

**ANNUAL REPORT ON
GROUNDWATER MONITORING AND
CORRECTIVE ACTION REPORT
SEDIMENTATION POND
A.B. BROWN GENERATING STATION
POSEY COUNTY, INDIANA**

by
Haley & Aldrich, Inc.
Greenville, South Carolina

for
Southern Indiana Gas and Electric Company
Evansville, Indiana

File No. 129420
January 2023

Table of Contents

	Page
List of Tables	ii
List of Figures	ii
List of Appendices	ii
1. Annual Groundwater Monitoring Report Summary	1
1.1 CODE OF FEDERAL REGULATIONS TITLE 40 (40 CFR) § 257.90(E)(6) SUMMARY	1
1.1.1 40 CFR § 257.90(e)(6)(i) – Status of Monitoring Program at Start of Reporting Period	1
1.1.2 40 CFR § 257.90(e)(6)(ii) – Status of Monitoring Program at End of Reporting Period	1
1.1.3 40 CFR § 257.90(e)(6)(iii) – Statistically Significant Increases	1
1.1.4 40 CFR § 257.90(e)(6)(iv) – Statistically Significant Levels	2
1.1.5 40 CFR § 257.90(e)(6)(v) – Selection of Remedy	3
1.1.6 40 CFR § 257.90(e)(6)(vi) – Remedial Activities	3
1.2 40 CFR § 257.90(A)	3
1.3 40 CFR § 257.90(E) – SUMMARY	3
1.3.1 Status of the Groundwater Monitoring Program	4
1.3.2 Key Actions Completed	4
1.3.3 Problems Encountered	4
1.3.4 Actions to Resolve Problems	4
1.3.5 Project Key Activities for Upcoming Year	5
1.4 40 CFR § 257.90(E) – INFORMATION	5
1.4.1 40 CFR § 257.90(e)(1)	5
1.4.2 40 CFR § 257.90(e)(2)	5
1.4.3 40 CFR § 257.90(e)(3)	5
1.4.4 40 CFR § 257.90(e)(4)	6
1.4.5 40 CFR § 257.90(e)(5)	6

List of Tables

Table No.	Title
1	Groundwater Monitoring Well Location and Construction Details
2	Summary of Groundwater Quality Data – May through November 2022

List of Figures

Figure No.	Title
1	Groundwater Monitoring Well Locations – Sedimentation Pond
2	Water Table Configuration – May 2022
3	Water Table Configuration – November 2022

List of Appendices

Appendix	Title
A	Summary of Statistical Analysis
B	Field Forms
C	Laboratory Analytical Reports

1. Annual Groundwater Monitoring Report Summary

1.1 CODE OF FEDERAL REGULATIONS TITLE 40 (40 CFR) § 257.90(e)(6) SUMMARY

A section at the beginning of the annual report that provides an overview of the current status of groundwater monitoring and corrective action programs for the CCR unit. At a minimum, the summary must specify all of the following:

1.1.1 40 CFR § 257.90(e)(6)(i) – Status of Monitoring Program at Start of Reporting Period

At the start of the current annual reporting period, whether the CCR unit was operating under the detection monitoring program in § 257.94 or the assessment monitoring program in § 257.95;

At the start of the current annual reporting period (1 January 2022), the Sedimentation Pond at A.B. Brown Generating Station (ABB) was operating under an assessment monitoring program in compliance with 40 CFR § 257.95.

1.1.2 40 CFR § 257.90(e)(6)(ii) – Status of Monitoring Program at End of Reporting Period

At the end of the current annual reporting period, whether the CCR unit was operating under the detection monitoring program in § 257.94 or the assessment monitoring program in § 257.95;

At the end of the current annual reporting period (31 December 2022), the Sedimentation Pond was operating under an assessment monitoring program in compliance with 40 CFR § 257.95.

1.1.3 40 CFR § 257.90(e)(6)(iii) – Statistically Significant Increases

If it was determined that there was a statistically significant increase over background for one or more constituents listed in appendix III to this part pursuant to § 257.94(e):

1.1.3.1 40 CFR § 257.90(e)(6)(iii)(A)

Identify those constituents listed in appendix III to this part and the names of the monitoring wells associated with such an increase; and

The Sedimentation Pond was operating under an assessment monitoring program throughout 2022; therefore, no statistical evaluations were conducted on Appendix III constituents in 2022.

1.1.3.2 40 CFR § 257.90(e)(6)(iii)(B)

Provide the date when the assessment monitoring program was initiated for the CCR unit.

An assessment monitoring program was established on 15 August 2018 for the Sedimentation Pond to meet the requirements of 40 CFR § 257.95. The Sedimentation Pond has remained in assessment monitoring since that time.

1.1.4 40 CFR § 257.90(e)(6)(iv) – Statistically Significant Levels

If it was determined that there was a statistically significant level above the groundwater protection standard for one or more constituents listed in appendix IV to this part pursuant to § 257.95(g) include all of the following:

1.1.4.1 40 CFR § 257.90(e)(6)(iv)(A) – Statistically Significant Level Constituents

Identify those constituents listed in appendix IV to this part and the names of the monitoring wells associated with such an increase;

Statistical analyses were completed in 2022 following the November 2021 and May 2022 semiannual assessment monitoring events as described in § 257.93(h)(2). Statistically significant levels (SSLs) were not identified in any of the monitoring wells in 2022. A summary of statistical analysis is provided as Appendix A.

1.1.4.2 40 CFR § 257.90(e)(6)(iv)(B) – Initiation of the Assessment of Corrective Measures

Provide the date when the assessment of corrective measures was initiated for the CCR unit;

An assessment of corrective measures has not been initiated for this unit since no SSLs have been identified through year end 2022. The Sedimentation Pond remained in assessment monitoring throughout 2022.

1.1.4.3 40 CFR § 257.90(e)(6)(iv)(C) – Assessment of Corrective Measures Public Meeting

Provide the date when the public meeting was held for the assessment of corrective measures for the CCR unit; and

An assessment of corrective measures is not required and therefore has not been initiated for the Sedimentation Pond through year end 2022; therefore, a public meeting was not held.

1.1.4.4 40 CFR § 257.90(e)(6)(iv)(D) – Completion of the Assessment of Corrective Measures

Provide the date when the assessment of corrective measures was completed for the CCR unit.

An assessment of corrective measures has not been completed for this unit. The Sedimentation Pond remained in assessment monitoring during 2022.

1.1.5 40 CFR § 257.90(e)(6)(v) – Selection of Remedy

Whether a remedy was selected pursuant to § 257.97 during the current annual reporting period, and if so, the date of remedy selection; and

Since an assessment of corrective measures has not been required, the selection of remedy under § 257.97 is not required.

1.1.6 40 CFR § 257.90(e)(6)(vi) – Remedial Activities

Whether remedial activities were initiated or are ongoing pursuant to § 257.98 during the current annual reporting period.

Remedial activities were not required in 2022; therefore, no demonstration or certification is applicable.

1.2 40 CFR § 257.90(a)

Except as provided for in § 257.100 for inactive CCR surface impoundments, all CCR landfills, CCR surface impoundments, and lateral expansions of CCR units are subject to the groundwater monitoring and corrective action requirements under § 257.90 through § 257.98.

The Sedimentation Pond at ABB is subject to the groundwater monitoring and corrective action requirements described under 40 CFR § 257.90 through § 257.98 (Rule). The remainder of this document addresses the requirement for the Owner/Operator to prepare an Annual Groundwater Monitoring and Corrective Action Report per § 257.90(e).

1.3 40 CFR § 257.90(e) – SUMMARY

Annual groundwater monitoring and corrective action report. For existing CCR landfills and existing CCR surface impoundments, no later than January 31, 2018, and annually thereafter, the owner or operator must prepare an annual groundwater monitoring and corrective action report. For new CCR landfills, new CCR surface impoundments, and all lateral expansions of CCR units, the owner or operator must prepare the initial annual groundwater monitoring and corrective action report no later than January 31 of the year following the calendar year a groundwater monitoring system has been established for such CCR unit as required by this subpart, and annually thereafter. For the preceding calendar year, the annual report must document the status of the groundwater monitoring and corrective action program for the CCR unit, summarize key actions completed, describe any problems encountered, discuss actions to resolve

the problems, and project key activities for the upcoming year. For purposes of this section, the owner or operator has prepared the annual report when the report is placed in the facility's operating record as required by § 257.105(h)(1).

This Annual Groundwater Monitoring and Corrective Action Report documents the activities completed in 2022 for the Sedimentation Pond as required by the Rule. Semi-annual groundwater sampling and analysis was conducted per the requirements described in § 257.93, and the status of the groundwater monitoring program described in § 257.95 is provided in this report. Field forms for the groundwater sampling events are provided in Appendix B. Laboratory analytical reports are provided in Appendix C.

1.3.1 Status of the Groundwater Monitoring Program

Annual and semi-annual groundwater sampling continued in May 2022 and November 2022 as outlined in § 257.95(b) and 257.95(d)(1). Statistical analyses were completed within 90-days following completion of the sampling and analysis events as described in § 257.93(h)(2). The results of these statistical analyses continued to demonstrate that SSLs of Appendix IV constituents were not present in groundwater downgradient of the Sedimentation Pond. Although SSLs were not present, some concentrations are above background, therefore in accordance with 257.95(f), the Sedimentation Pond will continue with semiannual assessment monitoring.

1.3.2 Key Actions Completed

The following key actions were completed in 2022:

- Per the requirements of 257.93(c) of the Rule, static water level measurements were collected during each sampling event to evaluate groundwater flow direction and rate.
- Completed statistical analyses of assessment monitoring results to evaluate potential SSLs.
- Prepared 2021 Annual Report including:
 - Pursuant to § 257.105(h)(1), the Annual Report was placed in the facility's operating record;
 - Pursuant to § 257.106(h)(1), the notification was sent to the relevant State Director and/or Tribal authority within 30 days of the Annual Report being placed in the facility's operating record [§ 257.106(d)];
 - Pursuant to § 257.107(h)(1), the Annual Report was posted to the CCR Website within 30 days of the Annual Report being placed in the facility's operating record [§ 257.107(d) and 257.107(h)(1)];
- Collected and analyzed two rounds of groundwater samples in accordance with § 257.95(b) and § 257.95(d)(1).

1.3.3 Problems Encountered

Problems such as damaged wells, issues with sample collection or lack of sampling or problems with laboratory analyses were not encountered at the Sedimentation Pond in 2022.

1.3.4 Actions to Resolve Problems

Actions to resolve problems were not required.

1.3.5 Project Key Activities for Upcoming Year

Key activities to be completed in 2023 include the following:

- Continue semiannual assessment monitoring as required by § 257.95.
- Complete statistical analyses of the semiannual groundwater sampling results as required by § 257.93(h)(2).

1.4 40 CFR § 257.90(e) – INFORMATION

At a minimum, the annual groundwater monitoring and corrective action report must contain the following information, to the extent available:

1.4.1 40 CFR § 257.90(e)(1)

A map, aerial image, or diagram showing the CCR unit and all background (or upgradient) and downgradient monitoring wells, to include the well identification numbers, that are part of the groundwater monitoring program for the CCR unit;

As required by § 257.90(e)(1), a map showing the locations of the Sedimentation Pond and associated upgradient, and downgradient wells is presented as Figure 1. Groundwater elevation contours for the May 2022 event are presented as Figure 2. Groundwater elevation contours created for the November 2022 event are presented as Figure 3.

1.4.2 40 CFR § 257.90(e)(2)

Identification of any monitoring wells that were installed or decommissioned during the preceding year, along with a narrative description of why those actions were taken;

Additional monitoring wells were not installed nor were any monitoring wells decommissioned during 2022. However, location and construction details of the existing monitoring well network for the Sedimentation Pond is provided for reference as Table 1.

1.4.3 40 CFR § 257.90(e)(3)

In addition to all the monitoring data obtained under § 257.90 through § 257.98, a summary including the number of groundwater samples that were collected for analysis for each background and downgradient well, the dates the samples were collected, and whether the sample was required by the detection monitoring or assessment monitoring programs;

In accordance with § 257.95(b) and § 257.95(d)(1), two independent samples from each background and downgradient monitoring well were collected and analyzed. A summary table including the sample names, dates of sample collection, reason for sample collection (detection or assessment), and monitoring data obtained for the groundwater monitoring program for the Sedimentation Pond is presented in Table 2 of this report.

1.4.4 40 CFR § 257.90(e)(4)

A narrative discussion of any transition between monitoring programs (e.g., the date and circumstances for transitioning from detection monitoring to assessment monitoring in addition to identifying the constituent(s) detected at a statistically significant increase over background levels); and

The statistical analyses completed in 2022 determined that SSLs of Appendix IV constituents were not present downgradient of the Sedimentation Pond, though some concentrations are above background. As a result, this CCR Unit remains in assessment monitoring and semiannual sampling will continue in 2022. Statistical analysis for the November 2022 sampling event is ongoing and will be completed within 90 days after sampling and analysis to determine if a statistically significant increase over background has occurred.

1.4.5 40 CFR § 257.90(e)(5)

Other information required to be included in the annual report as specified in § 257.90 through § 257.98.

Other information including development of groundwater protection standards and recording of groundwater monitoring results in the operating record were discussed in prior annual reports.

TABLES

TABLE 1

PAGE 1 OF 1

GROUNDWATER MONITORING WELL LOCATION AND CONSTRUCTION DETAILS

A.B. BROWN GENERATING STATION - SEDIMENTATION POND

MOUNT VERNON, INDIANA

Well	CCR Unit	Date Installed	Easting	Northing	Top of Pad Elevation (ft msl)	Top of Riser Elevation (ft msl)	Surface Grout (ft bgs)	Bentonite (ft bgs)	Sand Pack (ft bgs)	Screen Zone (ft bgs)	Screen Length (ft)	Well Radius (in)	Status	
CCR-SP-1	Sediment Pond	March 2016	2770030.26	970981.89	403.90	403.51	0.0 - 6.0	6.0 - 8.0	8.0 - 20.0	10.00	-	20.00	10	2 Active
CCR-SP-2	Sediment Pond	March 2016	2769939.51	970887.25	403.60	403.23	0.0 - 6.0	6.0 - 8.0	8.0 - 20.0	10.00	-	20.00	10	2 Active
CCR-SP-3	Sediment Pond	March 2016	2770027.64	970735.02	403.90	403.57	0.0 - 6.0	6.0 - 8.0	8.0 - 20.0	10.00	-	20.00	10	2 Active
CCR-BK-1R	Background	March 2016	2770919.08	974083.40	480.10	483.39	0.0 - 50.0	50.0 - 52.0	52.0 - 64.0	54.00	-	64.00	10	2 Active
CCR-BK-2	Background	March 2016	2769728.14	972854.33	427.50	430.60	0.0 - 11.5	11.5 - 13.5	13.5 - 25.5	15.50	-	25.50	10	2 Active

Notes:

bgs = below ground surface

ft = feet

in = inches

msl = mean sea level

Datum of Elevations in NAVD 88

TABLE 2

SUMMARY OF GROUNDWATER QUALITY DATA - MAY THROUGH NOVEMBER 2022

A.B. BROWN GENERATION STATION - SEDIMENTATION POND

MOUNT VERNON, INDIANA

Location Group	Action Level	Background				
		Maximum Contaminant Level/ Regional Screening Levels	CCR-BK-1R CCR-BK-1-20220518 05/18/2022 180-138328-3	CCR-BK-1R CCR-BK-1-20221108 11/08/2022 180-147725-6	CCR-BK-2 CCR-BK-2-20220518 05/18/2022 180-138328-4	CCR-BK-2 CCR-BK-2-20221108 11/08/2022 180-147725-7
Detection Monitoring - EPA Appendix III Constituents (mg/L)						
Boron, Total	NA	0.08 U	0.08 U	0.08 U	0.08 U	
Calcium, Total	NA	49	47	47	39	
Chloride	NA	7 J-	8.9	36 J-	19	
Fluoride	4	0.33 J+	0.23 U	0.34 J+	0.11 U	
pH (lab) (pH units)	NA	7.6 J	7.5 J	7.3 J	7.4 J	
Sulfate	NA	31 J-	41	64 J-	22	
Total Dissolved Solids (TDS)	NA	300	290	270	240	
Assessment Monitoring - EPA Appendix IV Constituents (mg/L)						
Antimony, Total	0.006	0.002 U	0.002 U	0.002 U	0.002 U	
Arsenic, Total	0.01	0.001 U	0.001 U	0.001 U	0.001 U	
Barium, Total	2	0.038	0.063	0.037	0.036	
Beryllium, Total	0.004	0.001 U	0.001 U	0.001 U	0.001 U	
Cadmium, Total	0.005	0.001 U	0.001 U	0.001 U	0.001 U	
Chromium, Total	0.1	0.002 U	0.002 U	0.002 U	0.002 U	
Cobalt, Total	0.006	0.0005 U	0.0005 U	0.0005 U	0.0005 U	
Fluoride (mg/L)	4	0.33 J+	0.23 U	0.34 J+	0.11 U	
Lead, Total	0.015	0.00018 J	0.001 U	0.001 U	0.001 U	
Lithium, Total	0.04	0.0025 J	0.0065	0.0025 J	0.0021 J	
Mercury, Total	0.002	0.0002 U	0.0002 U	0.0002 U	0.0002 U	
Molybdenum, Total	0.1	0.00074 J	0.0011 J	0.00063 J	0.005 U	
Selenium, Total	0.05	0.005 U	0.005 U	0.005 U	0.005 U	
Thallium, Total	0.002	0.001 U	0.001 U	0.001 U	0.001 U	
Radiological (pCi/L)						
Radium-226	NA	1 U ± 0.201	0.39 ± 0.207	1 UJ ± 0.114	1 U ± 0.21	
Radium-228	NA	1 U ± 0.332	1 U ± 0.297	1 U ± 0.202	1 U ± 0.494	
Radium-226 & 228	5	0.576 ± 0.388	5 UJ ± 0.362	5 U ± 0.232	0.894 U ± 0.537	
Field Parameters						
Temperature (Deg C)	NA	15.59	15.59	14.78	21.9	
Dissolved Oxygen, Field (mg/L)	NA	6.26	5.04	0.56	3.28	
Conductivity, Field (mS/cm)	NA	0.49655	0.332	0.52726	0.286	
Oxidation Reduction Potential (ORP), Field (mv)	NA	187.3	92.8	174	77	
Turbidity, Field (NTU)	NA	0	6.6	0.32	110	
pH, Field (SU)	NA	6.85	6.59	6.9	6.46	

ABBREVIATIONS AND NOTES:

CCR: Coal Combustion Residuals.

mg/L: milligram per liter.

pCi/L: picoCurie per liter.

USEPA: United States Environmental Protection Agency.

Results in **bold** are detected.

- USEPA. 2016. Final Rule: Disposal of Coal Combustion Residuals from Electric Utilities. July 26. 40 CFR Part 257.

<https://www.epa.gov/coalash/coal-ash-rule>

TABLE 2

SUMMARY OF GROUNDWATER QUALITY DATA - MAY THROUGH NOVEMBER 2022

A.B. BROWN GENERATION STATION - SEDIMENTATION POND

MOUNT VERNON, INDIANA

Location Group	Action Level	Downgradient								
		Maximum Contaminant Level/ Regional Screening Levels	CCR-SP-1 CCR-SP-1-20220519 05/19/2022 180-138465-1	CCR-SP-1 CCR-SP-1-20221104 11/04/2022 180-147725-1	CCR-SP-2 CCR-SP-2-20220519 05/19/2022 180-138465-2	CCR-SP-2 CCR-SP-2-20221107 11/07/2022 180-147725-2	CCR-SP-2 BLIND DUP-20221107 11/07/2022 180-147725-4	CCR-SP-3 CCR-SP-3-20220519 05/19/2022 180-138465-3	CCR-SP-3 DUPLICATE-2-20220519 05/19/2022 180-138465-4	CCR-SP-3 CCR-SP-3-20221107 11/07/2022 180-147725-3
Detection Monitoring - EPA Appendix III Constituents (mg/L)										
Boron, Total	NA	0.31	0.46	0.12	0.17	0.12	0.08 U	0.08 U	0.08 U	0.08 U
Calcium, Total	NA	240	240	180	180	190	100	96	85	85
Chloride	NA	100	97	53	72	72	12 J+	12 J+	5.9	5.9
Fluoride	4	0.17	0.25 U	0.24	0.16 U	0.16 U	0.41	0.34	0.26 U	0.26 U
pH (lab) (pH units)	NA	7.6 J	7.4 J	7.1 J	7.6 J	7.5 J	7.3 J	7.3 J	7.7 J	7.7 J
Sulfate	NA	530	810	260	390	390	28	25	2 J+	2 J+
Total Dissolved Solids (TDS)	NA	1600	1700	940	1100	1100	420	410	380	380
Assessment Monitoring - EPA Appendix IV Constituents (mg/L)										
Antimony, Total	0.006	0.002 U	0.002 U	0.002 U	0.002 U	0.002 U	0.002 U	0.002 U	0.002 U	0.002 U
Arsenic, Total	0.01	0.004	0.0074	0.016	0.011	0.0092	0.0071	0.0072	0.0088	0.0088
Barium, Total	2	0.094	0.064	0.081	0.096	0.1	0.08	0.077	0.076	0.076
Beryllium, Total	0.004	0.001 U	0.001 U	0.001 U	0.001 U	0.001 U	0.001 U	0.001 U	0.001 U	0.001 U
Cadmium, Total	0.005	0.001 U	0.001 U	0.001 U	0.001 U	0.001 U	0.001 U	0.001 U	0.001 U	0.001 U
Chromium, Total	0.1	0.002 U	0.002 U	0.002 U	0.002 U	0.002 U	0.002 U	0.002 U	0.002 U	0.002 U
Cobalt, Total	0.006	0.0081	0.0042	0.00087	0.00065	0.00063	0.0011	0.001	0.00054	0.00054
Fluoride (mg/L)	4	0.17	0.25 U	0.24	0.16 U	0.16 U	0.41	0.34	0.26 U	0.26 U
Lead, Total	0.015	0.00021 J	0.001 U	0.00071 J	0.001 U	0.001 U	0.00026 J	0.00025 J	0.001 U	0.001 U
Lithium, Total	0.04	0.0043 J	0.0061	0.0056	0.0053	0.0057	0.0018 J	0.0019 J	0.005 U	0.005 U
Mercury, Total	0.002	0.0002 U	0.0002 U	0.0002 U	0.0002 U	0.0002 U	0.0002 U	0.0002 U	0.0002 U	0.0002 U
Molybdenum, Total	0.1	0.00092 J	0.00061 J	0.0017 J	0.0012 J	0.00096 J	0.0042 J	0.0043 J	0.011	0.011
Selenium, Total	0.05	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U	0.005 U
Thallium, Total	0.002	0.001 U	0.001 U	0.001 U	0.001 U	0.001 U	0.001 U	0.001 U	0.001 U	0.001 U
Radiological (pCi/L)										
Radium-226	NA	1 U ± 0.184	1 U ± 0.253	1 U ± 0.199	1 U ± 0.429	1 U ± 0.262	1 U ± 0.143	1 U ± 0.136	1 U ± 0.177	1 U ± 0.177
Radium-228	NA	1 U ± 0.382	1 U ± 0.334	1 U ± 0.496	1 U ± 0.569	0.786 ± 0.449	1 U ± 0.327	1 U ± 0.226	1 U ± 0.397	1 U ± 0.397
Radium-226 & 228	5	0.676 ± 0.424	5 U ± 0.419	5 U ± 0.534	5 U ± 0.713	1.08 UJ ± 0.52	0.509 ± 0.357	5 U ± 0.264	5 U ± 0.435	5 U ± 0.435
Field Parameters										
Temperature (Deg C)	NA	13.25	18.71	14.41	17.24	17.24	13.51	13.51	18.98	18.98
Dissolved Oxygen, Field (mg/L)	NA	0.02	0.18	0.01	0.1	0.1	0.11	0.11	0.23	0.23
Conductivity, Field (mS/cm)	NA	2.3987	1.363	1.5028	1.15	1.15	0.77121	0.77121	0.476	0.476
Oxidation Reduction Potential (ORP), Field (mv)	NA	-26.7	-194	-86.6	-97	-97	-19.7	-19.7	-41	-41
Turbidity, Field (NTU)	NA	0	0	20.64	0	0	7.41	7.41	139	139
pH, Field (SU)	NA	6.6	6.25	6.91	6.66	6.66	7.11	7.11	6.76	6.76

ABBREVIATIONS AND NOTES:

CCR: Coal Combustion Residuals.

mg/L: milligram per liter.

pCi/L: picoCurie per liter.


USEPA: United States Environmental Protection Agency.

Results in **bold** are detected.

- USEPA. 2016. Final Rule: Disposal of Coal Combustion Residuals from Electric Utilities. July 26. 40 CFR Part 257.

<https://www.epa.gov/coalash/coal-ash-rule>

FIGURES

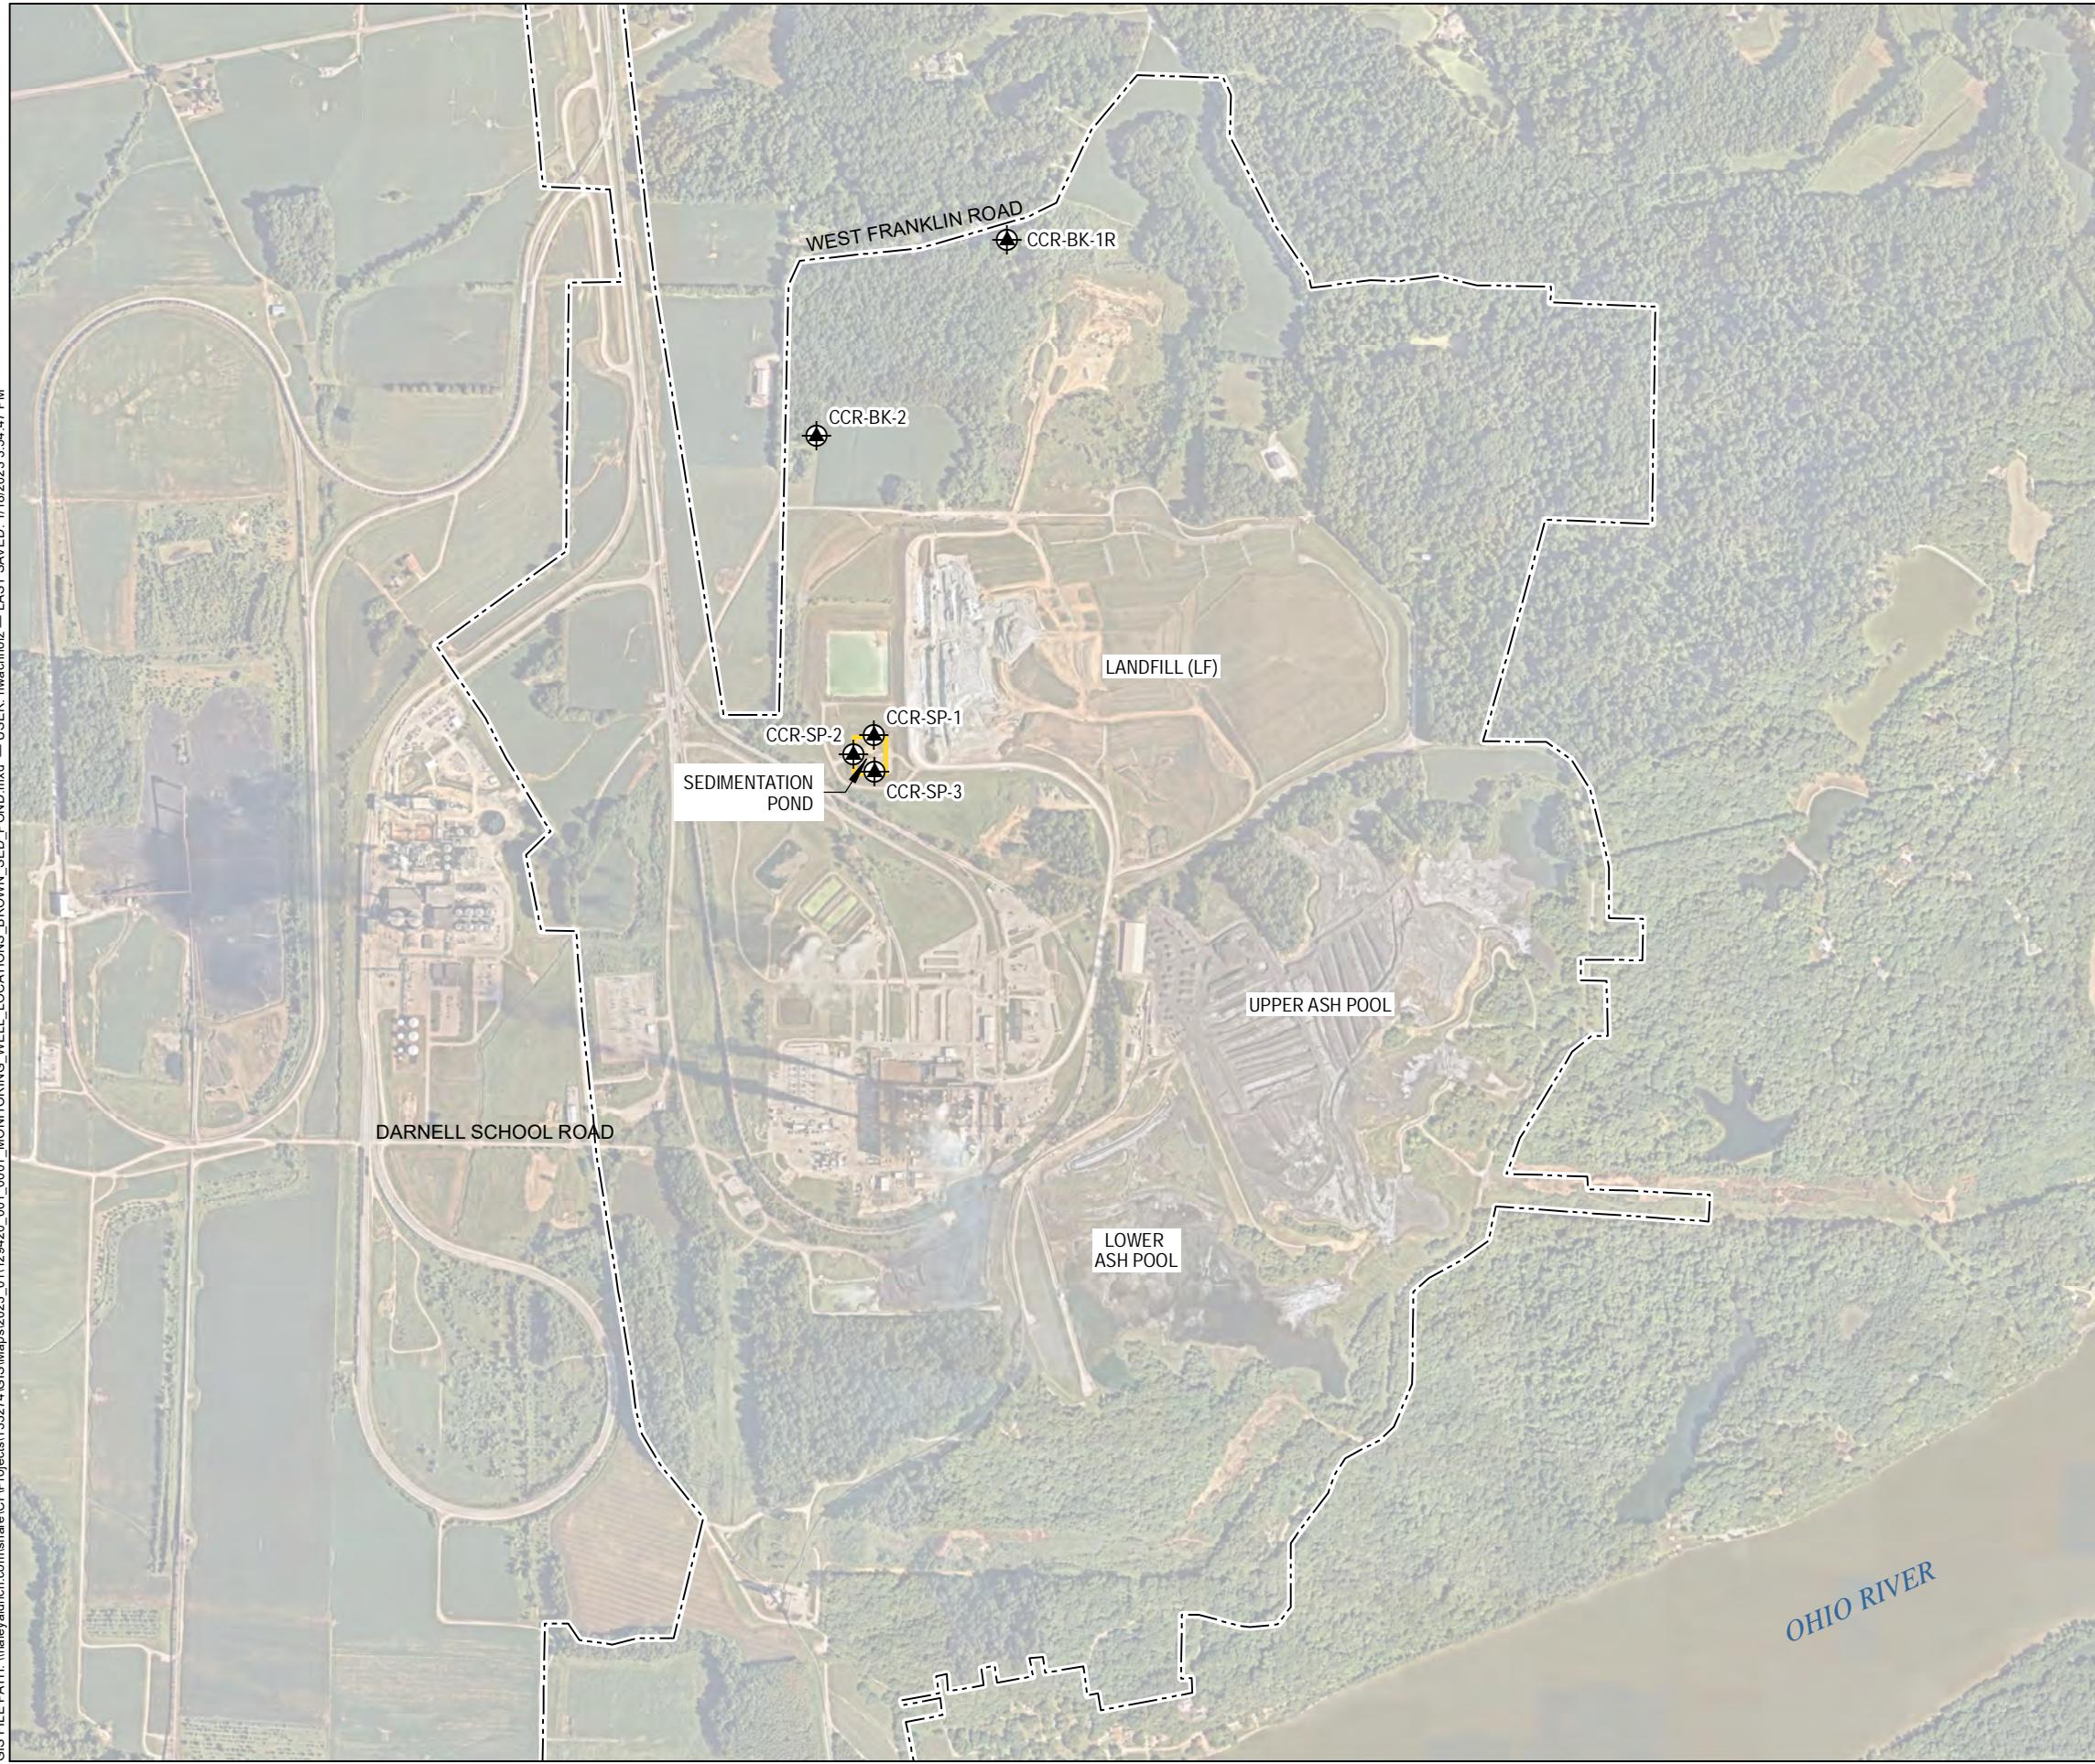

LEGEND

- CCR MONITORING WELL
- PROPERTY BOUNDARY
- CCR REGULATED UNIT BOUNDARY

NOTES

- ALL LOCATIONS AND DIMENSIONS ARE APPROXIMATE.
- AERIAL IMAGERY SOURCE: NEARMAP, 24 AUGUST 2022



0 1,100 2,200
SCALE IN FEET


HALEY
ALDRICH

SOUTHERN INDIANA GAS AND ELECTRIC COMPANY
A.B. BROWN GENERATING STATION
MOUNT VERNON, INDIANA

GROUNDWATER MONITORING
WELL LOCATIONS -
SEDIMENTATION POND

JANUARY 2023

FIGURE 1

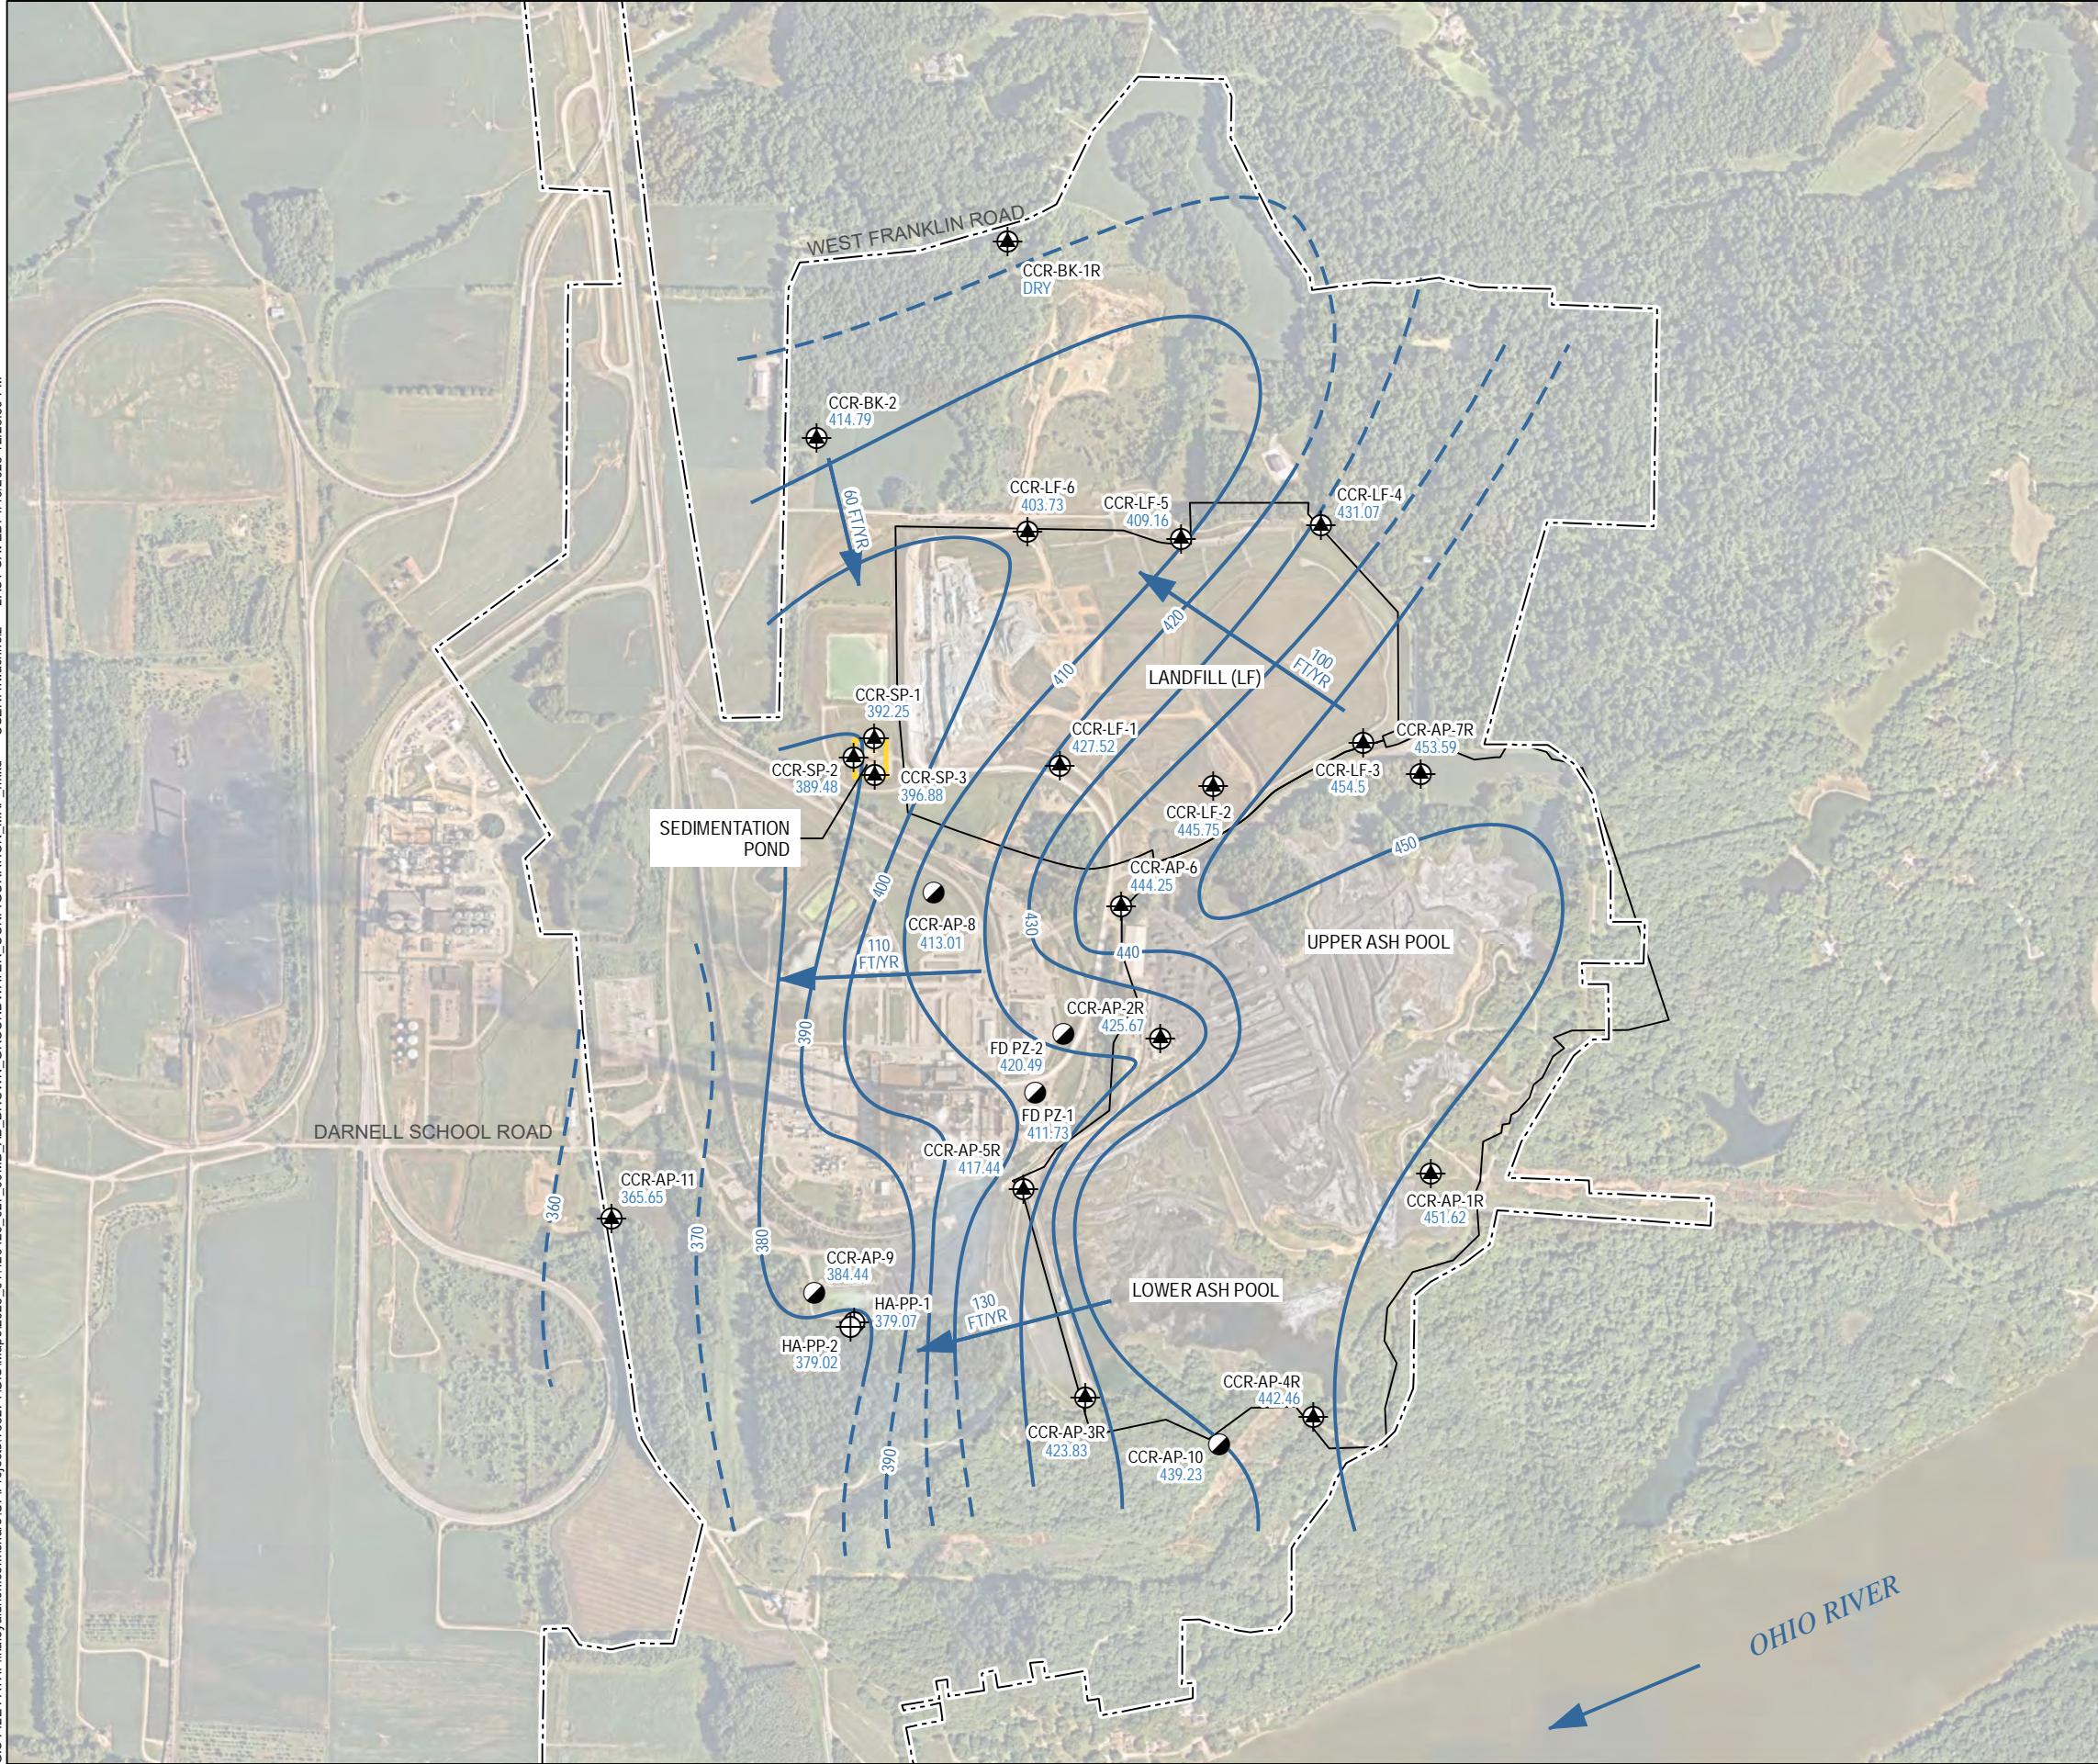

LEGEND

- CCR MONITORING WELL
- NATURE AND EXTENT MONITORING WELL
- CCR PIEZOMETER WELL
- GROUNDWATER ELEVATION CONTOUR, 10-FT INTERVAL, DASHED WHERE INFERRED
- GROUNDWATER FLOW DIRECTION
- CCR REGULATED UNIT BOUNDARY
- ASH POND/LANDFILL
- PROPERTY BOUNDARY

NOTES

- ALL LOCATIONS AND DIMENSIONS ARE APPROXIMATE.
- CCR REGULATED UNITS INCLUDE THE ASH POND, LANDFILL, AND SEDIMENTATION POND.
- GROUNDWATER ELEVATIONS WERE MEASURED 16 MAY 2022
- APPROXIMATE GROUNDWATER FLOW RATE CALCULATED USING
 $V = k/i/n_e$ WHERE
 V = GROUNDWATER FLOW VELOCITY IN FEET PER DAY
 k = HORIZONTAL HYDRAULIC CONDUCTIVITY IN FEET PER DAY
 i = HORIZONTAL GROUNDWATER GRADIENT IN FEET PER FOOT
 n_e = ASSUMED EFFECTIVE POROSITY
- AERIAL IMAGERY SOURCE: NEARMAP, 24 AUGUST 2022



0 1,100 2,200
SCALE IN FEET


HALEY
ALDRICH

SOUTHERN INDIANA GAS AND ELECTRIC COMPANY
A.B. BROWN GENERATING STATION
MOUNT VERNON, INDIANA

WATER TABLE CONFIGURATION MAP
MAY 2022

JANUARY 2023

FIGURE 2

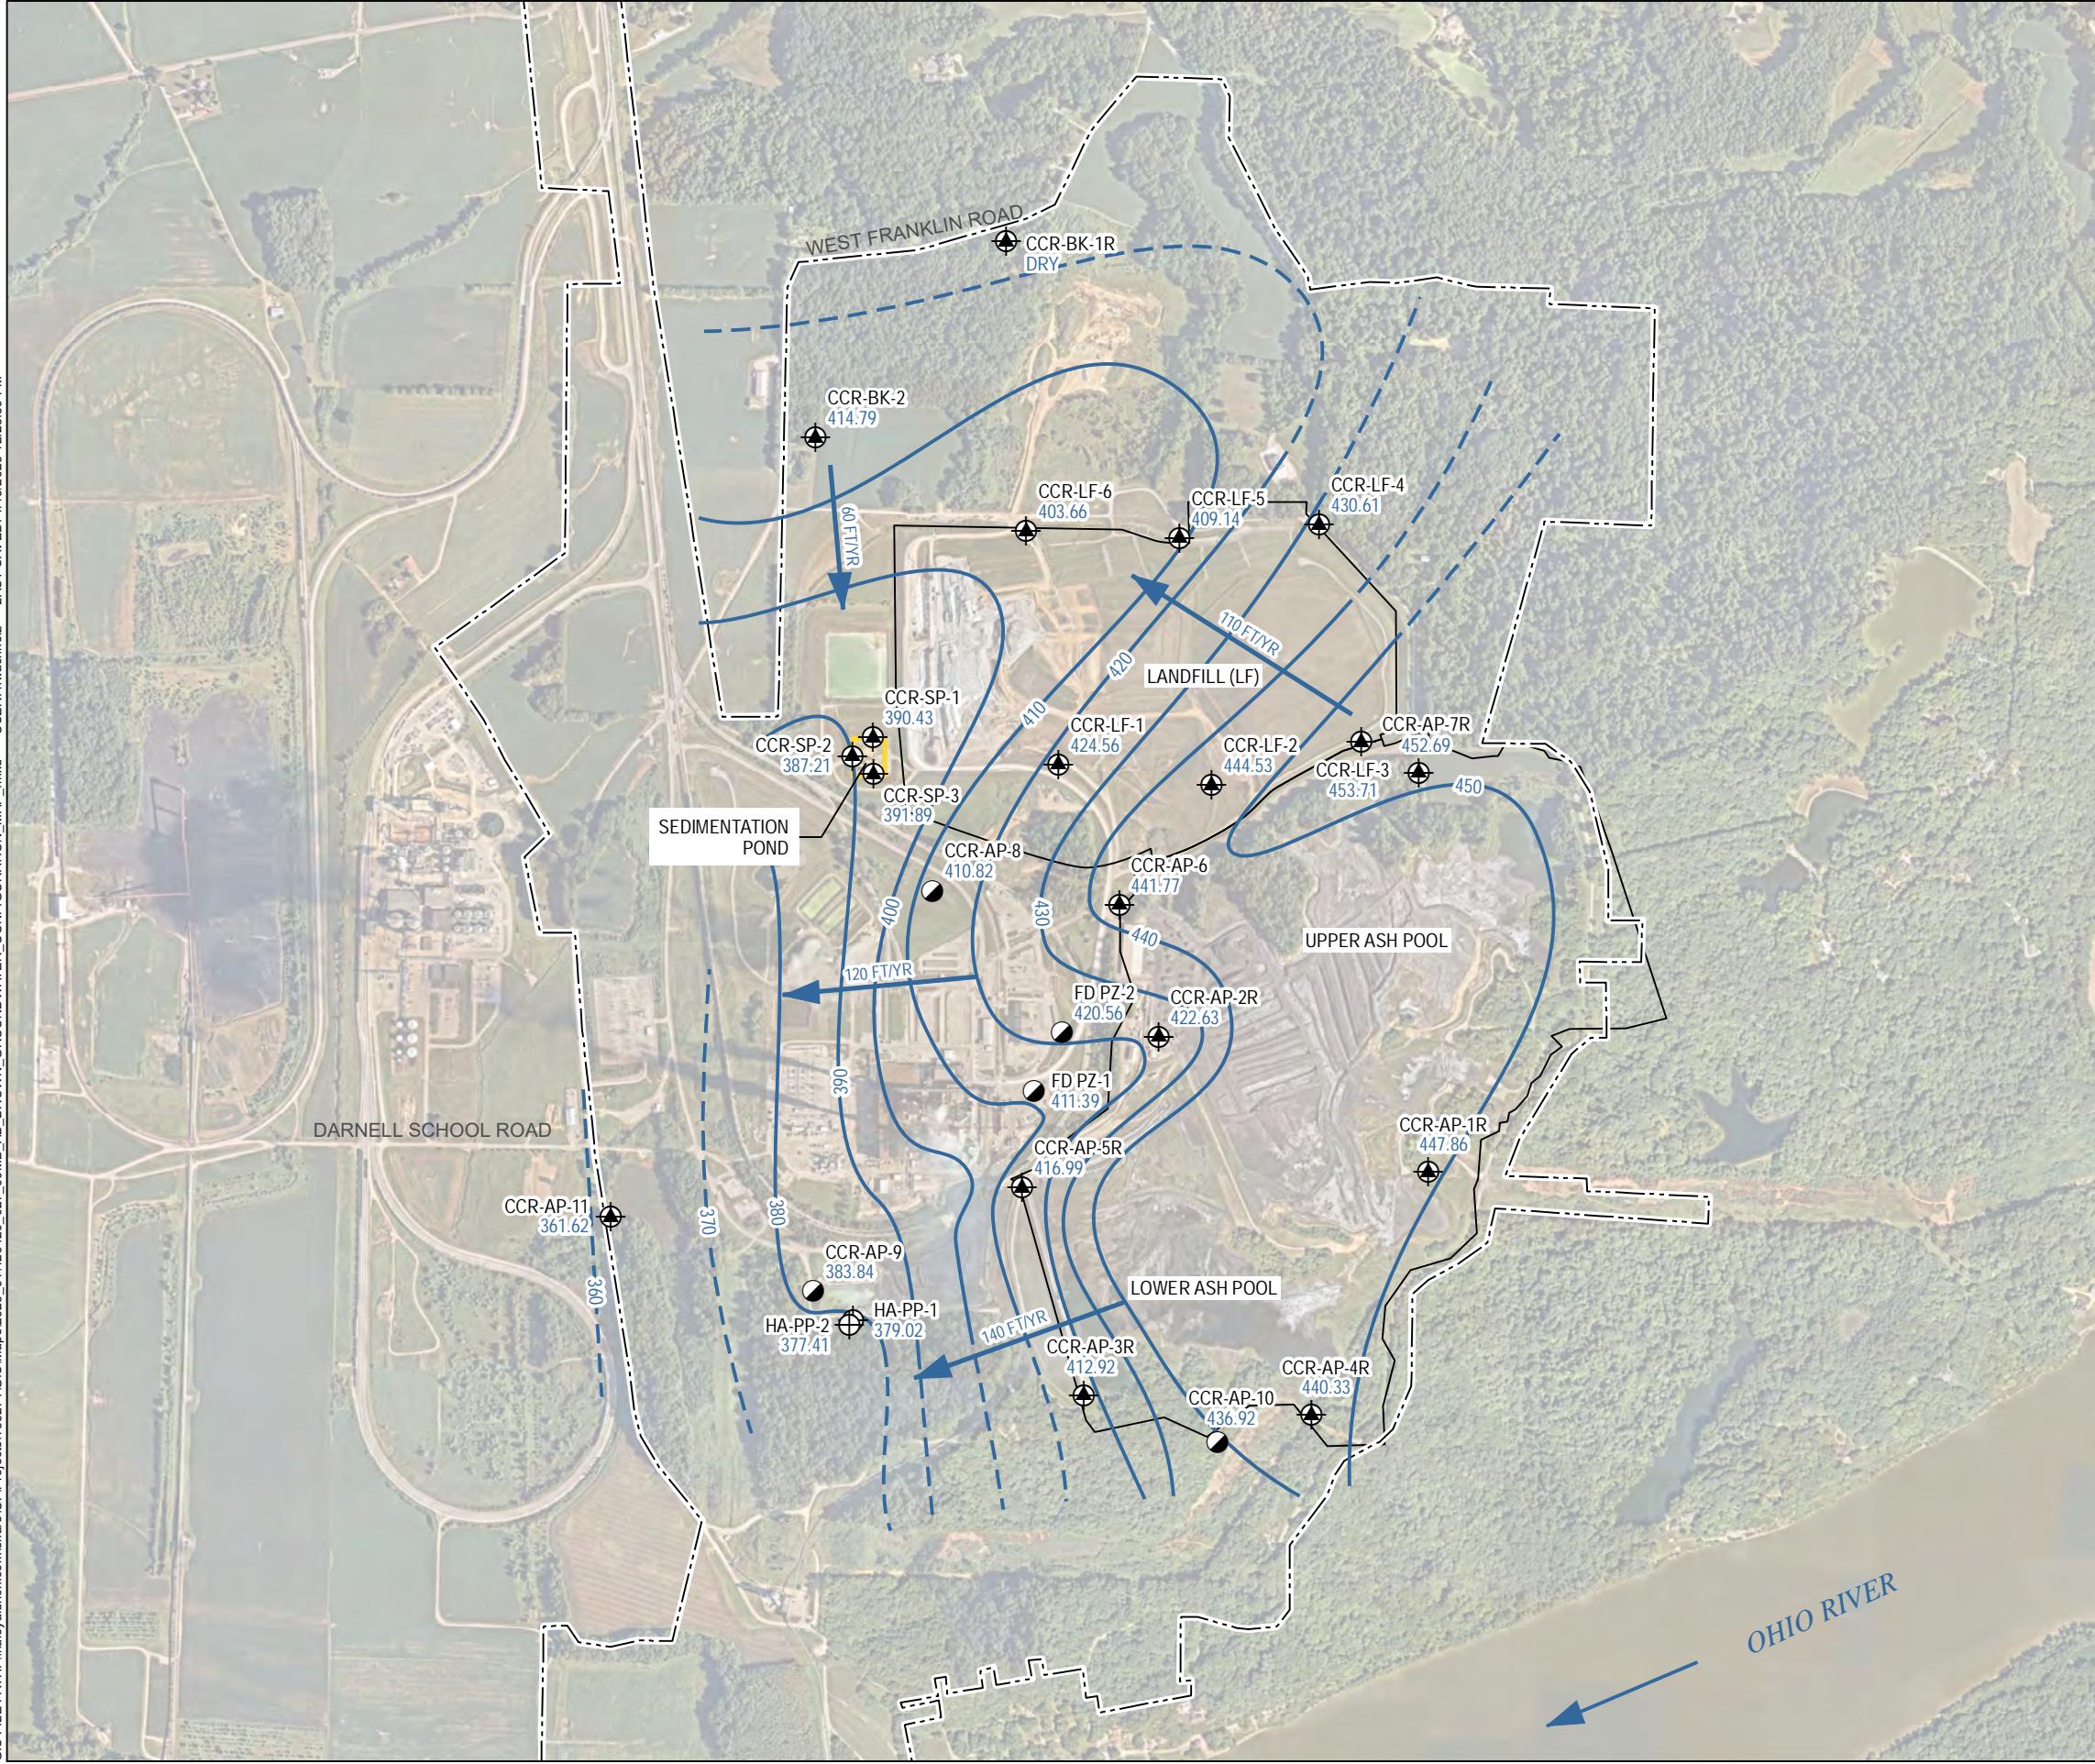

LEGEND

- CCR MONITORING WELL
- NATURE AND EXTENT MONITORING WELL
- CCR PIEZOMETER WELL
- GROUNDWATER ELEVATION CONTOUR, 10-FT INTERVAL, DASHED WHERE INFERRED
- GROUNDWATER FLOW DIRECTION
- CCR REGULATED UNIT BOUNDARY
- ASH POND/LANDFILL
- PROPERTY BOUNDARY

NOTES

1. ALL LOCATIONS AND DIMENSIONS ARE APPROXIMATE.
2. CCR REGULATED UNITS INCLUDE THE ASH POND, LANDFILL, AND SEDIMENTATION POND.
3. GROUNDWATER ELEVATIONS WERE MEASURED 1 NOVEMBER 2022
4. APPROXIMATE GROUNDWATER FLOW RATE CALCULATED USING $V = ki/n_e$ WHERE
 V = GROUNDWATER FLOW VELOCITY IN FEET PER DAY
 k = HORIZONTAL HYDRAULIC CONDUCTIVITY IN FEET PER DAY
 i = HORIZONTAL GROUNDWATER GRADIENT IN FEET PER FOOT
 n_e = ASSUMED EFFECTIVE POROSITY
5. AERIAL IMAGERY SOURCE: NEARMAP, 24 AUGUST 2022



0 1,100 2,200
SCALE IN FEET

HALEY
ALDRICH

SOUTHERN INDIANA GAS AND ELECTRIC COMPANY
A.B. BROWN GENERATING STATION
MOUNT VERNON, INDIANA

WATER TABLE CONFIGURATION MAP
NOVEMBER 2022

JANUARY 2023

FIGURE 3

APPENDIX A

Summary of Statistical Analysis



HALEY & ALDRICH, INC.
400 Augusta Street
Suite 100
Greenville, SC 29601
864.214.8750

TECHNICAL MEMORANDUM

25 March 2022
File No. 0129420

TO: Southern Indiana Gas and Electric Company

FROM: Haley & Aldrich, Inc.
Mark Miesfeldt, Lead Hydrogeologist
Steven F. Putrich, P.E., Project Principal

SUBJECT: Statistical Evaluation of the November 2021 Semi-Annual Groundwater Assessment Monitoring Data
Southern Indiana Gas and Electric Company
Sedimentation Pond
A.B. Brown Generating Station; Posey County, Indiana

Pursuant to Title 40 Code of Federal Regulations (40 CFR) § 257.93 and § 257.95 (Rule), this memorandum summarizes the statistical evaluation of the analytical results for the November 2021 semi-annual assessment monitoring event for the A.B. Brown Generating Station Sedimentation Pond. Haley & Aldrich, Inc. (Haley & Aldrich) completed this statistical evaluation to determine if Appendix IV groundwater monitoring constituents have been detected in downgradient wells at statistically significant levels (SSL) greater than Groundwater Protection Standards (GWPS), consistent with the requirements in 40 CFR § 257.95.

Methods used during this statistical analysis are described in the *Statistical Data Analysis Plan for the A.B. Brown Generating Station Sediment Pond* (Haley & Aldrich, 2017). A summary of how applicable performance standards described in § 257.93 (g) were achieved include:

- § 257.93 (g) (1) – Data set distribution was evaluated using basic summary statistics, graphical methods, and the Shapiro-Wilks Test of Normality. Parametric methods were used where normal distributions were identified. Those data sets were evaluated for outliers using box plots, Dixon's test and Rosner's test. Outlier identification and data set distribution groups are summarized in Table I.
- § 257.93 (g) (2) – Not applicable
- § 257.93 (g) (3) – Not applicable
- § 257.93 (g) (4) – Levels of confidence and additional supporting information for the use of tolerance intervals and prediction limits are included in Table I.
- § 257.93 (g) (5) – Non-detect values were accounted for by simple substitution, where the detection limit replaced the non-detect result. Non-detect values are identified and summarized in Table I.

- § 257.93 (g) (6) – Time series plots for groundwater monitoring wells included in this evaluation were reviewed to identify potential seasonal variability. No additional statistics to account for seasonality or spatial variability were necessary.

Data from the groundwater sampling event for the downgradient monitoring wells (CCR-SP-1 through CCR-SP-3) were compared to the GWPS established from the background dataset for the upgradient monitoring wells (CCR-BK-1 and CCR-BK-2) for detected Appendix IV constituents. GWPS for each of the Appendix IV constituents have been set equal to the highest value of the maximum contaminant level, regional screening level, or background concentration. The results of the assessment monitoring statistical evaluation are discussed below and provided in Table I.

Development of GWPS

The Rule provides four specific options for statistical evaluation of groundwater quality data collected at a coal combustion residual (CCR) unit (40 CFR §257.93(f) (1-4)). Haley & Aldrich certified the tolerance limit (TL) as the statistical method used for developing background concentration for the GWPS on 14 January 2019. As noted above, the GWPS for each of the Appendix IV constituents have been set equal to the highest value of the maximum contaminant level (MCL), regional screening level (RSL), or background concentration. The most recent groundwater sampling result from each compliance well was compared to the GWPS to determine if additional statistical testing is warranted.

STATISTICAL EVALUATION

An interwell statistical evaluation was used to identify SSLs. An interwell evaluation compares the most recent values from downgradient compliance wells to a background dataset composed of upgradient well data. Because the CCR unit is in assessment monitoring, no statistical evaluations were conducted on Appendix III (detection monitoring) constituents.

The parametric TL method was used to complete statistical evaluations of the referenced dataset. The TL procedure is one in which a concentration limit for each constituent is established from the distribution of the background data, with a minimum 95 percent confidence level. The upper endpoint of a tolerance interval is called the UTL. Depending on the data distribution, parametric or non-parametric TL procedures are used to evaluate groundwater monitoring data using this method. Parametric TLs utilize normally distributed data or data normalized via a transformation of the sample background data used to construct the limit. If the data are non-normal and a transformation is not indicated, non-parametric procedures (order statistics or bootstrap methods) are used to calculate the TL. If all the background data are non-detect, a maximum reporting limit may serve as an appropriate UTL.

These statistical evaluations were conducted using the background dataset for detected Appendix IV constituents using parametric TL. If an Appendix IV constituent concentration from the November 2021 sampling event was greater than the GWPS, the lower confidence limit (LCL) for the downgradient well constituent was used to evaluate if an SSL was indicated. The LCL is the lower end of the confidence interval range, which is an estimated concentration range intended to contain the true mean or median

of the population from which the sample is drawn. The confidence interval range is designed to locate the true population mean or median with a high degree of statistical confidence, or conversely, with a low probability of error.

The UTLs were calculated from the background well dataset using Chemstat software after testing for outlier sample results that would warrant removal from the dataset based on likely error in sampling or measurement. Both visual and statistical outlier tests for the background data were performed using Chemstat and U.S. Environmental Protection Agency's ProUCL 5.1 software, and a visual inspection of the data was performed using box plots and distribution plots for the downgradient sample data. No sample data were identified as outliers that warranted removal from the dataset.

BACKGROUND DISTRIBUTIONS

The groundwater analytical results for each sampling event from the background sample locations were combined to calculate the UTL for each detected Appendix IV constituent. The variability and distribution of the pooled dataset was evaluated to determine the method for UTL calculation. The background concentrations were periodically updated per the document *Statistical Analysis of Groundwater Monitoring Data at RCRA Facilities, Unified Guidance*, March 2009 (Unified Guidance).

TREND SUMMARY

Mann Kendall trend analyses were performed on data sets of sufficient sample size. Results of the trend analysis are included on Table I. In summary, 95 percent of trends analyzed are identified as stable or decreasing.

RESULTS OF APPENDIX IV DOWNGRADIENT STATISTICAL COMPARISONS

The sample concentrations from the downgradient wells for each of the detected Appendix IV constituents from the November 2021 assessment monitoring event were compared to their respective GWPS (Table I). A sample concentration greater than the GWPS is considered to represent an SSL. Based on previous compliance sampling events and statistical evaluations, interwell comparisons were utilized for downgradient wells and constituents. Based on this statistical evaluation an SSL greater than the GWPS was not identified at the Sedimentation Pond. As a result, the Sedimentation Pond will remain in Assessment Monitoring.

Tables:

Table I – Summary of Assessment Monitoring Statistical Evaluation – November 2021

\haleyaldrich.com\share\grn_common\129420 Vectren\Deliverables\AB_Brown\Annual Report\2023\Sedimentation Pond\Appendices\App A - Summary of Statistical Analysis\November 2021\2022-0325-HAI-ABB-GW Stats Summary_SSL Notification_Sedimentation Pond_F.docx

TABLE

TABLE I
SUMMARY OF ASSESSMENT MONITORING STATISTICAL EVALUATION - NOVEMBER 2021
A.B. BROWN GENERATING STATION - SEDIMENTATION POND
PREPARED: FEBRUARY 18, 2022

Location Id	Frequency of Detection	Percent Non-Detects	Range of Non-Detect	Mean	50th Percentile (Median)	95th Percentile	Maximum Detect	Variance	Standard Deviation	Coefficient of Variance	CCR MCL/RSL	Report Result Unit	Detection Exceedances (Y/N)	Number of Detection Exceedances	Outlier Detected	Outlier Removed	Trend	Distribution Group*	Inter-well Analysis								
																			November 2021 Concentrations	Detect?	Lower Confidence Limits	Upper Tolerance Limit	SSI	Background Limit (Higher of MCL/RSL or Upper Tolerance Limit)	² Exceedance above Background at Individual Well	SSI	
CCR Appendix-IV: Antimony, Total (mg/L)																											
CCR-BK-1	2/16	88%	0.002-0.002	0.00356	0.004	0.004	0.0009	6.992E-07	0.0011826	0.6638	0.006	mg/L	N	0	N	N	Stable	Non-parametric					0.002	0.006			
CCR-BK-2	1/16	94%	0.002-0.002	0.00382	0.004	0.004	0.00096	2.794E-07	0.0007476	0.3924	0.006	mg/L	N	0	N	N	Stable										
CCR-SP-1	0/15	100%	0.002-0.002	0.004	0.004	0.004		0	0	0	0.006	mg/L	N	0	N	N	NA						0.002	N			
CCR-SP-2	0/15	100%	0.002-0.002	0.004	0.004	0.004		0	0	0	0.006	mg/L	N	0	N	N	NA						0.002	N			
CCR-SP-3	0/15	100%	0.002-0.002	0.004	0.004	0.004		0	0	0	0.006	mg/L	N	0	N	N	NA						0.002	N			
CCR Appendix-IV: Arsenic, Total (mg/L)																											
CCR-BK-1	12/17	29%	0.001-0.001	0.001868	0.002	0.0037	0.005	5.684E-07	0.0010662	1.1414	0.01	mg/L	N	0	Y	N	Stable	Non-parametric					0.0035	0.010			
CCR-BK-2	8/17	53%	0.001-0.001	0.00246	0.002	0.00609	0.007	1.5908E-06	0.0017838	1.4544	0.01	mg/L	N	0	Y	N	Stable										
CCR-SP-1	17/17	0%	-	0.009	0.009	0.01742	0.026	0.000009896	0.004448	0.8982	0.01	mg/L	Y	2	Y	N	Stable						0.0033	Y			
CCR-SP-2	16/17	6%	0.001-0.001	0.00604	0.0028	0.0234	0.026	0.00002842	0.00754	2.492	0.01	mg/L	Y	4	N	N	Increase	Log-transformed					0.0130	Y	0.0010		
CCR-SP-3	17/17	0%	-	0.0312	0.024	0.0756	0.086	0.0002642	0.02298	1.4778	0.01	mg/L	Y	18	N	N	Decrease						0.0071	Y			
CCR Appendix-IV: Barium, Total (mg/L)																											
CCR-BK-1	17/17	0%	-	0.0794	0.074	0.1211	0.164	0.0002908	0.02412	0.6074	2	mg/L	N	0	Y	N	Stable	Non-parametric					0.150	2.0			
CCR-BK-2	17/17	0%	-	0.0898	0.074	0.1687	0.3	0.001485	0.0545	1.2142	2	mg/L	N	0	Y	N	Stable										
CCR-SP-1	17/17	0%	-	0.1608	0.166	0.214	0.24	0.0007678	0.03918	0.4876	2	mg/L	N	0	N	N	Decrease						0.044	Y			
CCR-SP-2	17/17	0%	-	0.214	0.24	0.28	0.28	0.00139	0.05272	0.4934	2	mg/L	N	0	N	N	Stable						0.066	Y			
CCR-SP-3	17/17	0%	-	0.1468	0.144	0.1797	0.22	0.0002312	0.0215	0.2932	2	mg/L	N	0	Y	N	Stable						0.068	Y			
CCR Appendix-IV: Beryllium, Total (mg/L)																											
CCR-BK-1	1/16	94%	0.001-0.001	0.00189	0.002	0.002	0.00024	9.368E-08	0.0004328	0.458	0.004	mg/L	N	0	N	N	NA	Non-parametric					0.001	0.004			
CCR-BK-2	2/16	88%	0.001-0.001	0.001822	0.002	0.002	0.0008	1.1696E-07	0.0004836	0.5308	0.004	mg/L	N	0	N	N	NA										
CCR-SP-1	0/15	100%	0.001-0.001	0.002	0.002	0.002	0.002		0	0	0	0.004	mg/L	N	0	N	N	NA						0.001	N		
CCR-SP-2	0/15	100%	0.001-0.001	0.002	0.002	0.002	0.002		0	0	0	0.004	mg/L	N	0	N	N	NA						0.001	N		
CCR-SP-3	1/15	93%	0.001-0.001	0.001906	0.002	0.002	0.00058	6.49E-08	0.0003602	0.3782	0.004	mg/L	N	0	N	N	NA						0.001	N			
CCR Appendix-IV: Cadmium, Total (mg/L)																											
CCR-BK-1	0/17	100%	0.001-0.001	0.002	0.002	0.002	0.002	0	0	0	0.005	mg/L	N	0	N	N	NA	Non-parametric					0.001	0.00			

TABLE I
SUMMARY OF ASSESSMENT MONITORING STATISTICAL EVALUATION - NOVEMBER 2021
A.B. BROWN GENERATING STATION - SEDIMENTATION POND
PREPARED: FEBRUARY 18, 2022

Location Id	Frequency of Detection	Percent Non-Detects	Range of Non-Detect	Mean	50th Percentile (Median)	95th Percentile	Maximum Detect	Variance	Standard Deviation	Coefficient of Variance	CCR MCL/RSL	Report Result Unit	Detection Exceedances (Y/N)	Number of Detection Exceedances	Outlier Detected	Outlier Removed	Trend	Distribution Group*	Inter-well Analysis						
																			November 2021 Concentrations	Detect?	Lower Confidence Limits	Upper Tolerance Limit	SSI	Background Limit (Higher of MCL/RSL or Upper Tolerance Limit)	Exceedance above Background at Individual Well
CCR Appendix-IV: Molybdenum, Total (mg/L)																									
CCR-BK-1	15/17	12%	0.005-0.005	0.00187	0.0014	0.005	0.0034	0.000001926	0.001388	0.7407	0.1	mg/L	N	0	N	N	Decrease	Non-parametric							
CCR-BK-2	8/17	53%	0.005-0.005	0.00319	0.005	0.005	0.0025	0.000004133	0.002033	0.6377	0.1	mg/L	N	0	N	N	Stable								
CCR-SP-1	16/17	6%	0.005-0.005	0.00159	0.0014	0.00268	0.0021	8.706E-07	0.0009331	0.5853	0.1	mg/L	N	0	Y	N	Decrease								
CCR-SP-2	15/17	12%	0.005-0.005	0.00177	0.0014	0.005	0.0016	0.000001495	0.001223	0.6905	0.1	mg/L	N	0	Y	N	Stable								
CCR-SP-3	16/17	6%	0.005-0.005	0.00415	0.0043	0.0058	0.0062	0.00000165	0.001285	0.3098	0.1	mg/L	N	0	N	N	Decrease								
CCR Appendix-IV: Radium-226 & 228 (pCi/L)																									
CCR-BK-1	11/17	35%	0.121-0.336	1.044	0.852	2.756	4.92	0.545	1.044	1.9994	5	pCi/L	N	0	Y	N	Stable	Non-parametric							
CCR-BK-2	4/17	76%	-0.0961-2.74	1.312	0.434	5.752	6.26	1.8244	1.9102	2.912	5	pCi/L	N	0	N	N	Stable								
CCR-SP-1	8/17	53%	0.0465-0.974	0.874	0.966	1.6398	1.474	0.1104	0.4698	1.0742	5	pCi/L	N	0	N	N	Stable								
CCR-SP-2	11/17	35%	0.241-0.846	1.254	1.156	2.244	2.84	0.18716	0.6118	0.9764	5	pCi/L	N	0	Y	N	Stable								
CCR-SP-3	4/17	76%	0.131-1.07	0.794	0.67	1.919	1.09	0.1334	0.5166	1.3002	5	pCi/L	N	0	N	N	Stable								
CCR Appendix-IV: Selenium, Total (mg/L)																									
CCR-BK-1	3/17	82%	0.005-0.005	0.00842	0.01	0.01	0.00134	0.000006024	0.003472	0.8248	0.05	mg/L	N	0	N	N	NA	Non-parametric							
CCR-BK-2	2/17	88%	0.005-0.005	0.009	0.01	0.01	0.00196	0.000003924	0.002802	0.623	0.05	mg/L	N	0	Y	N	NA								
CCR-SP-1	1/15	93%	0.005-0.005	0.00938	0.01	0.01	0.00072	0.000002772	0.002354	0.502	0.05	mg/L	N	0	N	N	NA								
CCR-SP-2	1/15	93%	0.005-0.005	0.00942	0.01	0.01	0.00126	0.000002458	0.002218	0.471	0.05	mg/L	N	0	N	N	NA								
CCR-SP-3	1/15	93%	0.005-0.005	0.00938	0.01	0.01	0.00084	0.0000027	0.002324	0.495	0.05	mg/L	N	0	N	N	NA								
CCR Appendix-IV: Thallium, Total (mg/L)																									
CCR-BK-1	2/16	88%	0.001-0.001	0.001788	0.002	0.002	0.00054	1.6508E-07	0.0005746	0.6426	0.002	mg/L	N	0	N	N	NA	Non-parametric							
CCR-BK-2	3/16	81%	0.001-0.001	0.001678	0.002	0.002	0.00038	2.324E-07	0.0006818	0.8122	0.002	mg/L	N	0	N	N	NA								
CCR-SP-1	2/15	87%	0.001-0.001	0.00175	0.002	0.002	0.000186	2.118E-07	0.0006508	0.7442	0.002	mg/L	N	0	N	N	NA								
CCR-SP-2	2/15	87%	0.001-0.001	0.001798	0.002	0.002	0.00086	1.4828E-07	0.0005446	0.606	0.002	mg/L	N	0	N	N	NA								
CCR-SP-3	3/15	80%	0.001-0.001	0.001652	0.002	0.002	0.00044	2.544E-07	0.0007132	0.864	0.002	mg/L	N	0	N	N	NA								

Notes:

1 - Groundwater protection standards compared against lower confidence level to determine statistically significant levels.

CCR = Coal combustion residual

GWP5 = Groundwater Protection Standards

mg/L = milligrams per liter

MCL = Maximum containment level

N/A = Not available

NT = Not tested

pCi/L = Pico curies per liter of air

RSL = Regional screening level

SSI = Statistically significant increase

SSL = Statistically significant level



HALEY & ALDRICH, INC.
6500 Rockside Road
Suite 200
Cleveland, OH 44131
216.739.0555

TECHNICAL MEMORANDUM

14 September 2022

File No. 129420

TO: Southern Indiana Gas and Electric Company

FROM: Haley & Aldrich, Inc.
Todd Plating, Senior Project Manager
Steven F. Putrich, P.E., Project Principal

SUBJECT: Statistical Evaluation of the May 2022 Semi-annual Groundwater Assessment
Monitoring Data
Southern Indiana Gas and Electric Company
Sedimentation Pond
A.B. Brown Generating Station; Posey County, Indiana

Pursuant to Title 40 Code of Federal Regulations (40 CFR) § 257.93 and § 257.95 (Rule), this memorandum summarizes the statistical evaluation of the analytical results for the May 2022 semi-annual assessment monitoring event for the A.B. Brown Generating Station Sedimentation Pond. Haley & Aldrich, Inc. (Haley & Aldrich) completed this statistical evaluation to determine if Appendix IV groundwater monitoring constituents have been detected in downgradient wells at statistically significant levels (SSL) greater than Groundwater Protection Standards (GWPS), consistent with the requirements in 40 CFR § 257.95.

Methods used during this statistical analysis are described in the *Statistical Data Analysis Plan for the A.B. Brown Generating Station Sediment Pond* (Haley & Aldrich, 2017). A summary of how applicable performance standards described in § 257.93 (g) were achieved include:

- § 257.93 (g) (1) – Data set distribution was evaluated using basic summary statistics, graphical methods, and the Shapiro-Wilks Test of Normality. Parametric methods were used where normal distributions were identified. Those data sets were evaluated for outliers using box plots, Dixon's test and Rosner's test. Outlier identification and data set distribution groups are summarized in Table I.
- § 257.93 (g) (2) – Not applicable
- § 257.93 (g) (3) – Not applicable
- § 257.93 (g) (4) – Levels of confidence and additional supporting information for the use of tolerance intervals and prediction limits are included in Table I.

- § 257.93 (g) (5) – Non-detect values were accounted for by simple substitution, where the detection limit replaced the non-detect result. Non-detect values are identified and summarized in Table I.
- § 257.93 (g) (6) – Time series plots for groundwater monitoring wells included in this evaluation were reviewed to identify potential seasonal variability. No additional statistics to account for seasonality or spatial variability were necessary.

Data from the groundwater sampling event for the downgradient monitoring wells (CCR-SP-1 through CCR-SP-3) were compared to the GWPS established from the background dataset for the upgradient monitoring wells (CCR-BK-1 and CCR-BK-2) for detected Appendix IV constituents. GWPS for each of the Appendix IV constituents have been set equal to the highest value of the maximum contaminant level, regional screening level, or background concentration. The results of the assessment monitoring statistical evaluation are discussed below and provided in Table I.

Development of GWPS

The Rule provides four specific options for statistical evaluation of groundwater quality data collected at a coal combustion residual (CCR) unit (40 CFR §257.93(f) (1-4)). Haley & Aldrich certified the tolerance limit (TL) as the statistical method used for developing background concentration for the GWPS on 14 January 2019. As noted above, the GWPS for each of the Appendix IV constituents have been set equal to the highest value of the maximum contaminant level (MCL), regional screening level (RSL), or background concentration. The most recent groundwater sampling result from each compliance well was compared to the GWPS to determine if additional statistical testing is warranted.

STATISTICAL EVALUATION

An interwell statistical evaluation was used to identify SSLs. An interwell evaluation compares the most recent values from downgradient compliance wells to a background dataset composed of upgradient well data. Because the CCR unit is in assessment monitoring, no statistical evaluations were conducted on Appendix III (detection monitoring) constituents.

The parametric TL method was used to complete statistical evaluations of the referenced dataset. The TL procedure is one in which a concentration limit for each constituent is established from the distribution of the background data, with a minimum 95 percent confidence level. The upper endpoint of a tolerance interval is called the UTL. Depending on the data distribution, parametric or non-parametric TL procedures are used to evaluate groundwater monitoring data using this method. Parametric TLs utilize normally distributed data or data normalized via a transformation of the sample background data used to construct the limit. If the data are non-normal and a transformation is not indicated, non-parametric procedures (order statistics or bootstrap methods) are used to calculate the TL. If all the background data are non-detect, a maximum reporting limit may serve as an appropriate UTL.

These statistical evaluations were conducted using the background dataset for detected Appendix IV constituents using parametric TL. If an Appendix IV constituent concentration from the May 2022

sampling event was greater than the GWPS, the lower confidence limit (LCL) for the downgradient well constituent was used to evaluate if an SSL was indicated. The LCL is the lower end of the confidence interval range, which is an estimated concentration range intended to contain the true mean or median of the population from which the sample is drawn. The confidence interval range is designed to locate the true population mean or median with a high degree of statistical confidence, or conversely, with a low probability of error.

The UTLs were calculated from the background well dataset using Chemstat software after testing for outlier sample results that would warrant removal from the dataset based on likely error in sampling or measurement. Both visual and statistical outlier tests for the background data were performed using Chemstat and U.S. Environmental Protection Agency's ProUCL 5.1 software, and a visual inspection of the data was performed using box plots and distribution plots for the downgradient sample data. No sample data were identified as outliers that warranted removal from the dataset.

BACKGROUND DISTRIBUTIONS

The groundwater analytical results for each sampling event from the background sample locations were combined to calculate the UTL for each detected Appendix IV constituent. The variability and distribution of the pooled dataset was evaluated to determine the method for UTL calculation. The background concentrations were periodically updated per the document *Statistical Analysis of Groundwater Monitoring Data at RCRA Facilities, Unified Guidance, March 2009* (Unified Guidance).

TREND SUMMARY

Mann Kendall trend analyses were performed on data sets of sufficient sample size. Results of the trend analysis are included on Table I. In summary, 95 percent of trends analyzed are identified as stable or decreasing.

RESULTS OF APPENDIX IV DOWNGRADIENT STATISTICAL COMPARISONS

The sample concentrations from the downgradient wells for each of the detected Appendix IV constituents from the May 2022 assessment monitoring event were compared to their respective GWPS (Table I). A sample concentration greater than the GWPS is considered to represent an SSL. Based on previous compliance sampling events and statistical evaluations, interwell comparisons were utilized for downgradient wells and constituents. Based on this statistical evaluation an SSL greater than the GWPS was not identified at the Sedimentation Pond. As a result, the Sedimentation Pond will remain in Assessment Monitoring.

Tables:

Table I – Summary of Assessment Monitoring Statistical Evaluation – May 2022

\haleyaldrich.com\share\grn_common\129420 Vectren\Deliverables\AB_Brown\Statistical Analysis\2022\May 2022 Results\2022_0913 ABB Sedimentation Pond May 2022 Statistical Evaluation Summary_F.docx

TABLE

TABLE I
A.B. BROWN GENERATING STATION
SEDIMENTATION POND
SUMMARY OF ASSESSMENT MONITORING STATISTICAL EVALUATION - MAY 2022

TABLE I
A.B. BROWN GENERATING STATION
SEDIMENTATION POND
SUMMARY OF ASSESSMENT MONITORING STATISTICAL EVALUATION - MAY 2022

Location Id	Frequency of Detection	Percent Non-Detects	Range of Non-Detect	Mean	50th Percentile (Median)	95th Percentile	Maximum Detect	Variance	Standard Deviation	Coefficient of Variance	CCR MCL/RSL	Report Result Unit	Detection Exceedances (Y/N)	Number of Detection Exceedances	Outlier Detected	Outlier Removed	Trend	Distribution Group*	Inter-well Analysis								
																			May 2022 Concentrations	Detect?	Lower Confidence Limits	Upper Tolerance Limit	Upper Tolerance Limit	SSI	Background Limit (Higher of MCL/RSL or Upper Tolerance)	Exceedance above Background at Individual Well	SSL
CCR Appendix-IV: Mercury, Total (mg/L)																											
CCR-BK-1	0/17	100%	0.0002-0.0002	0.0004	0.0004	0.0004		1.2834E-22	1.6022E-11	8.01E-08	0.002	mg/L	N	0	N	N	NA	Non-parametric						0.0002	0.2	0.002	
CCR-BK-2	2/17	88%	0.0002-0.0002	0.000388	0.0004	0.0004	0.0004	1.1408E-09	0.00004776	0.246	0.002	mg/L	N	0	N	N	NA										
CCR-SP-1	0/16	100%	0.0002-0.0002	0.0004	0.0004	0.0004		1.2296E-22	1.5682E-11	7.84E-08	0.002	mg/L	N	0	Y	N	NA										
CCR-SP-2	0/16	100%	0.0002-0.0002	0.0004	0.0004	0.0004		1.2296E-22	1.5682E-11	7.84E-08	0.002	mg/L	N	0	Y	N	NA							0.0002	N	N	FALSE
CCR-SP-3	0/16	100%	0.0002-0.0002	0.0004	0.0004	0.0004		1.2296E-22	1.5682E-11	7.84E-08	0.002	mg/L	N	0	N	N	NA										
CCR Appendix-IV: Molybdenum, Total (mg/L)																											
CCR-BK-1	16/18	11%	0.005-0.005	0.00181	0.00135	0.005	0.0034	0.000001884	0.001372	0.758	0.1	mg/L	N	0	N	N	Decrease	Non-parametric						0.005	5	0.100	
CCR-BK-2	9/18	50%	0.005-0.005	0.00305	0.00375	0.005	0.0025	0.00004254	0.002062	0.6771	0.1	mg/L	N	0	N	N	Stable										
CCR-SP-1	17/18	6%	0.005-0.005	0.00156	0.00135	0.002535	0.0021	8.446E-07	0.000919	0.5904	0.1	mg/L	N	0	Y	N	Decrease										
CCR-SP-2	16/18	11%	0.005-0.005	0.00177	0.0014	0.005	0.0017	0.000001407	0.001186	0.6714	0.1	mg/L	N	0	Y	N	Stable							0.0017	Y	N	FALSE
CCR-SP-3	17/18	6%	0.005-0.005	0.00415	0.00425	0.005775	0.0062	0.000001553	0.001246	0.3003	0.1	mg/L	N	0	N	N	Decrease										
CCR Appendix-IV: Radium-226 & 228 (pCi/L)																											
CCR-BK-1	11/17	35%	0.121-0.336	2.088	1.766	4.844	9.84	1.028	2.028	3.862	5	pCi/L	N	0	Y	N	Stable	Non-parametric						3.1	3.13	5.0	
CCR-BK-2	4/17	76%	-0.0961-2.74	2.624	1.06	14.392	12.52	7.512	5.484	6.108	5	pCi/L	N	0	N	N	Stable										
CCR-SP-1	9/18	50%	0.0465-0.974	0.902	0.987	1.5924	1.474	0.11022	0.4696	1.0418	5	pCi/L	N	0	N	N	Stable										
CCR-SP-2	11/18	39%	0.241-5	1.74	1.157	4.63	2.84	2.24	2.118	2.434	5	pCi/L	N	0	Y	N	Stable							5.000	N	N	FALSE
CCR-SP-3	5/18	72%	0.131-1.07	0.806	0.673	1.885	1.09	0.12712	0.5042	1.2498	5	pCi/L	N	0	N	N	Stable										
CCR Appendix-IV: Selenium, Total (mg/L)																											
CCR-BK-1	3/18	83%	0.005-0.005	0.0085	0.01	0.01	0.00134	0.000005748	0.00339	0.7972	0.05	mg/L	N	0	N	N	NA	Non-parametric						0.005	5	0.050	
CCR-BK-2	2/18	89%	0.005-0.005	0.00904	0.01	0.01	0.00196	0.000003728	0.00273	0.6034	0.05	mg/L	N	0	Y	N	NA										
CCR-SP-1	1/16	94%	0.005-0.005	0.00942	0.01	0.01	0.00072	0.000002604	0.002282	0.4846	0.05	mg/L	N	0	N	N	NA										
CCR-SP-2	1/16	94%	0.005-0.005	0.00946	0.01	0.01	0.00126	0.00000231	0.00215	0.4548	0.05	mg/L	N	0	N	N	NA							0.005	N	N	FALSE
CCR-SP-3	1/16	94%	0.005-0.005	0.00942	0.																						

APPENDIX B
Field Forms

Low-Flow Test Report:

Test Date / Time: 5/19/2022 10:39:10 AM

Project: AB BROWN (24)

Operator Name: Jon Hill

Location Name: FD-PZ-1 Well Diameter: 1 in Casing Type: PVC Screen Length: 10 ft Top of Screen: 10 ft Total Depth: 20 ft Initial Depth to Water: 7.17 ft	Pump Type: Peristaltic Tubing Type: LDPE Pump Intake From TOC: 19 ft Estimated Total Volume Pumped: 0 ml Flow Cell Volume: 130 ml Final Flow Rate: 200 ml/min Final Draw Down: 0 ft	Instrument Used: Aqua TROLL 600 Serial Number: 707269
---	---	--

Test Notes:

Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth to Water	Flow
		+/- 0.1	+/- 0.5	+/- 3 %	+/- 10 %	+/- 10	+/- 10	+/- 5	
5/19/2022 10:39 AM	00:00	7.59 pH	21.33 °C	7,463.7 µS/cm	2.78 mg/L	1,314.4 NTU	93.6 mV	218.54 cm	200.00 ml/min

Samples

Sample ID:	Description:

Low-Flow Test Report:

Test Date / Time: 5/19/2022 11:07:27 AM

Project: AB BROWN (25)

Operator Name: Jon Hill

Location Name: FD-PZ-2 Well Diameter: 2 in Casing Type: PVC Screen Length: 10 ft Top of Screen: 10 ft Total Depth: 20 ft Initial Depth to Water: 2.8 ft	Pump Type: Peristaltic Tubing Type: LDPE Pump Intake From TOC: 19 ft Estimated Total Volume Pumped: 0 ml Flow Cell Volume: 130 ml Final Flow Rate: 200 ml/min Final Draw Down: 0 ft	Instrument Used: Aqua TROLL 600 Serial Number: 707269
--	---	--

Test Notes:

Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth to Water	Flow
		+/- 0.1	+/- 0.5	+/- 3 %	+/- 10 %	+/- 10	+/- 10	+/- 5	
5/19/2022 11:07 AM	00:00	7.07 pH	21.18 °C	943.50 µS/cm	1.66 mg/L	104.16 NTU	117.5 mV	85.34 cm	200.00 ml/min

Samples

Sample ID:	Description:

Low-Flow Test Report:

Test Date / Time: 5/19/2022 9:58:26 AM

Project: AB BROWN (23)

Operator Name: Jon Hill

Location Name: MH-1 Initial Depth to Water: 9.18 ft	Pump Type: Peristaltic Tubing Type: LDPE Pump Intake From TOC: 10 ft Estimated Total Volume Pumped: 0 ml Flow Cell Volume: 130 ml Final Flow Rate: 200 ml/min Final Draw Down: 0 ft	Instrument Used: Aqua TROLL 600 Serial Number: 707269
--	--	--

Test Notes:

Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth to Water	Flow
		+/- 0.1	+/- 0.5	+/- 3 %	+/- 10 %	+/- 10	+/- 10	+/- 5	
5/19/2022 9:58 AM	00:00	8.77 pH	18.01 °C	7,801.7 µS/cm	0.24 mg/L	0.71 NTU	33.3 mV	279.81 cm	200.00 ml/min

Samples

Sample ID:	Description:

Low-Flow Test Report:

Test Date / Time: 5/19/2022 9:28:42 AM

Project: AB BROWN (22)

Operator Name: Jon Hill

Location Name: MH-2 Initial Depth to Water: 9.97 ft	Pump Type: Sample Pro Tubing Type: LDPE Pump Intake From TOC: 11 ft Estimated Total Volume Pumped: 0 ml Flow Cell Volume: 130 ml Final Flow Rate: 200 ml/min Final Draw Down: 0 ft	Instrument Used: Aqua TROLL 600 Serial Number: 707269
--	---	--

Test Notes:

Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth to Water	Flow
		+/- 0.1	+/- 0.5	+/- 3 %	+/- 10 %	+/- 10	+/- 10	+/- 5	
5/19/2022 9:28 AM	00:00	12.57 pH	21.32 °C	23,849 µS/cm	8.18 mg/L	692.81 NTU	-110.3 mV	303.89 cm	200.00 ml/min

Samples

Sample ID:	Description:

Low-Flow Test Report:

Test Date / Time: 5/17/2022 8:52:26 AM

Project: AB BROWN

Operator Name: Jon Hill

Location Name: CCR-AP-1R Well Diameter: 2 in Casing Type: PVC Screen Length: 10 ft Top of Screen: 27 ft Total Depth: 37 ft Initial Depth to Water: 16.08 ft	Pump Type: Dedicated Tubing Type: LDPE Pump Intake From TOC: 32 ft Estimated Total Volume Pumped: 3600 ml Flow Cell Volume: 130 ml Final Flow Rate: 200 ml/min Final Draw Down: 0.24 ft	Instrument Used: Aqua TROLL 600 Serial Number: 745383
---	--	--

Test Notes:

1.0 gallons purged

Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth to Water	Flow
		+/- 0.1	+/- 0.5	+/- 3 %	+/- 10 %	+/- 10	+/- 10	+/- 5	
5/17/2022 8:52 AM	00:00	6.88 pH	15.22 °C	1,300.8 µS/cm	0.94 mg/L	3.52 NTU	217.5 mV	16.08 ft	200.00 ml/min
5/17/2022 8:55 AM	03:00	6.84 pH	14.84 °C	1,260.3 µS/cm	0.25 mg/L	0.65 NTU	215.4 mV	16.12 ft	200.00 ml/min
5/17/2022 8:58 AM	06:00	6.81 pH	14.95 °C	1,256.4 µS/cm	0.17 mg/L	1.03 NTU	215.0 mV	16.17 ft	200.00 ml/min
5/17/2022 9:01 AM	09:00	6.79 pH	14.90 °C	1,260.1 µS/cm	0.15 mg/L	0.57 NTU	215.0 mV	16.22 ft	200.00 ml/min
5/17/2022 9:04 AM	12:00	6.77 pH	15.00 °C	1,261.9 µS/cm	0.15 mg/L	0.62 NTU	214.8 mV	16.27 ft	200.00 ml/min
5/17/2022 9:07 AM	15:00	6.76 pH	15.01 °C	1,265.8 µS/cm	0.15 mg/L	0.40 NTU	214.6 mV	16.30 ft	200.00 ml/min
5/17/2022 9:10 AM	18:00	6.75 pH	15.33 °C	1,256.7 µS/cm	0.32 mg/L	1.83 NTU	214.1 mV	16.32 ft	200.00 ml/min

Samples

Sample ID:	Description:
------------	--------------

Low-Flow Test Report:

Test Date / Time: 5/18/2022 8:55:51 AM

Project: AB BROWN (12)

Operator Name: Jon Hill

Location Name: CCR-AP-2R Well Diameter: 2 in Casing Type: PVC Screen Length: 10 ft Top of Screen: 43.3 ft Total Depth: 53.3 ft Initial Depth to Water: 42.47 ft	Pump Type: Dedicated Tubing Type: LDPE Pump Intake From TOC: 48 ft Estimated Total Volume Pumped: 9600 ml Flow Cell Volume: 130 ml Final Flow Rate: 200 ml/min Final Draw Down: 0.18 ft	Instrument Used: Aqua TROLL 600 Serial Number: 745383
--	--	--

Test Notes:

2.5 gal.ons purgec

Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth to Water	Flow
		+/- 0.1	+/- 0.5	+/- 3 %	+/- 10 %	+/- 10	+/- 10	+/- 5	
5/18/2022 8:55 AM	00:00	6.40 pH	17.56 °C	2,560.3 µS/cm	0.63 mg/L		144.3 mV	42.47 ft	200.00 ml/min
5/18/2022 8:58 AM	03:00	6.44 pH	17.57 °C	2,334.5 µS/cm	0.35 mg/L		133.5 mV	42.50 ft	200.00 ml/min
5/18/2022 9:01 AM	06:00	6.45 pH	17.58 °C	2,306.2 µS/cm	0.28 mg/L		131.2 mV	42.50 ft	200.00 ml/min
5/18/2022 9:04 AM	09:00	6.46 pH	17.53 °C	2,296.1 µS/cm	0.24 mg/L		129.8 mV	42.51 ft	200.00 ml/min
5/18/2022 9:07 AM	12:00	6.48 pH	17.49 °C	2,291.4 µS/cm	0.23 mg/L		129.4 mV	42.52 ft	200.00 ml/min
5/18/2022 9:10 AM	15:00	6.49 pH	17.46 °C	2,302.3 µS/cm	0.21 mg/L		129.8 mV	42.52 ft	200.00 ml/min
5/18/2022 9:13 AM	18:00	6.48 pH	17.46 °C	2,822.1 µS/cm	0.20 mg/L		148.4 mV	42.53 ft	200.00 ml/min
5/18/2022 9:16 AM	21:00	6.51 pH	17.45 °C	3,624.7 µS/cm	0.19 mg/L		164.8 mV	42.51 ft	200.00 ml/min
5/18/2022 9:19 AM	24:00	6.53 pH	17.44 °C	4,240.3 µS/cm	0.18 mg/L		171.0 mV	42.50 ft	200.00 ml/min
5/18/2022 9:22 AM	27:00	6.54 pH	17.44 °C	4,532.5 µS/cm	0.18 mg/L		174.4 mV	42.54 ft	200.00 ml/min
5/18/2022 9:25 AM	30:00	6.55 pH	17.44 °C	4,786.7 µS/cm	0.19 mg/L		176.5 mV	42.55 ft	200.00 ml/min
5/18/2022 9:28 AM	33:00	6.56 pH	17.45 °C	4,956.0 µS/cm	0.20 mg/L		178.0 mV	42.57 ft	200.00 ml/min
5/18/2022 9:31 AM	36:00	6.57 pH	17.43 °C	5,134.9 µS/cm	0.22 mg/L		179.3 mV	42.60 ft	200.00 ml/min
5/18/2022 9:34 AM	39:00	6.58 pH	17.43 °C	5,242.5 µS/cm	0.24 mg/L		180.4 mV	42.61 ft	200.00 ml/min
5/18/2022 9:37 AM	42:00	6.59 pH	17.42 °C	5,350.1 µS/cm	0.27 mg/L		181.2 mV	42.61 ft	200.00 ml/min

5/18/2022 9:40 AM	45:00	6.60 pH	17.44 °C	5,438.5 µS/cm	0.30 mg/L		182.0 mV	42.64 ft	200.00 ml/min
5/18/2022 9:43 AM	48:00	6.61 pH	17.44 °C	5,530.9 µS/cm	0.32 mg/L		182.7 mV	42.65 ft	200.00 ml/min

Samples

Sample ID:	Description:

Created using VuSitu from In-Situ, Inc.

Low-Flow Test Report:

Test Date / Time: 5/18/2022 10:05:20 AM

Project: AB BROWN (13)

Operator Name: Jon Hill

Location Name: CCR-AP-21 Well Diameter: 2 cm Casing Type: PVC Screen Length: 10 ft Top of Screen: 83 ft Total Depth: 93 ft Initial Depth to Water: 31.22 ft	Pump Type: Dedicated Tubing Type: LDPE Pump Intake From TOC: 91 ft Estimated Total Volume Pumped: 4800 ml Flow Cell Volume: 130 ml Final Flow Rate: 200 ml/min Final Draw Down: 0.29 ft	Instrument Used: Aqua TROLL 600 Serial Number: 745383
--	---	--

Test Notes:

0.75 gallons purged

Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth to Water	Flow
		+/- 0.1	+/- 0.5	+/- 3 %	+/- 10 %	+/- 10	+/- 10	+/- 5	
5/18/2022 10:05 AM	00:00	7.46 pH	17.12 °C	1,254.1 µS/cm	1.53 mg/L		140.9 mV	31.22 ft	200.00 ml/min
5/18/2022 10:08 AM	03:00	7.52 pH	17.13 °C	1,231.9 µS/cm	0.95 mg/L		134.0 mV	31.27 ft	200.00 ml/min
5/18/2022 10:11 AM	06:00	7.47 pH	17.15 °C	1,221.6 µS/cm	0.73 mg/L		123.6 mV	31.34 ft	200.00 ml/min
5/18/2022 10:14 AM	09:00	7.45 pH	17.12 °C	1,220.8 µS/cm	0.60 mg/L		115.1 mV	31.37 ft	200.00 ml/min
5/18/2022 10:17 AM	12:00	7.43 pH	17.12 °C	1,218.4 µS/cm	0.51 mg/L		107.3 mV	31.40 ft	200.00 ml/min
5/18/2022 10:20 AM	15:00	7.41 pH	17.13 °C	1,220.1 µS/cm	0.47 mg/L		100.8 mV	31.43 ft	200.00 ml/min
5/18/2022 10:23 AM	18:00	7.39 pH	17.12 °C	1,220.5 µS/cm	0.42 mg/L		94.8 mV	31.46 ft	200.00 ml/min
5/18/2022 10:26 AM	21:00	7.37 pH	17.12 °C	1,220.9 µS/cm	0.42 mg/L		89.5 mV	31.49 ft	200.00 ml/min
5/18/2022 10:29 AM	24:00	7.36 pH	17.14 °C	1,220.8 µS/cm	0.41 mg/L		84.5 mV	31.51 ft	200.00 ml/min

Samples

Sample ID:	Description:

Low-Flow Test Report:

Test Date / Time: 5/17/2022 1:35:57 PM

Project: AB BROWN (6)

Operator Name: Jon Hill

Location Name: CCR-AP-3R Well Diameter: 2 in Casing Type: PVC Screen Length: 10 ft Top of Screen: 37 ft Total Depth: 47 ft Initial Depth to Water: 25 ft	Pump Type: Dedicated Tubing Type: LDPE Pump Intake From TOC: 38 ft Estimated Total Volume Pumped: 4200 ml Flow Cell Volume: 130 ml Final Flow Rate: 200 ml/min Final Draw Down: 0.03 ft	Instrument Used: Aqua TROLL 600 Serial Number: 745383
---	---	--

Test Notes:

1.5 gallons purged

Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth to Water	Flow
		+/- 0.1	+/- 0.5	+/- 3 %	+/- 10 %	+/- 10	+/- 10	+/- 5	
5/17/2022 1:35 PM	00:00	6.74 pH	18.95 °C	8,343.9 µS/cm	0.72 mg/L	111.14 NTU	145.4 mV	25.00 ft	200.00 ml/min
5/17/2022 1:38 PM	03:00	6.85 pH	18.38 °C	8,442.3 µS/cm	0.50 mg/L	67.50 NTU	142.6 mV	25.01 ft	200.00 ml/min
5/17/2022 1:41 PM	06:00	6.90 pH	18.24 °C	8,410.3 µS/cm	0.43 mg/L	88.32 NTU	140.6 mV	25.04 ft	200.00 ml/min
5/17/2022 1:44 PM	09:00	6.93 pH	18.31 °C	8,407.5 µS/cm	0.41 mg/L	104.55 NTU	139.5 mV	25.05 ft	200.00 ml/min
5/17/2022 1:47 PM	12:00	6.95 pH	18.25 °C	8,392.3 µS/cm	0.39 mg/L	131.46 NTU	138.8 mV	25.05 ft	200.00 ml/min
5/17/2022 1:50 PM	15:00	6.96 pH	18.13 °C	8,395.8 µS/cm	0.39 mg/L	145.65 NTU	138.5 mV	25.05 ft	200.00 ml/min
5/17/2022 1:53 PM	18:00	6.97 pH	18.17 °C	8,395.0 µS/cm	0.36 mg/L	181.24 NTU	138.3 mV	25.04 ft	200.00 ml/min
5/17/2022 1:56 PM	21:00	6.98 pH	18.16 °C	8,396.8 µS/cm	0.36 mg/L	196.75 NTU	138.3 mV	25.03 ft	200.00 ml/min

Samples

Sample ID:	Description:
------------	--------------

Low-Flow Test Report:

Test Date / Time: 5/18/2022 8:18:24 AM

Project: AB BROWN (11)

Operator Name: Jon Hill

Location Name: CCR-AP-3I Well Diameter: 2 in Casing Type: PVC Screen Length: 10 ft Top of Screen: 67.5 ft Total Depth: 77.5 ft Initial Depth to Water: 30.3 ft	Pump Type: Dedicated Tubing Type: LDPE Pump Intake From TOC: 73 ft Estimated Total Volume Pumped: 1200 ml Flow Cell Volume: 130 ml Final Flow Rate: 200 ml/min Final Draw Down: 4.5 ft	Instrument Used: Aqua TROLL 600 Serial Number: 745383
---	--	--

Test Notes:

Pumped well dry on 5.17. Sampled well on 5.18

Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth to Water	Flow
		+/- 0.1	+/- 0.5	+/- 3 %	+/- 10 %	+/- 10	+/- 10	+/- 5	
5/18/2022 8:18 AM	00:00	7.63 pH	16.35 °C	1,203.5 µS/cm	2.19 mg/L		165.2 mV	30.30 ft	200.00 ml/min
5/18/2022 8:21 AM	03:00	7.67 pH	16.42 °C	1,360.9 µS/cm	0.21 mg/L		158.4 mV	32.77 ft	200.00 ml/min
5/18/2022 8:24 AM	06:00	7.64 pH	16.62 °C	1,362.3 µS/cm	0.14 mg/L		149.3 mV	34.80 ft	200.00 ml/min

Samples

Sample ID:	Description:

Low-Flow Test Report:

Test Date / Time: 5/17/2022 9:34:50 AM

Project: AB BROWN (2)

Operator Name: Jon Hill

Location Name: CCR-AP-4R Well Diameter: 2 in Casing Type: PVC Screen Length: 10 ft Top of Screen: 38 ft Total Depth: 48 ft Initial Depth to Water: 33.03 ft	Pump Type: Dedicated Tubing Type: LDPE Pump Intake From TOC: 43 ft Estimated Total Volume Pumped: 6000 ml Flow Cell Volume: 130 ml Final Flow Rate: 200 ml/min Final Draw Down: 0.19 ft	Instrument Used: Aqua TROLL 600 Serial Number: 745383
--	---	--

Test Notes:

2.0 gallons purged

Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth to Water	Flow
		+/- 0.1	+/- 0.5	+/- 3 %	+/- 10 %	+/- 10	+/- 10	+/- 5	
5/17/2022 9:34 AM	00:00	6.67 pH	14.63 °C	1,401.5 µS/cm	7.21 mg/L	128.94 NTU	190.1 mV	33.03 ft	200.00 ml/min
5/17/2022 9:37 AM	03:00	6.65 pH	14.31 °C	1,443.4 µS/cm	6.72 mg/L	192.96 NTU	186.2 mV	33.07 ft	200.00 ml/min
5/17/2022 9:40 AM	06:00	6.67 pH	14.32 °C	1,470.2 µS/cm	6.72 mg/L	127.41 NTU	183.7 mV	33.10 ft	200.00 ml/min
5/17/2022 9:43 AM	09:00	6.69 pH	14.31 °C	1,376.6 µS/cm	6.75 mg/L	103.58 NTU	182.0 mV	33.14 ft	200.00 ml/min
5/17/2022 9:46 AM	12:00	6.70 pH	14.37 °C	1,360.0 µS/cm	6.78 mg/L	53.21 NTU	180.6 mV	33.16 ft	200.00 ml/min
5/17/2022 9:49 AM	15:00	6.71 pH	14.32 °C	1,358.2 µS/cm	6.82 mg/L	46.45 NTU	179.7 mV	33.18 ft	200.00 ml/min
5/17/2022 9:52 AM	18:00	6.72 pH	14.41 °C	1,322.6 µS/cm	6.85 mg/L	34.83 NTU	179.0 mV	33.20 ft	200.00 ml/min
5/17/2022 9:55 AM	21:00	6.72 pH	14.36 °C	1,339.3 µS/cm	6.91 mg/L	29.03 NTU	178.5 mV	33.20 ft	200.00 ml/min
5/17/2022 9:58 AM	24:00	6.73 pH	14.42 °C	1,298.2 µS/cm	6.92 mg/L	19.06 NTU	178.2 mV	33.21 ft	200.00 ml/min
5/17/2022 10:01 AM	27:00	6.73 pH	14.41 °C	1,310.0 µS/cm	6.96 mg/L	13.08 NTU	178.0 mV	33.22 ft	200.00 ml/min
5/17/2022 10:04 AM	30:00	6.73 pH	14.42 °C	1,311.3 µS/cm	6.92 mg/L	14.53 NTU	178.1 mV	33.22 ft	200.00 ml/min

Samples

Sample ID: DUP-1, FB-1	Description:
------------------------	--------------

Low-Flow Test Report:

Test Date / Time: 5/18/2022 7:35:02 AM

Project: AB BROWN (10)

Operator Name: Jon Hill

Location Name: CCR-AP-5R Well Diameter: 2 in Casing Type: PVC Screen Length: 10 ft Top of Screen: 35 ft Total Depth: 45 ft Initial Depth to Water: 35.8 ft	Pump Type: Dedicated Tubing Type: LDPE Pump Intake From TOC: 40 ft Estimated Total Volume Pumped: 3600 ml Flow Cell Volume: 130 ml Final Flow Rate: 200 ml/min Final Draw Down: 0.15 ft	Instrument Used: Aqua TROLL 600 Serial Number: 745383
---	---	--

Test Notes:

1.0 gallons purged

Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth to Water	Flow
		+/- 0.1	+/- 0.5	+/- 3 %	+/- 10 %	+/- 10	+/- 10	+/- 5	
5/18/2022 7:35 AM	00:00	6.67 pH	16.62 °C	7,359.1 µS/cm	1.34 mg/L		197.3 mV	35.80 ft	200.00 ml/min
5/18/2022 7:38 AM	03:00	6.75 pH	16.56 °C	7,371.1 µS/cm	0.65 mg/L		196.8 mV	35.82 ft	200.00 ml/min
5/18/2022 7:41 AM	06:00	6.77 pH	16.51 °C	7,367.3 µS/cm	0.47 mg/L		196.7 mV	35.85 ft	200.00 ml/min
5/18/2022 7:44 AM	09:00	6.78 pH	16.54 °C	7,356.5 µS/cm	0.39 mg/L		195.1 mV	35.89 ft	200.00 ml/min
5/18/2022 7:47 AM	12:00	6.78 pH	16.53 °C	7,359.7 µS/cm	0.34 mg/L		192.9 mV	35.92 ft	200.00 ml/min
5/18/2022 7:50 AM	15:00	6.79 pH	16.52 °C	7,352.4 µS/cm	0.31 mg/L		192.0 mV	35.94 ft	200.00 ml/min
5/18/2022 7:53 AM	18:00	6.79 pH	16.53 °C	7,356.7 µS/cm	0.31 mg/L		192.0 mV	35.95 ft	200.00 ml/min

Samples

Sample ID:	Description:
------------	--------------

Low-Flow Test Report:

Test Date / Time: 5/17/2022 3:33:08 PM

Project: AB BROWN (8)

Operator Name: Jon Hill

Location Name: CCR-AP-6 Well Diameter: 2 in Casing Type: PVC Screen Length: 10 ft Top of Screen: 29 ft Total Depth: 39 ft Initial Depth to Water: 17.71 ft	Pump Type: Dedicated Tubing Type: LDPE Pump Intake From TOC: 34 ft Estimated Total Volume Pumped: 3600 ml Flow Cell Volume: 130 ml Final Flow Rate: 200 ml/min Final Draw Down: 0.28 ft	Instrument Used: Aqua TROLL 600 Serial Number: 745383
---	---	--

Test Notes:

1.5 gallons purged. Faulty turbidity sensor

Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth to Water	Flow
		+/- 0.1	+/- 0.5	+/- 3 %	+/- 10 %	+/- 10	+/- 10	+/- 5	
5/17/2022 3:33 PM	00:00	6.69 pH	14.64 °C	3,478.9 µS/cm	0.34 mg/L	174.79 NTU	121.3 mV	17.71 ft	200.00 ml/min
5/17/2022 3:36 PM	03:00	6.69 pH	14.22 °C	3,433.3 µS/cm	0.48 mg/L	136.70 NTU	121.2 mV	17.75 ft	200.00 ml/min
5/17/2022 3:39 PM	06:00	6.77 pH	14.15 °C	3,340.5 µS/cm	2.72 mg/L	152.47 NTU	120.5 mV	17.78 ft	200.00 ml/min
5/17/2022 3:42 PM	09:00	6.76 pH	14.15 °C	3,343.2 µS/cm	2.72 mg/L	163.58 NTU	120.0 mV	17.83 ft	200.00 ml/min
5/17/2022 3:45 PM	12:00	6.76 pH	14.24 °C	3,339.1 µS/cm	2.71 mg/L	207.13 NTU	119.1 mV	17.86 ft	200.00 ml/min
5/17/2022 3:48 PM	15:00	6.74 pH	14.13 °C	3,344.4 µS/cm	2.53 mg/L	274.70 NTU	117.8 mV	17.90 ft	200.00 ml/min
5/17/2022 3:51 PM	18:00	6.74 pH	14.24 °C	3,338.5 µS/cm	2.42 mg/L	334.69 NTU	116.2 mV	17.99 ft	200.00 ml/min

Samples

Sample ID:	Description:
------------	--------------

Low-Flow Test Report:

Test Date / Time: 5/17/2022 2:46:35 PM

Project: AB BROWN (7)

Operator Name: Jon Hill

Location Name: CCR-AP-7R Well Diameter: 2 in Casing Type: PVC Screen Length: 10 ft Top of Screen: 43.5 ft Total Depth: 53.5 ft Initial Depth to Water: 35.25 ft	Pump Type: Dedicated Tubing Type: LDPE Pump Intake From TOC: 49 ft Estimated Total Volume Pumped: 3600 ml Flow Cell Volume: 130 ml Final Flow Rate: 200 ml/min Final Draw Down: 0.05 ft	Instrument Used: Aqua TROLL 600 Serial Number: 745383
---	--	--

Test Notes:

1.0 gallons purged. Faulty turbidity sensor. Sample clear

Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth to Water	Flow
		+/- 0.1	+/- 0.5	+/- 3 %	+/- 10 %	+/- 10	+/- 10	+/- 5	
5/17/2022 2:46 PM	00:00	6.43 pH	15.02 °C	6,354.0 µS/cm	7.84 mg/L	57.52 NTU	123.7 mV	35.25 ft	200.00 ml/min
5/17/2022 2:49 PM	03:00	6.35 pH	14.31 °C	6,376.7 µS/cm	7.28 mg/L	152.10 NTU	123.3 mV	35.26 ft	200.00 ml/min
5/17/2022 2:52 PM	06:00	6.34 pH	14.41 °C	6,313.7 µS/cm	7.03 mg/L	324.88 NTU	124.3 mV	35.28 ft	200.00 ml/min
5/17/2022 2:55 PM	09:00	6.33 pH	14.21 °C	6,333.6 µS/cm	7.56 mg/L	579.69 NTU	125.5 mV	35.30 ft	200.00 ml/min
5/17/2022 2:58 PM	12:00	6.31 pH	14.29 °C	6,335.0 µS/cm	7.44 mg/L	923.64 NTU	126.8 mV	35.30 ft	200.00 ml/min
5/17/2022 3:01 PM	15:00	6.30 pH	14.24 °C	6,244.6 µS/cm	7.54 mg/L	1,290.1 NTU	128.0 mV	35.28 ft	200.00 ml/min
5/17/2022 3:04 PM	18:00	6.28 pH	14.27 °C	6,292.4 µS/cm	7.41 mg/L	1,427.8 NTU	129.1 mV	35.30 ft	200.00 ml/min

Samples

Sample ID:	Description:
------------	--------------

Low-Flow Test Report:

Test Date / Time: 5/18/2022 6:51:35 AM

Project: AB BROWN (9)

Operator Name: Jon Hill

Location Name: CCR-AP-8 Well Diameter: 2 in Casing Type: PVC Screen Length: 10 ft Top of Screen: 6.2 ft Total Depth: 16.2 ft Initial Depth to Water: 3.8 ft	Pump Type: Dedicated Tubing Type: LDPE Pump Intake From TOC: 11 ft Estimated Total Volume Pumped: 3600 ml Flow Cell Volume: 130 ml Final Flow Rate: 200 ml/min Final Draw Down: 0.26 ft	Instrument Used: Aqua TROLL 600 Serial Number: 745383
---	--	--

Test Notes:

0.5 gallons purged

Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth to Water	Flow
		+/- 0.1	+/- 0.5	+/- 3 %	+/- 10 %	+/- 10	+/- 10	+/- 5	
5/18/2022 6:51 AM	00:00	6.67 pH	18.12 °C	2,788.7 µS/cm	3.65 mg/L		159.3 mV	3.80 ft	200.00 ml/min
5/18/2022 6:54 AM	03:00	6.63 pH	18.20 °C	2,836.4 µS/cm	3.11 mg/L		159.2 mV	3.85 ft	200.00 ml/min
5/18/2022 6:57 AM	06:00	6.62 pH	18.31 °C	2,861.8 µS/cm	2.83 mg/L		158.9 mV	3.89 ft	200.00 ml/min
5/18/2022 7:00 AM	09:00	6.60 pH	18.31 °C	2,883.4 µS/cm	2.64 mg/L		158.7 mV	3.94 ft	200.00 ml/min
5/18/2022 7:03 AM	12:00	6.59 pH	18.38 °C	2,886.9 µS/cm	2.54 mg/L		158.5 mV	3.97 ft	200.00 ml/min
5/18/2022 7:06 AM	15:00	6.59 pH	18.45 °C	2,889.1 µS/cm	2.44 mg/L		158.1 mV	4.01 ft	200.00 ml/min
5/18/2022 7:09 AM	18:00	6.58 pH	18.53 °C	2,889.4 µS/cm	2.37 mg/L		158.0 mV	4.06 ft	200.00 ml/min

Samples

Sample ID:	Description:

Low-Flow Test Report:

Test Date / Time: 5/18/2022 11:19:41 AM

Project: AB BROWN (15)

Operator Name: Jon Hill

Location Name: CCR-AP-9 Well Diameter: 2 in Casing Type: PVC Screen Length: 10 ft Top of Screen: 25.2 ft Total Depth: 35.2 ft Initial Depth to Water: 8.55 ft	Pump Type: Dedicated Tubing Type: LDPE Pump Intake From TOC: 30 ft Estimated Total Volume Pumped: 4200 ml Flow Cell Volume: 130 ml Final Flow Rate: 200 ml/min Final Draw Down: 0.65 ft	Instrument Used: Aqua TROLL 600 Serial Number: 707269
--	---	--

Test Notes:

0.5 gallons purged

Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth to Water	Flow
		+/- 0.1	+/- 0.5	+/- 3 %	+/- 10 %	+/- 10	+/- 10	+/- 5	
5/18/2022 11:19 AM	00:00	6.78 pH	17.18 °C	7,773.3 µS/cm	0.50 mg/L	101.70 NTU	-58.5 mV	8.55 ft	200.00 ml/min
5/18/2022 11:22 AM	03:00	6.80 pH	17.26 °C	7,821.1 µS/cm	0.37 mg/L	93.15 NTU	-64.6 mV	9.03 ft	200.00 ml/min
5/18/2022 11:25 AM	06:00	6.81 pH	17.29 °C	7,906.1 µS/cm	0.33 mg/L	75.88 NTU	-68.1 mV	9.07 ft	200.00 ml/min
5/18/2022 11:28 AM	09:00	6.82 pH	17.32 °C	7,979.1 µS/cm	0.29 mg/L	64.94 NTU	-70.9 mV	9.13 ft	200.00 ml/min
5/18/2022 11:31 AM	12:00	6.83 pH	17.39 °C	8,045.5 µS/cm	0.30 mg/L	54.65 NTU	-72.8 mV	9.14 ft	200.00 ml/min
5/18/2022 11:34 AM	15:00	6.84 pH	17.38 °C	8,120.4 µS/cm	0.30 mg/L	55.65 NTU	-74.2 mV	9.17 ft	200.00 ml/min
5/18/2022 11:37 AM	18:00	6.85 pH	17.34 °C	8,221.9 µS/cm	0.29 mg/L	41.01 NTU	-75.2 mV	9.19 ft	200.00 ml/min
5/18/2022 11:40 AM	21:00	6.86 pH	17.25 °C	8,342.6 µS/cm	0.29 mg/L	55.20 NTU	-76.4 mV	9.20 ft	200.00 ml/min

Samples

Sample ID:	Description:
------------	--------------

Low-Flow Test Report:

Test Date / Time: 5/17/2022 10:38:51 AM

Project: AB BROWN (3)

Operator Name: Jon Hill

Location Name: CCR-AP-10 Well Diameter: 2 in Casing Type: PVC Screen Length: 10 ft Top of Screen: 33.2 ft Total Depth: 43.2 ft Initial Depth to Water: 35.3 ft	Pump Type: Dedicated Tubing Type: LDPE Pump Intake From TOC: 38 ft Estimated Total Volume Pumped: 7200 ml Flow Cell Volume: 130 ml Final Flow Rate: 200 ml/min Final Draw Down: 0.23 ft	Instrument Used: Aqua TROLL 600 Serial Number: 745383
---	--	--

Test Notes:

2.5 gallons purged

Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth to Water	Flow
		+/- 0.1	+/- 0.5	+/- 3 %	+/- 10 %	+/- 10	+/- 10	+/- 5	
5/17/2022 10:38 AM	00:00	6.99 pH	14.54 °C	3,995.4 µS/cm	3.80 mg/L	346.45 NTU	225.8 mV	35.30 ft	200.00 ml/min
5/17/2022 10:41 AM	03:00	6.90 pH	14.56 °C	3,579.4 µS/cm	1.42 mg/L	299.48 NTU	224.0 mV	35.34 ft	200.00 ml/min
5/17/2022 10:44 AM	06:00	6.88 pH	14.53 °C	3,496.6 µS/cm	0.94 mg/L	305.93 NTU	223.4 mV	35.37 ft	200.00 ml/min
5/17/2022 10:47 AM	09:00	6.87 pH	14.55 °C	3,462.9 µS/cm	0.88 mg/L	225.07 NTU	223.3 mV	35.38 ft	200.00 ml/min
5/17/2022 10:50 AM	12:00	6.86 pH	14.56 °C	3,437.4 µS/cm	0.87 mg/L	92.03 NTU	223.3 mV	35.40 ft	200.00 ml/min
5/17/2022 10:53 AM	15:00	6.86 pH	14.55 °C	3,441.1 µS/cm	0.89 mg/L	180.12 NTU	223.4 mV	35.42 ft	200.00 ml/min
5/17/2022 10:56 AM	18:00	6.86 pH	14.52 °C	3,424.9 µS/cm	0.86 mg/L	117.57 NTU	223.4 mV	35.42 ft	200.00 ml/min
5/17/2022 10:59 AM	21:00	6.85 pH	14.52 °C	3,416.6 µS/cm	0.86 mg/L	118.35 NTU	223.5 mV	35.44 ft	200.00 ml/min
5/17/2022 11:02 AM	24:00	6.85 pH	14.54 °C	3,391.6 µS/cm	0.87 mg/L	83.73 NTU	223.5 mV	35.46 ft	200.00 ml/min
5/17/2022 11:05 AM	27:00	6.85 pH	14.49 °C	3,404.8 µS/cm	0.86 mg/L	79.42 NTU	223.6 mV	35.45 ft	200.00 ml/min
5/17/2022 11:08 AM	30:00	6.84 pH	14.55 °C	3,329.4 µS/cm	0.83 mg/L	66.44 NTU	223.6 mV	35.46 ft	200.00 ml/min
5/17/2022 11:11 AM	33:00	6.84 pH	14.44 °C	3,357.1 µS/cm	0.82 mg/L	46.63 NTU	223.6 mV	35.50 ft	200.00 ml/min
5/17/2022 11:14 AM	36:00	6.84 pH	14.57 °C	3,347.1 µS/cm	0.86 mg/L	47.72 NTU	223.5 mV	35.53 ft	200.00 ml/min

Samples

Sample ID: MS/MSD 1	Description:
----------------------------	---------------------

Created using VuSitu from In-Situ, Inc.

Low-Flow Test Report:

Test Date / Time: 5/18/2022 12:53:32 PM

Project: AB BROWN (16)

Operator Name: Jon Hill

Location Name: CCR-AP-11 Well Diameter: 2 in Casing Type: PVC Screen Length: 10 ft Top of Screen: 16 ft Total Depth: 26 ft Initial Depth to Water: 11.02 ft	Pump Type: Sample Pro Tubing Type: LDPE Pump Intake From TOC: 21 ft Estimated Total Volume Pumped: 18586.666 ml Flow Cell Volume: 130 ml Final Flow Rate: 200 ml/min Final Draw Down: 0.20 ft	Instrument Used: Aqua TROLL 600 Serial Number: 707269
--	--	--

Test Notes:

6 gallons purged

Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth to Water	Flow
		+/- 0.1	+/- 0.5	+/- 3 %	+/- 10 %	+/- 10	+/- 10	+/- 5	
5/18/2022 12:53 PM	00:00		17.31 °C	0.06 µS/cm	10.18 mg/L	34.80 NTU	95.9 mV	11.05 ft	200.00 ml/min
5/18/2022 12:56 PM	03:00	6.89 pH	13.88 °C	1,357.4 µS/cm	6.40 mg/L	11,116 NTU	138.0 mV	11.10 ft	200.00 ml/min
5/18/2022 12:59 PM	06:00	6.88 pH	13.80 °C	1,343.0 µS/cm	7.12 mg/L	8,562.9 NTU	152.3 mV	11.13 ft	200.00 ml/min
5/18/2022 1:02 PM	09:00	6.89 pH	13.93 °C	1,357.0 µS/cm	7.56 mg/L	9,948.0 NTU	160.2 mV		200.00 ml/min
5/18/2022 1:05 PM	12:09	6.92 pH	13.75 °C	1,355.0 µS/cm	8.09 mg/L	6,983.0 NTU	164.9 mV		200.00 ml/min
5/18/2022 1:08 PM	15:09	6.91 pH	13.69 °C	1,353.6 µS/cm	8.27 mg/L	5,578.8 NTU	169.5 mV		200.00 ml/min
5/18/2022 1:11 PM	18:09	6.92 pH	13.70 °C	1,344.6 µS/cm	8.66 mg/L	4,337.0 NTU	172.4 mV		200.00 ml/min
5/18/2022 1:14 PM	21:09	6.95 pH	13.77 °C	1,346.8 µS/cm	8.94 mg/L	3,516.4 NTU	173.8 mV		200.00 ml/min
5/18/2022 1:17 PM	24:09	6.96 pH	13.82 °C	1,344.5 µS/cm	8.97 mg/L	3,553.1 NTU	175.4 mV		200.00 ml/min
5/18/2022 1:20 PM	27:09	6.98 pH	13.73 °C	1,340.3 µS/cm	9.18 mg/L	2,448.6 NTU	176.5 mV		200.00 ml/min
5/18/2022 1:23 PM	30:09	6.99 pH	13.56 °C	1,338.0 µS/cm	9.42 mg/L	1,988.4 NTU	177.7 mV		200.00 ml/min
5/18/2022 1:26 PM	33:09	7.00 pH	13.63 °C	1,335.7 µS/cm	9.47 mg/L	1,578.4 NTU	178.7 mV		200.00 ml/min
5/18/2022 1:29 PM	36:09	6.96 pH	13.91 °C	1,307.7 µS/cm	8.57 mg/L	1,171.1 NTU	180.2 mV		200.00 ml/min
5/18/2022 1:32 PM	39:09	6.90 pH	13.94 °C	1,311.5 µS/cm	6.64 mg/L	1,001.6 NTU	181.7 mV		200.00 ml/min
5/18/2022 1:35 PM	42:09	6.91 pH	13.74 °C	1,315.9 µS/cm	6.66 mg/L	770.06 NTU	181.9 mV		200.00 ml/min

5/18/2022 1:38 PM	45:09	6.91 pH	13.90 °C	1,321.3 µS/cm	6.54 mg/L	705.93 NTU	182.1 mV		200.00 ml/min
5/18/2022 1:41 PM	48:09	6.92 pH	13.78 °C	1,186.6 µS/cm	6.39 mg/L	561.79 NTU	182.2 mV		200.00 ml/min
5/18/2022 1:44 PM	51:09	6.93 pH	13.86 °C	1,258.1 µS/cm	6.33 mg/L	521.78 NTU	182.4 mV		200.00 ml/min
5/18/2022 1:46 PM	52:40	7.00 pH	13.90 °C	1,320.1 µS/cm	7.72 mg/L	546.98 NTU	181.8 mV		200.00 ml/min
5/18/2022 1:49 PM	55:40	6.94 pH	13.77 °C	1,317.4 µS/cm	6.60 mg/L	315.00 NTU	182.3 mV		200.00 ml/min
5/18/2022 1:52 PM	58:40	6.95 pH	13.74 °C	1,284.5 µS/cm	6.68 mg/L	422.44 NTU	182.8 mV		200.00 ml/min
5/18/2022 1:55 PM	01:01:40	6.95 pH	13.66 °C	1,210.3 µS/cm	6.62 mg/L	329.29 NTU	183.5 mV		200.00 ml/min
5/18/2022 1:58 PM	01:04:40	6.96 pH	13.66 °C	1,318.1 µS/cm	6.72 mg/L	526.27 NTU	183.8 mV		200.00 ml/min
5/18/2022 2:01 PM	01:07:40	6.96 pH	13.65 °C	1,320.7 µS/cm	6.97 mg/L	305.49 NTU	184.6 mV		200.00 ml/min
5/18/2022 2:02 PM	01:08:56	7.03 pH	13.63 °C	1,120.0 µS/cm	7.92 mg/L	322.63 NTU	183.8 mV		200.00 ml/min
5/18/2022 2:05 PM	01:11:56	6.96 pH	13.53 °C	1,316.3 µS/cm	6.74 mg/L	335.42 NTU	184.7 mV		200.00 ml/min
5/18/2022 2:08 PM	01:14:56	6.95 pH	13.62 °C	1,104.9 µS/cm	6.77 mg/L	239.10 NTU	185.6 mV		200.00 ml/min
5/18/2022 2:11 PM	01:17:56	6.95 pH	13.74 °C	1,146.8 µS/cm	6.99 mg/L	293.81 NTU	186.1 mV		200.00 ml/min
5/18/2022 2:14 PM	01:20:56	6.95 pH	13.72 °C	1,169.3 µS/cm	6.82 mg/L	170.83 NTU	186.5 mV		200.00 ml/min
5/18/2022 2:17 PM	01:23:56	6.95 pH	13.63 °C	1,311.3 µS/cm	6.76 mg/L	307.57 NTU	187.0 mV	11.22 ft	200.00 ml/min
5/18/2022 2:20 PM	01:26:56	6.95 pH	13.64 °C	249.42 µS/cm	6.91 mg/L	192.34 NTU	187.5 mV	11.23 ft	200.00 ml/min
5/18/2022 2:23 PM	01:29:56	6.95 pH	13.85 °C	216.99 µS/cm	6.85 mg/L	875.93 NTU	187.6 mV	11.22 ft	200.00 ml/min
5/18/2022 2:26 PM	01:32:56	6.95 pH	13.99 °C	1,038.3 µS/cm	6.82 mg/L	203.54 NTU	187.7 mV	11.25 ft	200.00 ml/min

Samples

Sample ID:	Description:

Low-Flow Test Report:

Test Date / Time: 5/17/2022 3:01:10 PM

Project: A.B. Brown (3)

Operator Name: Hayley Torres

Location Name: CCR-LF-1 Well Diameter: 2 in Casing Type: PVC Screen Length: 10 ft Top of Screen: 9 ft Total Depth: 19 ft Initial Depth to Water: 8.24 ft	Pump Type: Dedicated Tubing Type: LDPE Pump Intake From TOC: 14 ft Estimated Total Volume Pumped: 2.5 gal Flow Cell Volume: 130 ml Final Flow Rate: 100 ml/min Final Draw Down: 0 ft	Instrument Used: Aqua TROLL 600 Serial Number: 651925
---	---	--

Test Notes:

Turbidity never stabilized and rose throughout the entirety of the purge time. Water was visibly perfectly clear so the decision was made to sample despite the high number. Possible error with probe. Will be thoroughly cleaned before next sampling.

Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth to Water	Flow
		+/- 0.1	+/- 0.5	+/- 3 %	+/- 10 %	+/- 10	+/- 10	+/- 5	
5/17/2022 3:01 PM	00:00	6.70 pH	17.60 °C	2,025.2 µS/cm	2.69 mg/L	81.73 NTU	94.7 mV	8.24 ft	100.00 ml/min
5/17/2022 3:04 PM	03:00	6.68 pH	18.45 °C	2,039.7 µS/cm	2.53 mg/L	68.65 NTU	98.4 mV		100.00 ml/min
5/17/2022 3:07 PM	06:00	6.70 pH	18.41 °C	2,034.0 µS/cm	2.49 mg/L	71.40 NTU	99.5 mV		100.00 ml/min
5/17/2022 3:10 PM	09:00	6.70 pH	18.32 °C	2,035.1 µS/cm	2.47 mg/L	90.48 NTU	101.1 mV		100.00 ml/min
5/17/2022 3:13 PM	12:00	6.67 pH	18.22 °C	2,040.5 µS/cm	2.47 mg/L	104.74 NTU	103.2 mV		100.00 ml/min
5/17/2022 3:16 PM	15:00	6.64 pH	18.08 °C	2,036.2 µS/cm	2.44 mg/L	138.59 NTU	105.4 mV		100.00 ml/min
5/17/2022 3:19 PM	18:00	6.60 pH	18.46 °C	2,041.4 µS/cm	2.45 mg/L	177.40 NTU	107.5 mV		100.00 ml/min
5/17/2022 3:22 PM	21:00	6.57 pH	18.48 °C	2,036.6 µS/cm	2.43 mg/L	197.77 NTU	109.4 mV		100.00 ml/min
5/17/2022 3:25 PM	24:00	6.56 pH	17.17 °C	2,004.3 µS/cm	2.38 mg/L	200.72 NTU	111.4 mV		100.00 ml/min
5/17/2022 3:28 PM	27:00	6.54 pH	17.15 °C	1,997.9 µS/cm	2.44 mg/L	210.48 NTU	113.3 mV		100.00 ml/min
5/17/2022 3:31 PM	30:00	6.52 pH	17.18 °C	1,961.5 µS/cm	2.62 mg/L	176.19 NTU	114.9 mV		100.00 ml/min
5/17/2022 3:34 PM	33:00	6.51 pH	17.18 °C	1,952.4 µS/cm	2.75 mg/L	211.35 NTU	116.0 mV		100.00 ml/min
5/17/2022 3:37 PM	36:00	6.51 pH	16.95 °C	1,946.5 µS/cm	2.81 mg/L	188.40 NTU	116.7 mV		100.00 ml/min
5/17/2022 3:40 PM	39:00	6.51 pH	16.82 °C	1,949.2 µS/cm	2.81 mg/L	235.04 NTU	117.3 mV		100.00 ml/min
5/17/2022 3:43 PM	42:00	6.51 pH	17.03 °C	1,962.7 µS/cm	2.74 mg/L	144.76 NTU	117.6 mV		100.00 ml/min

5/17/2022 3:46 PM	45:00	6.51 pH	17.15 °C	1,969.9 µS/cm	2.71 mg/L	165.91 NTU	117.7 mV		100.00 ml/min
5/17/2022 3:49 PM	48:00	6.51 pH	16.96 °C	1,970.4 µS/cm	2.70 mg/L	252.88 NTU	118.0 mV		100.00 ml/min
5/17/2022 3:52 PM	51:00	6.50 pH	18.01 °C	1,993.7 µS/cm	2.74 mg/L	266.52 NTU	117.5 mV		100.00 ml/min
5/17/2022 3:55 PM	54:00	6.48 pH	19.63 °C	2,004.3 µS/cm	2.78 mg/L	301.27 NTU	115.8 mV		100.00 ml/min
5/17/2022 3:58 PM	57:00	6.48 pH	19.96 °C	2,001.5 µS/cm	2.83 mg/L	325.14 NTU	114.1 mV		100.00 ml/min
5/17/2022 4:01 PM	01:00:00	6.48 pH	19.87 °C	2,003.8 µS/cm	2.90 mg/L	387.08 NTU	113.3 mV		100.00 ml/min
5/17/2022 4:04 PM	01:03:00	6.48 pH	20.01 °C	2,004.0 µS/cm	2.92 mg/L	426.59 NTU	112.3 mV		100.00 ml/min
5/17/2022 4:07 PM	01:06:00	6.50 pH	20.05 °C	2,007.8 µS/cm	3.01 mg/L	469.62 NTU	111.1 mV		100.00 ml/min
5/17/2022 4:10 PM	01:09:00	6.51 pH	19.86 °C	2,005.8 µS/cm	3.09 mg/L	505.92 NTU	109.9 mV		100.00 ml/min
5/17/2022 4:13 PM	01:12:00	6.54 pH	19.96 °C	2,007.7 µS/cm	3.13 mg/L	559.93 NTU	108.0 mV		100.00 ml/min
5/17/2022 4:16 PM	01:15:00	6.56 pH	20.52 °C	2,008.8 µS/cm	3.14 mg/L	608.05 NTU	106.2 mV		100.00 ml/min
5/17/2022 4:19 PM	01:18:00	6.59 pH	20.15 °C	2,007.4 µS/cm	3.24 mg/L	737.74 NTU	104.3 mV		100.00 ml/min
5/17/2022 4:22 PM	01:21:00	6.61 pH	20.44 °C	2,013.6 µS/cm	3.35 mg/L	985.90 NTU	102.8 mV		100.00 ml/min

Samples

Sample ID:	Description:

Created using VuSitu from In-Situ, Inc.

Low-Flow Test Report:

Test Date / Time: 5/18/2022 10:34:14 AM

Project: A.B. Brown (5)

Operator Name: Hayley Torres

Location Name: CCR-LF-2 Well Diameter: 2 in Casing Type: PVC Screen Length: 10 ft Top of Screen: 35 ft Total Depth: 45 ft Initial Depth to Water: 27.26 ft	Pump Type: Dedicated Tubing Type: LDPE Pump Intake From TOC: 40 ft Estimated Total Volume Pumped: 2 gal Flow Cell Volume: 130 ml Final Flow Rate: 100 ml/min Final Draw Down: 0 ft	Instrument Used: Aqua TROLL 600 Serial Number: 651925
---	---	--

Test Notes:

Faulty conductivity meter.

Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth to Water	Flow
		+/- 0.1	+/- 0.5	+/- 3 %	+/- 10 %	+/- 10	+/- 10	+/- 5	
5/18/2022 10:34 AM	00:00	6.69 pH	16.65 °C	23,817 µS/cm	5.83 mg/L		127.3 mV	27.26 ft	100.00 ml/min
5/18/2022 10:37 AM	03:00	6.60 pH	16.73 °C	19,859 µS/cm	3.04 mg/L		119.8 mV		100.00 ml/min
5/18/2022 10:40 AM	06:00	6.59 pH	16.54 °C	21,907 µS/cm	2.52 mg/L		119.6 mV		100.00 ml/min
5/18/2022 10:43 AM	09:00	6.57 pH	16.70 °C	23,067 µS/cm	2.37 mg/L		120.3 mV		100.00 ml/min
5/18/2022 10:46 AM	12:00	6.56 pH	16.78 °C	11,003 µS/cm	2.28 mg/L		120.9 mV		100.00 ml/min
5/18/2022 10:49 AM	15:00	6.56 pH	16.89 °C	21,705 µS/cm	2.26 mg/L		121.3 mV		100.00 ml/min
5/18/2022 10:52 AM	18:00	6.56 pH	16.68 °C	17,449 µS/cm	2.34 mg/L		121.8 mV		100.00 ml/min
5/18/2022 10:55 AM	21:00	6.55 pH	16.87 °C	22,773 µS/cm	2.27 mg/L		122.8 mV		100.00 ml/min
5/18/2022 10:58 AM	24:00	6.55 pH	16.84 °C	20,300 µS/cm	2.50 mg/L		123.8 mV		100.00 ml/min
5/18/2022 11:01 AM	27:00	6.55 pH	16.95 °C	21,009 µS/cm	2.57 mg/L		124.8 mV		100.00 ml/min
5/18/2022 11:04 AM	30:00	6.54 pH	17.03 °C	21,211 µS/cm	2.44 mg/L		125.8 mV		100.00 ml/min
5/18/2022 11:07 AM	33:00	6.53 pH	17.04 °C	19,829 µS/cm	2.40 mg/L		126.9 mV		100.00 ml/min
5/18/2022 11:10 AM	36:00	6.54 pH	17.07 °C	4,692.3 µS/cm	2.68 mg/L		127.7 mV		100.00 ml/min
5/18/2022 11:13 AM	39:00	6.53 pH	17.17 °C	4,490.4 µS/cm	2.57 mg/L		128.4 mV		100.00 ml/min
5/18/2022 11:16 AM	42:00	6.53 pH	17.10 °C	21,322 µS/cm	2.46 mg/L		128.6 mV		100.00 ml/min

5/18/2022 11:19 AM	45:00	6.52 pH	17.11 °C	1,312.4 µS/cm	3.03 mg/L		129.5 mV		100.00 ml/min
5/18/2022 11:22 AM	48:00	6.51 pH	17.19 °C	20,171 µS/cm	2.62 mg/L		130.6 mV		100.00 ml/min
5/18/2022 11:25 AM	51:00	6.51 pH	17.28 °C	22,699 µS/cm	2.75 mg/L		131.6 mV		100.00 ml/min
5/18/2022 11:28 AM	54:00	6.51 pH	17.36 °C	22,205 µS/cm	2.95 mg/L		132.5 mV		100.00 ml/min
5/18/2022 11:31 AM	57:00	6.51 pH	17.43 °C	19,616 µS/cm	2.53 mg/L		133.6 mV		100.00 ml/min
5/18/2022 11:34 AM	01:00:00	6.51 pH	17.45 °C	22,845 µS/cm	2.45 mg/L		134.3 mV		100.00 ml/min

Samples

Sample ID: DUP 3, Field Blank	Description:
-------------------------------	--------------

Created using VuSitu from In-Situ, Inc.

Low-Flow Test Report:

Test Date / Time: 5/18/2022 8:41:54 AM

Project: A.B. Brown (4)

Operator Name: Hayley Torres

Location Name: CCR-LF-3 Well Diameter: 2 in Casing Type: PVC Screen Length: 10 ft Top of Screen: 25 ft Total Depth: 35 ft Initial Depth to Water: 30.12 ft	Pump Type: Dedicated Tubing Type: LDPE Pump Intake From TOC: 30 ft Estimated Total Volume Pumped: 1.25 gal Flow Cell Volume: 130 ml Final Flow Rate: 100 ml/min Final Draw Down: 0 ft	Instrument Used: Aqua TROLL 600 Serial Number: 651925
---	---	--

Test Notes:

Faulty turbidity. Water clean

Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth to Water	Flow
		+/- 0.1	+/- 0.5	+/- 3 %	+/- 10 %	+/- 10	+/- 10	+/- 5	
5/18/2022 8:41 AM	00:00	7.05 pH	17.32 °C	2,356.2 µS/cm	7.62 mg/L	304.92 NTU	221.1 mV	30.12 ft	100.00 ml/min
5/18/2022 8:44 AM	03:00	6.93 pH	17.17 °C	2,330.7 µS/cm	6.91 mg/L	341.79 NTU	212.7 mV		100.00 ml/min
5/18/2022 8:47 AM	06:00	6.91 pH	16.96 °C	2,324.3 µS/cm	6.78 mg/L	354.02 NTU	203.9 mV		100.00 ml/min
5/18/2022 8:50 AM	09:00	6.90 pH	16.85 °C	2,321.0 µS/cm	6.68 mg/L	368.09 NTU	196.7 mV		100.00 ml/min
5/18/2022 8:53 AM	12:00	6.89 pH	16.88 °C	2,317.8 µS/cm	6.62 mg/L	394.98 NTU	190.8 mV		100.00 ml/min
5/18/2022 8:56 AM	15:00	6.89 pH	16.72 °C	2,319.9 µS/cm	6.58 mg/L	378.04 NTU	185.9 mV		100.00 ml/min
5/18/2022 8:59 AM	18:00	6.88 pH	16.53 °C	2,328.8 µS/cm	6.61 mg/L	423.45 NTU	181.6 mV		100.00 ml/min
5/18/2022 9:02 AM	21:00	6.87 pH	16.61 °C	2,325.0 µS/cm	6.56 mg/L	535.32 NTU	177.8 mV		100.00 ml/min

Samples

Sample ID:	Description:

Low-Flow Test Report:

Test Date / Time: 5/17/2022 9:48:22 AM

Project: A.B. Brown

Operator Name: Hayley Torres

Location Name: CCR-LF-4 Well Diameter: 2 in Casing Type: PVC Screen Length: 10 ft Top of Screen: 45 ft Total Depth: 55 ft Initial Depth to Water: 47.78 ft	Pump Type: Peristaltic Tubing Type: LDPE Pump Intake From TOC: 25 ft Estimated Total Volume Pumped: 1.5 gal Flow Cell Volume: 130 ml Final Flow Rate: 100 ml/min Final Draw Down: 0 ft	Instrument Used: Aqua TROLL 600 Serial Number: 651925
--	---	--

Test Notes:

Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth to Water	Flow
		+/- 0.1	+/- 0.5	+/- 3 %	+/- 10 %	+/- 10	+/- 10	+/- 5	
5/17/2022 9:48 AM	00:00	6.60 pH	16.24 °C	13,315 µS/cm	3.96 mg/L	59.22 NTU	-23.2 mV	47.78 ft	100.00 ml/min
5/17/2022 9:51 AM	03:00	6.62 pH	15.97 °C	13,951 µS/cm	1.60 mg/L	38.65 NTU	-55.0 mV		100.00 ml/min
5/17/2022 9:54 AM	06:00	6.62 pH	16.09 °C	13,965 µS/cm	1.25 mg/L	21.16 NTU	-60.5 mV		100.00 ml/min
5/17/2022 9:57 AM	09:00	6.62 pH	16.16 °C	13,930 µS/cm	1.12 mg/L	11.69 NTU	-62.4 mV		100.00 ml/min
5/17/2022 10:00 AM	12:00	6.62 pH	16.16 °C	13,927 µS/cm	1.07 mg/L	7.59 NTU	-63.1 mV		100.00 ml/min
5/17/2022 10:03 AM	15:00	6.62 pH	16.24 °C	13,886 µS/cm	1.04 mg/L	6.30 NTU	-63.2 mV		100.00 ml/min
5/17/2022 10:06 AM	18:00	6.62 pH	16.20 °C	13,872 µS/cm	1.00 mg/L	6.03 NTU	-63.0 mV		100.00 ml/min

Samples

Sample ID:	Description:

Low-Flow Test Report:

Test Date / Time: 5/17/2022 10:50:38 AM

Project: A.B. Brown (2)

Operator Name: Hayley Torres

Location Name: CCR-LF-5 Well Diameter: 2 in Casing Type: PVC Screen Length: 10 ft Top of Screen: 20 ft Total Depth: 30 ft Initial Depth to Water: 21.32 ft	Pump Type: Dedicated Tubing Type: LDPE Pump Intake From TOC: 25 ft Estimated Total Volume Pumped: 2.5 gal Flow Cell Volume: 130 ml Final Flow Rate: 100 ml/min Final Draw Down: 0 ft	Instrument Used: Aqua TROLL 600 Serial Number: 651925
---	--	--

Test Notes:

Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth to Water	Flow
		+/- 0.1	+/- 0.5	+/- 3 %	+/- 10 %	+/- 10	+/- 10	+/- 5	
5/17/2022 10:50 AM	00:00	6.81 pH	16.83 °C	4,509.1 µS/cm	1.34 mg/L	24.78 NTU	1.8 mV	21.32 ft	100.00 ml/min
5/17/2022 10:53 AM	03:00	6.80 pH	16.68 °C	4,189.0 µS/cm	1.12 mg/L	81.03 NTU	8.2 mV		100.00 ml/min
5/17/2022 10:56 AM	06:00	6.82 pH	16.43 °C	4,142.8 µS/cm	1.02 mg/L	33.75 NTU	11.9 mV		100.00 ml/min
5/17/2022 10:59 AM	09:00	6.82 pH	16.61 °C	4,239.8 µS/cm	0.84 mg/L	60.91 NTU	16.1 mV		100.00 ml/min
5/17/2022 11:02 AM	12:00	6.82 pH	16.53 °C	4,406.3 µS/cm	0.81 mg/L	29.68 NTU	19.3 mV		100.00 ml/min
5/17/2022 11:05 AM	15:00	6.82 pH	16.56 °C	4,638.3 µS/cm	0.82 mg/L	80.06 NTU	22.3 mV		100.00 ml/min
5/17/2022 11:08 AM	18:00	6.81 pH	16.56 °C	4,767.1 µS/cm	0.79 mg/L	37.32 NTU	23.2 mV		100.00 ml/min
5/17/2022 11:11 AM	21:00	6.81 pH	16.59 °C	4,814.1 µS/cm	0.43 mg/L	29.83 NTU	12.4 mV		100.00 ml/min
5/17/2022 11:14 AM	24:00	6.81 pH	16.60 °C	4,891.6 µS/cm	0.19 mg/L	24.08 NTU	14.3 mV		100.00 ml/min
5/17/2022 11:17 AM	27:00	6.81 pH	16.59 °C	4,892.7 µS/cm	0.16 mg/L	27.14 NTU	17.6 mV		100.00 ml/min

Samples

Sample ID:	Description:
------------	--------------

Low-Flow Test Report:

Test Date / Time: 5/17/2022 1:31:03 PM

Project: A.B. Brown (3)

Operator Name: Hayley Torres

Location Name: CCR-LF-6 Well Diameter: 2 in Casing Type: PVC Screen Length: 5 ft Top of Screen: 4.66 ft Total Depth: 9.66 ft Initial Depth to Water: 8.39 ft	Pump Type: Dedicated Tubing Type: LDPE Pump Intake From TOC: 6.5 ft Estimated Total Volume Pumped: 0.75 gal Flow Cell Volume: 130 ml Final Flow Rate: 100 ml/min Final Draw Down: 0 ft	Instrument Used: Aqua TROLL 600 Serial Number: 651925
--	--	--

Test Notes:

Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth to Water	Flow
		+/- 0.1	+/- 0.5	+/- 3 %	+/- 10 %	+/- 10	+/- 10	+/- 5	
5/17/2022 1:31 PM	00:00	6.88 pH	23.19 °C	1,550.9 µS/cm	3.74 mg/L		119.5 mV	8.39 ft	100.00 ml/min
5/17/2022 1:34 PM	03:00	6.81 pH	22.70 °C	1,494.8 µS/cm	1.34 mg/L		119.5 mV		100.00 ml/min
5/17/2022 1:37 PM	06:00	6.83 pH	21.63 °C	1,557.9 µS/cm	1.54 mg/L		116.7 mV		100.00 ml/min
5/17/2022 1:40 PM	09:00	6.84 pH	21.40 °C	1,579.9 µS/cm	1.46 mg/L		113.2 mV		100.00 ml/min
5/17/2022 1:43 PM	12:00	6.84 pH	20.85 °C	1,567.8 µS/cm	1.48 mg/L		111.3 mV		100.00 ml/min
5/17/2022 1:46 PM	15:00	6.82 pH	20.73 °C	1,568.8 µS/cm	1.48 mg/L		110.6 mV		100.00 ml/min
5/17/2022 1:49 PM	18:00	6.77 pH	20.44 °C	1,562.9 µS/cm	1.45 mg/L		111.1 mV		100.00 ml/min
5/17/2022 1:52 PM	21:00	6.74 pH	20.58 °C	1,569.4 µS/cm	1.57 mg/L		111.1 mV		100.00 ml/min

Samples

Sample ID:	Description:

Low-Flow Test Report:

Test Date / Time: 5/19/2022 6:47:38 AM

Project: AB BROWN (19)

Operator Name: Jon Hill

Location Name: CCR-SP-1 Well Diameter: 2 in Casing Type: PVC Screen Length: 10 ft Top of Screen: 10 ft Total Depth: 20 ft Initial Depth to Water: 11.5 ft	Pump Type: Sample Pro Tubing Type: LDPE Pump Intake From TOC: 15 ft Estimated Total Volume Pumped: 3600 ml Flow Cell Volume: 130 ml Final Flow Rate: 200 ml/min Final Draw Down: 0.26 ft	Instrument Used: Aqua TROLL 600 Serial Number: 707269
---	--	--

Test Notes:

1.0 gallons purged

Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth to Water	Flow
		+/- 0.1	+/- 0.5	+/- 3 %	+/- 10 %	+/- 10	+/- 10	+/- 5	
5/19/2022 6:47 AM	00:00	6.78 pH	13.40 °C	2,480.3 µS/cm	7.60 mg/L	22.18 NTU	-5.4 mV	11.50 ft	200.00 ml/min
5/19/2022 6:50 AM	03:00	6.59 pH	13.38 °C	2,442.1 µS/cm	0.11 mg/L	8.68 NTU	-10.8 mV	11.57 ft	200.00 ml/min
5/19/2022 6:53 AM	06:00	6.61 pH	13.24 °C	2,416.8 µS/cm	0.07 mg/L	1.79 NTU	-16.4 mV	11.62 ft	200.00 ml/min
5/19/2022 6:56 AM	09:00	6.60 pH	13.30 °C	2,413.0 µS/cm	0.04 mg/L	1.08 NTU	-18.0 mV	11.66 ft	200.00 ml/min
5/19/2022 6:59 AM	12:00	6.60 pH	13.24 °C	2,406.0 µS/cm	0.03 mg/L	0.00 NTU	-20.3 mV	11.70 ft	200.00 ml/min
5/19/2022 7:02 AM	15:00	6.59 pH	13.28 °C	2,397.6 µS/cm	0.02 mg/L	0.00 NTU	-23.8 mV	11.72 ft	200.00 ml/min
5/19/2022 7:05 AM	18:00	6.60 pH	13.25 °C	2,398.7 µS/cm	0.02 mg/L	0.00 NTU	-26.7 mV	11.76 ft	200.00 ml/min

Samples

Sample ID: FB-2, MS/MSD-2	Description:
---------------------------	--------------

Low-Flow Test Report:

Test Date / Time: 5/19/2022 7:35:07 AM

Project: AB BROWN (20)

Operator Name: Jon Hill

Location Name: CCR-SP-2 Well Diameter: 2 cm Casing Type: PVC Screen Length: 10 ft Top of Screen: 10 ft Total Depth: 20 ft Initial Depth to Water: 13.79 ft	Pump Type: Sample Pro Tubing Type: LDPE Pump Intake From TOC: 15 ft Estimated Total Volume Pumped: 3600 ml Flow Cell Volume: 130 ml Final Flow Rate: 200 ml/min Final Draw Down: 0.23 ft	Instrument Used: Aqua TROLL 600 Serial Number: 707269
---	--	--

Test Notes:

1.0 gallons purged

Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth to Water	Flow
		+/- 0.1	+/- 0.5	+/- 3 %	+/- 10 %	+/- 10	+/- 10	+/- 5	
5/19/2022 7:35 AM	00:00	6.83 pH	14.54 °C	1,434.1 µS/cm	0.79 mg/L	22.73 NTU	-50.3 mV	13.79 ft	200.00 ml/min
5/19/2022 7:38 AM	03:00	6.84 pH	14.35 °C	1,406.5 µS/cm	0.03 mg/L	6.23 NTU	-66.9 mV	13.82 ft	200.00 ml/min
5/19/2022 7:41 AM	06:00	6.85 pH	14.33 °C	1,431.6 µS/cm	0.01 mg/L	7.53 NTU	-75.0 mV	13.87 ft	200.00 ml/min
5/19/2022 7:44 AM	09:00	6.87 pH	14.31 °C	1,452.5 µS/cm	0.01 mg/L	7.69 NTU	-79.8 mV	13.92 ft	200.00 ml/min
5/19/2022 7:47 AM	12:00	6.88 pH	14.34 °C	1,469.1 µS/cm	0.00 mg/L	15.08 NTU	-83.4 mV	13.95 ft	200.00 ml/min
5/19/2022 7:50 AM	15:00	6.90 pH	14.35 °C	1,478.6 µS/cm	0.00 mg/L	27.46 NTU	-85.9 mV	13.99 ft	200.00 ml/min
5/19/2022 7:53 AM	18:00	6.91 pH	14.41 °C	1,502.8 µS/cm	0.01 mg/L	20.64 NTU	-86.6 mV	14.02 ft	200.00 ml/min

Samples

Sample ID:	Description:
------------	--------------

Low-Flow Test Report:

Test Date / Time: 5/19/2022 8:21:15 AM

Project: AB BROWN (21)

Operator Name: Jon Hill

Location Name: CCR-SP-3 Well Diameter: 2 in Casing Type: PVC Screen Length: 10 ft Top of Screen: 10 ft Total Depth: 20 ft Initial Depth to Water: 7.17 ft	Pump Type: Sample Pro Tubing Type: LDPE Pump Intake From TOC: 15 ft Estimated Total Volume Pumped: 3600 ml Flow Cell Volume: 130 ml Final Flow Rate: 200 ml/min Final Draw Down: 0.25 ft	Instrument Used: Aqua TROLL 600 Serial Number: 707269
---	--	--

Test Notes:

1.0 gallons purged

Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth to Water	Flow
		+/- 0.1	+/- 0.5	+/- 3 %	+/- 10 %	+/- 10	+/- 10	+/- 5	
5/19/2022 8:21 AM	00:00	7.15 pH	13.96 °C	753.37 µS/cm	0.39 mg/L	217.45 NTU	-23.8 mV	7.17 ft	200.00 ml/min
5/19/2022 8:24 AM	03:00	7.11 pH	13.79 °C	749.01 µS/cm	0.04 mg/L	89.01 NTU	-24.9 mV	7.22 ft	200.00 ml/min
5/19/2022 8:27 AM	06:00	7.11 pH	13.57 °C	749.07 µS/cm	0.00 mg/L	57.86 NTU	-26.4 mV	7.25 ft	200.00 ml/min
5/19/2022 8:30 AM	09:00	7.09 pH	13.45 °C	748.08 µS/cm	0.00 mg/L	45.28 NTU	-25.9 mV	7.29 ft	200.00 ml/min
5/19/2022 8:33 AM	12:00	7.09 pH	13.50 °C	751.52 µS/cm	0.01 mg/L	28.30 NTU	-22.0 mV	7.33 ft	200.00 ml/min
5/19/2022 8:36 AM	15:00	7.10 pH	13.46 °C	763.13 µS/cm	0.08 mg/L	14.00 NTU	-19.6 mV	7.37 ft	200.00 ml/min
5/19/2022 8:39 AM	18:00	7.11 pH	13.51 °C	771.21 µS/cm	0.11 mg/L	7.41 NTU	-19.7 mV	7.42 ft	200.00 ml/min

Samples

Sample ID: DUP-2	Description:
------------------	--------------

Low-Flow Test Report:

Test Date / Time: 5/18/2022 3:29:35 PM

Project: AB BROWN (18)

Operator Name: Jon Hill

Location Name: CCR-BK-1 Well Diameter: 2 in Casing Type: PVC Screen Length: 10 ft Top of Screen: 54 ft Total Depth: 64 ft	Pump Type: Sample Pro Tubing Type: LDPE Pump Intake From TOC: 59 ft Estimated Total Volume Pumped: 3600 ml Flow Cell Volume: 130 ml Final Flow Rate: 200 ml/min	Instrument Used: Aqua TROLL 600 Serial Number: 707269
--	---	--

Test Notes:

DTW - dry to top of pump. 0.5 gallons purged

Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth to Water	Flow
		+/- 0.1	+/- 0.5	+/- 3 %	+/- 10 %	+/- 10	+/- 10	+/- 5	
5/18/2022 3:29 PM	00:00	7.07 pH	15.68 °C	556.25 µS/cm	6.12 mg/L	0.00 NTU	160.9 mV		200.00 ml/min
5/18/2022 3:32 PM	03:00	6.82 pH	15.36 °C	505.95 µS/cm	7.31 mg/L	0.00 NTU	176.2 mV		200.00 ml/min
5/18/2022 3:35 PM	06:00	6.84 pH	15.56 °C	500.85 µS/cm	7.01 mg/L	0.00 NTU	179.6 mV		200.00 ml/min
5/18/2022 3:38 PM	09:00	6.82 pH	15.42 °C	500.38 µS/cm	6.77 mg/L	0.00 NTU	183.5 mV		200.00 ml/min
5/18/2022 3:41 PM	12:00	6.85 pH	15.49 °C	499.78 µS/cm	6.59 mg/L	0.00 NTU	184.5 mV		200.00 ml/min
5/18/2022 3:44 PM	15:00	6.83 pH	15.62 °C	495.47 µS/cm	6.42 mg/L	0.00 NTU	186.7 mV		200.00 ml/min
5/18/2022 3:47 PM	18:00	6.85 pH	15.59 °C	496.55 µS/cm	6.26 mg/L	0.00 NTU	187.3 mV		200.00 ml/min

Samples

Sample ID:	Description:

Low-Flow Test Report:

Test Date / Time: 5/18/2022 2:46:35 PM

Project: AB BROWN (17)

Operator Name: Jon Hill

Location Name: CCR-BK-2 Well Diameter: 2 in Casing Type: PVC Screen Length: 10 ft Top of Screen: 15.5 ft Total Depth: 25.5 ft Initial Depth to Water: 16.08 ft	Pump Type: Sample Pro Tubing Type: LDPE Pump Intake From TOC: 21 ft Estimated Total Volume Pumped: 3600 ml Flow Cell Volume: 130 ml Final Flow Rate: 200 ml/min Final Draw Down: 0 ft	Instrument Used: Aqua TROLL 600 Serial Number: 707269
--	---	--

Test Notes:

Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth to Water	Flow
		+/- 0.1	+/- 0.5	+/- 3 %	+/- 10 %	+/- 10	+/- 10	+/- 5	
5/18/2022 2:46 PM	00:00	6.98 pH	15.10 °C	573.14 µS/cm	1.36 mg/L	28.62 NTU	170.0 mV	16.08 ft	200.00 ml/min
5/18/2022 2:49 PM	03:00	6.93 pH	15.05 °C	562.88 µS/cm	0.99 mg/L	23.92 NTU	171.3 mV	16.10 ft	200.00 ml/min
5/18/2022 2:52 PM	06:00	6.94 pH	15.04 °C	558.45 µS/cm	0.89 mg/L	8.77 NTU	170.7 mV	16.10 ft	200.00 ml/min
5/18/2022 2:55 PM	09:00	6.92 pH	14.74 °C	554.00 µS/cm	0.81 mg/L	4.39 NTU	171.7 mV	16.10 ft	200.00 ml/min
5/18/2022 2:58 PM	12:00	6.93 pH	14.72 °C	546.02 µS/cm	0.69 mg/L	5.87 NTU	172.0 mV	16.10 ft	200.00 ml/min
5/18/2022 3:01 PM	15:00	6.89 pH	14.70 °C	533.88 µS/cm	0.60 mg/L	3.85 NTU	174.2 mV	16.10 ft	200.00 ml/min
5/18/2022 3:04 PM	18:00	6.90 pH	14.78 °C	527.26 µS/cm	0.56 mg/L	0.32 NTU	174.0 mV	16.10 ft	200.00 ml/min

Samples

Sample ID: MS/MSD-3	Description:
---------------------	--------------

Low-Flow Test Report:

Test Date / Time: 11/2/2022 1:17:17 PM

Project: AB BROWN

Operator Name: Jon Hill

Location Name: CCR-AP-1R Well Diameter: 2 in Casing Type: PVC Screen Length: 10 ft Top of Screen: 27 ft Total Depth: 37 ft Initial Depth to Water: 19.87 ft	Pump Type: Dedicated Tubing Type: LDPE Pump Intake From TOC: 32 ft Estimated Total Volume Pumped: 3843.333 ml Flow Cell Volume: 130 ml Final Flow Rate: 200 ml/min Final Draw Down: 0 ft	Instrument Used: Aqua TROLL 500 Serial Number: 745345
--	---	--

Test Notes:

1.0 gallons purged

Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth to Water	Flow
		+/- 0.1	+/- 0.5	+/- 3 %	+/- 10 %	+/- 10	+/- 10	+/- 5	
11/2/2022 1:17 PM	00:00	7.11 pH	15.30 °C	3,183.2 µS/cm	0.00 mg/L	3.05 NTU	44.8 mV	605.64 cm	200.00 ml/min
11/2/2022 1:20 PM	03:00	7.14 pH	15.23 °C	3,063.6 µS/cm	0.00 mg/L	3.68 NTU	33.2 mV	605.64 cm	200.00 ml/min
11/2/2022 1:23 PM	06:00	7.36 pH	15.27 °C	2,924.8 µS/cm	0.00 mg/L	5.54 NTU	22.7 mV	605.64 cm	200.00 ml/min
11/2/2022 1:26 PM	09:00	7.36 pH	15.21 °C	2,778.6 µS/cm	0.00 mg/L	11.08 NTU	18.2 mV	605.64 cm	200.00 ml/min
11/2/2022 1:29 PM	12:00	7.41 pH	15.29 °C	2,714.0 µS/cm	0.00 mg/L	19.86 NTU	12.9 mV	605.64 cm	200.00 ml/min
11/2/2022 1:32 PM	15:00	7.40 pH	15.18 °C	2,700.5 µS/cm	0.00 mg/L	34.37 NTU	10.8 mV	605.64 cm	200.00 ml/min
11/2/2022 1:33 PM	16:13	7.36 pH	15.31 °C	2,720.1 µS/cm	0.24 mg/L	0.00 NTU	12.5 mV	605.64 cm	200.00 ml/min
11/2/2022 1:36 PM	19:13	7.43 pH	15.26 °C	2,650.8 µS/cm	0.01 mg/L	0.00 NTU	6.1 mV	605.64 cm	200.00 ml/min

Samples

Sample ID:	Description:
------------	--------------

Low-Flow Test Report:

Test Date / Time: 11/8/2022 4:33:15 PM

Project: AB Brown (13)

Operator Name: Hayley Torres

Location Name: CCR-AP-2I Well Diameter: 2 in Casing Type: PVC Screen Length: 10 ft Top of Screen: 83 ft Total Depth: 93 ft Initial Depth to Water: 35.69 ft	Pump Type: Dedicated Tubing Type: LDPE Pump Intake From TOC: 88 ft Estimated Total Volume Pumped: 2100 ml Flow Cell Volume: 130 ml Final Flow Rate: 100 ml/min Final Draw Down: 4.42 ft	Instrument Used: Aqua TROLL 500 Serial Number: 625772
--	---	--

Test Notes:

Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth to Water	Flow
		+/- 0.1	+/- 0.5	+/- 3 %	+/- 10 %	+/- 10	+/- 10	+/- 5	
11/8/2022 4:33 PM	00:00	7.49 pH	19.07 °C	870.50 µS/cm	3.79 mg/L	0.00 NTU	76.2 mV	1,087.8 cm	100.00 ml/min
11/8/2022 4:36 PM	03:00	7.48 pH	18.83 °C	868.44 µS/cm	1.75 mg/L	0.00 NTU	-26.4 mV	1,087.8 cm	100.00 ml/min
11/8/2022 4:39 PM	06:00	7.60 pH	18.62 °C	905.68 µS/cm	1.67 mg/L	0.00 NTU	-45.6 mV	1,087.8 cm	100.00 ml/min
11/8/2022 4:42 PM	09:00	7.63 pH	18.65 °C	890.10 µS/cm	1.65 mg/L	0.44 NTU	-59.9 mV	1,087.8 cm	100.00 ml/min
11/8/2022 4:45 PM	12:00	7.58 pH	18.58 °C	875.76 µS/cm	1.65 mg/L	1.65 NTU	-75.5 mV	1,087.8 cm	100.00 ml/min
11/8/2022 4:48 PM	15:00	7.56 pH	18.73 °C	871.09 µS/cm	1.56 mg/L	4.07 NTU	-82.7 mV	1,087.8 cm	100.00 ml/min
11/8/2022 4:51 PM	18:00	7.54 pH	18.68 °C	864.91 µS/cm	1.47 mg/L	6.65 NTU	-87.1 mV	1,087.8 cm	100.00 ml/min
11/8/2022 4:54 PM	21:00	7.54 pH	18.92 °C	863.49 µS/cm	1.42 mg/L	8.23 NTU	-88.1 mV	1,087.8 cm	100.00 ml/min

Samples

Sample ID:	Description:
------------	--------------

Low-Flow Test Report:

Test Date / Time: 11/8/2022 2:21:18 PM

Project: AB Brown (12)

Operator Name: Hayley Torres

Location Name: CCR-AP-2R Well Diameter: 2 in Casing Type: PVC Screen Length: 10 ft Top of Screen: 43.3 ft Total Depth: 53.3 ft	Pump Type: Dedicated Tubing Type: LDPE Pump Intake From TOC: 48.3 ft Estimated Total Volume Pumped: 9900 ml Flow Cell Volume: 130 ml Final Flow Rate: 100 ml/min Final Draw Down: 0.11 ft	Instrument Used: Aqua TROLL 500 Serial Number: 625772
---	--	--

Test Notes:

Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth to Water	Flow
		+/- 0.1	+/- 0.5	+/- 3 %	+/- 10 %	+/- 10	+/- 10	+/- 5	
11/8/2022 2:21 PM	00:00	6.76 pH	19.16 °C	2,740.3 µS/cm	2.56 mg/L	334.76 NTU	91.1 mV		100.00 ml/min
11/8/2022 2:24 PM	03:00	6.74 pH	18.70 °C	1,903.5 µS/cm	1.21 mg/L	2,136.5 NTU	81.8 mV		100.00 ml/min
11/8/2022 2:27 PM	06:00	6.73 pH	18.45 °C	1,779.5 µS/cm	0.63 mg/L	2,475.6 NTU	79.4 mV		100.00 ml/min
11/8/2022 2:30 PM	09:00	6.73 pH	18.45 °C	1,730.7 µS/cm	0.46 mg/L	6,335.5 NTU	78.0 mV		100.00 ml/min
11/8/2022 2:33 PM	12:00	6.74 pH	18.36 °C	1,726.7 µS/cm	1.11 mg/L	30.94 NTU	78.5 mV		100.00 ml/min
11/8/2022 2:36 PM	15:00	6.71 pH	18.23 °C	1,718.8 µS/cm	0.41 mg/L	95.84 NTU	78.4 mV		100.00 ml/min
11/8/2022 2:39 PM	18:00	6.71 pH	18.24 °C	1,716.4 µS/cm	0.34 mg/L	128.34 NTU	78.0 mV		100.00 ml/min
11/8/2022 2:42 PM	21:00	6.71 pH	18.16 °C	1,714.9 µS/cm	0.31 mg/L	134.50 NTU	77.8 mV		100.00 ml/min
11/8/2022 2:45 PM	24:00	6.71 pH	18.21 °C	1,713.6 µS/cm	0.32 mg/L	152.02 NTU	77.7 mV		100.00 ml/min
11/8/2022 2:48 PM	27:00	6.71 pH	18.20 °C	1,714.7 µS/cm	0.34 mg/L	171.83 NTU	77.5 mV		100.00 ml/min
11/8/2022 2:51 PM	30:00	6.69 pH	18.22 °C	1,761.2 µS/cm	0.34 mg/L	169.16 NTU	79.7 mV		100.00 ml/min
11/8/2022 2:54 PM	33:00	6.69 pH	18.22 °C	2,081.0 µS/cm	0.33 mg/L	158.15 NTU	88.3 mV		100.00 ml/min
11/8/2022 2:57 PM	36:00	6.69 pH	18.26 °C	2,468.0 µS/cm	0.37 mg/L	156.94 NTU	95.1 mV		100.00 ml/min
11/8/2022 3:00 PM	39:00	6.72 pH	18.26 °C	2,861.5 µS/cm	0.84 mg/L	159.67 NTU	98.7 mV		100.00 ml/min
11/8/2022 3:03 PM	42:00	6.71 pH	18.24 °C	3,089.9 µS/cm	0.58 mg/L	505.92 NTU	102.9 mV		100.00 ml/min

11/8/2022 3:06 PM	45:00	6.72 pH	18.22 °C	3,279.0 µS/cm	0.53 mg/L	527.25 NTU	105.2 mV		100.00 ml/min
11/8/2022 3:09 PM	48:00	6.73 pH	18.22 °C	3,424.8 µS/cm	1.54 mg/L	310.95 NTU	106.6 mV		100.00 ml/min
11/8/2022 3:12 PM	51:00	6.73 pH	18.15 °C	3,529.2 µS/cm	0.60 mg/L	980.32 NTU	108.1 mV		100.00 ml/min
11/8/2022 3:15 PM	54:00	6.74 pH	18.11 °C	3,643.5 µS/cm	0.60 mg/L	954.52 NTU	109.5 mV		100.00 ml/min
11/8/2022 3:18 PM	57:00	6.74 pH	18.14 °C	3,720.5 µS/cm	0.61 mg/L	945.75 NTU	110.3 mV		100.00 ml/min
11/8/2022 3:21 PM	01:00:00	6.74 pH	18.11 °C	3,810.7 µS/cm	0.61 mg/L	948.80 NTU	111.3 mV		100.00 ml/min
11/8/2022 3:24 PM	01:03:00	6.75 pH	18.14 °C	3,873.8 µS/cm	0.62 mg/L	933.65 NTU	111.9 mV		100.00 ml/min
11/8/2022 3:27 PM	01:06:00	6.75 pH	18.09 °C	3,946.1 µS/cm	0.61 mg/L	933.74 NTU	112.7 mV		100.00 ml/min
11/8/2022 3:30 PM	01:09:00	6.75 pH	18.11 °C	3,993.7 µS/cm	0.63 mg/L	940.19 NTU	113.2 mV		100.00 ml/min
11/8/2022 3:33 PM	01:12:00	6.76 pH	18.09 °C	4,052.6 µS/cm	0.63 mg/L	904.40 NTU	113.7 mV		100.00 ml/min
11/8/2022 3:36 PM	01:15:00	6.76 pH	18.14 °C	4,096.3 µS/cm	0.63 mg/L	974.01 NTU	114.1 mV		100.00 ml/min
11/8/2022 3:39 PM	01:18:00	6.76 pH	18.14 °C	4,137.9 µS/cm	0.64 mg/L	865.28 NTU	114.5 mV		100.00 ml/min
11/8/2022 3:42 PM	01:21:00	6.76 pH	18.16 °C	4,185.0 µS/cm	0.62 mg/L	865.67 NTU	114.8 mV		100.00 ml/min
11/8/2022 3:45 PM	01:24:00	6.77 pH	18.16 °C	4,222.2 µS/cm	0.62 mg/L	849.54 NTU	115.2 mV		100.00 ml/min
11/8/2022 3:48 PM	01:27:00	6.77 pH	18.17 °C	4,250.7 µS/cm	0.62 mg/L	841.88 NTU	115.5 mV		100.00 ml/min
11/8/2022 3:51 PM	01:30:00	6.79 pH	18.18 °C	4,283.7 µS/cm	0.99 mg/L	0.12 NTU	114.5 mV		100.00 ml/min
11/8/2022 3:54 PM	01:33:00	6.78 pH	18.15 °C	4,312.2 µS/cm	0.64 mg/L	0.02 NTU	115.5 mV		100.00 ml/min
11/8/2022 3:57 PM	01:36:00	6.78 pH	18.13 °C	4,335.3 µS/cm	0.64 mg/L	0.00 NTU	115.8 mV		100.00 ml/min
11/8/2022 4:00 PM	01:39:00	6.78 pH	18.13 °C	4,361.5 µS/cm	0.65 mg/L	0.28 NTU	116.1 mV		100.00 ml/min

Samples

Sample ID:	Description:

Low-Flow Test Report:

Test Date / Time: 11/9/2022 10:21:14 AM

Project: AB Brown (14)

Operator Name: Hayley Torres

Location Name: CCR-AP-3R Well Diameter: 2 in Casing Type: PVC Screen Length: 10 ft Top of Screen: 37 ft Total Depth: 47 ft Initial Depth to Water: 38.21 ft	Pump Type: Dedicated Tubing Type: LDPE Pump Intake From TOC: 42 ft Estimated Total Volume Pumped: 3000 ml Flow Cell Volume: 130 ml Final Flow Rate: 100 ml/min Final Draw Down: 0.01 ft	Instrument Used: Aqua TROLL 500 Serial Number: 625772
--	---	--

Test Notes:

Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth to Water	Flow
		+/- 0.1	+/- 0.5	+/- 3 %	+/- 10 %	+/- 10	+/- 10	+/- 5	
11/9/2022 10:21 AM	00:00	6.94 pH	19.02 °C	5,213.4 µS/cm	2.80 mg/L	0.25 NTU	106.2 mV	1,164.6 cm	100.00 ml/min
11/9/2022 10:24 AM	03:00	6.90 pH	19.38 °C	6,137.4 µS/cm	1.26 mg/L	0.01 NTU	99.8 mV	1,164.6 cm	100.00 ml/min
11/9/2022 10:27 AM	06:00	6.88 pH	19.50 °C	6,272.9 µS/cm	0.81 mg/L	0.00 NTU	95.4 mV	1,164.6 cm	100.00 ml/min
11/9/2022 10:30 AM	09:00	6.87 pH	20.07 °C	6,283.8 µS/cm	0.92 mg/L	0.00 NTU	92.0 mV	1,164.6 cm	100.00 ml/min
11/9/2022 10:33 AM	12:00	6.86 pH	20.26 °C	6,292.9 µS/cm	0.92 mg/L	0.09 NTU	89.7 mV	1,164.6 cm	100.00 ml/min
11/9/2022 10:36 AM	15:00	6.86 pH	20.48 °C	6,294.9 µS/cm	0.88 mg/L	0.19 NTU	88.4 mV	1,164.6 cm	100.00 ml/min
11/9/2022 10:39 AM	18:00	6.86 pH	20.47 °C	6,286.3 µS/cm	0.82 mg/L	0.21 NTU	87.4 mV	1,164.6 cm	100.00 ml/min
11/9/2022 10:42 AM	21:00	6.86 pH	20.81 °C	6,290.1 µS/cm	0.75 mg/L	0.29 NTU	86.5 mV	1,164.6 cm	100.00 ml/min
11/9/2022 10:45 AM	24:00	6.86 pH	20.61 °C	6,278.5 µS/cm	0.72 mg/L	0.36 NTU	85.8 mV	1,164.6 cm	100.00 ml/min
11/9/2022 10:48 AM	27:00	6.86 pH	21.01 °C	6,289.3 µS/cm	0.66 mg/L	0.47 NTU	85.1 mV	1,164.6 cm	100.00 ml/min
11/9/2022 10:51 AM	30:00	6.86 pH	20.87 °C	6,276.6 µS/cm	0.65 mg/L	0.52 NTU	84.6 mV	1,164.6 cm	100.00 ml/min

Samples

Sample ID:	Description:
------------	--------------

Low-Flow Test Report:

Test Date / Time: 11/2/2022 2:03:13 PM

Project: AB BROWN (2)

Operator Name: Jon Hill

Location Name: CCR-AP-4R Well Diameter: 2 in Casing Type: PVC Screen Length: 10 ft Top of Screen: 38 ft Total Depth: 48 ft Initial Depth to Water: 35.2 ft	Pump Type: Dedicated Tubing Type: LDPE Pump Intake From TOC: 43 ft Estimated Total Volume Pumped: 6000 ml Flow Cell Volume: 130 ml Final Flow Rate: 200 ml/min Final Draw Down: 0 ft	Instrument Used: Aqua TROLL 500 Serial Number: 745345
---	---	--

Test Notes:

1.5 gallons purged

Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth to Water	Flow
		+/- 0.1	+/- 0.5	+/- 3 %	+/- 10 %	+/- 10	+/- 10	+/- 5	
11/2/2022 2:03 PM	00:00	7.49 pH	14.70 °C	988.14 µS/cm	7.40 mg/L	126.58 NTU	-16.0 mV	1,072.9 cm	200.00 ml/min
11/2/2022 2:06 PM	03:00	7.50 pH	14.06 °C	987.87 µS/cm	7.23 mg/L	123.55 NTU	-7.5 mV	1,072.9 cm	200.00 ml/min
11/2/2022 2:09 PM	06:00	7.51 pH	14.09 °C	991.89 µS/cm	7.00 mg/L	76.74 NTU	-1.2 mV	1,072.9 cm	200.00 ml/min
11/2/2022 2:12 PM	09:00	7.63 pH	14.03 °C	978.74 µS/cm	6.92 mg/L	121.53 NTU	-2.3 mV	1,072.9 cm	200.00 ml/min
11/2/2022 2:15 PM	12:00	7.67 pH	14.13 °C	972.94 µS/cm	6.79 mg/L	122.65 NTU	0.1 mV	1,072.9 cm	200.00 ml/min
11/2/2022 2:18 PM	15:00	7.71 pH	14.02 °C	985.96 µS/cm	7.01 mg/L	40.70 NTU	2.0 mV	1,072.9 cm	200.00 ml/min
11/2/2022 2:21 PM	18:00	7.72 pH	14.15 °C	981.81 µS/cm	6.78 mg/L	31.88 NTU	4.4 mV	1,072.9 cm	200.00 ml/min
11/2/2022 2:24 PM	21:00	7.72 pH	14.02 °C	988.20 µS/cm	6.67 mg/L	32.20 NTU	6.7 mV	1,072.9 cm	200.00 ml/min
11/2/2022 2:27 PM	24:00	7.72 pH	14.08 °C	989.04 µS/cm	6.65 mg/L	53.23 NTU	9.3 mV	1,072.9 cm	200.00 ml/min
11/2/2022 2:30 PM	27:00	7.72 pH	14.08 °C	994.28 µS/cm	6.62 mg/L	53.04 NTU	11.1 mV	1,072.9 cm	200.00 ml/min
11/2/2022 2:33 PM	30:00	7.57 pH	14.09 °C	1,011.2 µS/cm	6.93 mg/L	13.04 NTU	13.5 mV	1,072.9 cm	200.00 ml/min

Samples

Sample ID:	Description:
------------	--------------

Low-Flow Test Report:

Test Date / Time: 11/3/2022 2:52:46 PM

Project: AB BROWN (8)

Operator Name: Jon Hill

Location Name: CCR-AP5R Well Diameter: 2 in Casing Type: PVC Screen Length: 10 ft Top of Screen: 35 ft Total Depth: 45 ft Initial Depth to Water: 36.1 ft	Pump Type: Dedicated Tubing Type: LDPE Pump Intake From TOC: 40 ft Estimated Total Volume Pumped: 3600 ml Flow Cell Volume: 130 ml Final Flow Rate: 200 ml/min Final Draw Down: 0 ft	Instrument Used: Aqua TROLL 500 Serial Number: 745345
---	---	--

Test Notes:

1.0 gallons purged

Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth to Water	Flow
		+/- 0.1	+/- 0.5	+/- 3 %	+/- 10 %	+/- 10	+/- 10	+/- 5	
11/3/2022 2:52 PM	00:00	7.35 pH	16.89 °C	7,527.8 µS/cm	1.00 mg/L	6.11 NTU	51.2 mV	1,100.3 cm	200.00 ml/min
11/3/2022 2:55 PM	03:00	7.34 pH	16.81 °C	7,559.1 µS/cm	0.35 mg/L	7.89 NTU	51.9 mV	1,100.3 cm	200.00 ml/min
11/3/2022 2:58 PM	06:00	7.28 pH	16.72 °C	7,565.1 µS/cm	0.26 mg/L	7.78 NTU	49.1 mV	1,100.3 cm	200.00 ml/min
11/3/2022 3:01 PM	09:00	7.29 pH	16.80 °C	7,393.2 µS/cm	0.21 mg/L	10.28 NTU	44.0 mV	1,100.3 cm	200.00 ml/min
11/3/2022 3:04 PM	12:00	7.26 pH	16.77 °C	7,285.1 µS/cm	0.19 mg/L	12.09 NTU	37.5 mV	1,100.3 cm	200.00 ml/min
11/3/2022 3:07 PM	15:00	7.28 pH	16.82 °C	7,187.7 µS/cm	0.18 mg/L	9.77 NTU	35.4 mV	1,100.3 cm	200.00 ml/min
11/3/2022 3:10 PM	18:00	7.26 pH	16.74 °C	7,119.1 µS/cm	0.17 mg/L	9.62 NTU	36.8 mV	1,100.3 cm	200.00 ml/min

Samples

Sample ID:	Description:
------------	--------------

Low-Flow Test Report:

Test Date / Time: 11/3/2022 2:00:13 PM

Project: AB BROWN (7)

Operator Name: Jon Hill

Location Name: CCR-AP-7R Well Diameter: 2 in Casing Type: PVC Screen Length: 10 ft Top of Screen: 43.5 ft Total Depth: 53.5 ft Initial Depth to Water: 35.95 ft	Pump Type: Dedicated Tubing Type: LDPE Pump Intake From TOC: 49 ft Estimated Total Volume Pumped: 4800 ml Flow Cell Volume: 130 ml Final Flow Rate: 200 ml/min Final Draw Down: 0 ft	Instrument Used: Aqua TROLL 500 Serial Number: 745345
---	---	--

Test Notes:

1.25 gallons purged

Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth to Water	Flow
		+/- 0.1	+/- 0.5	+/- 3 %	+/- 10 %	+/- 10	+/- 10	+/- 5	
11/3/2022 2:00 PM	00:00	6.64 pH	14.37 °C	5,739.8 µS/cm	7.49 mg/L	126.51 NTU	25.1 mV	1,095.8 cm	200.00 ml/min
11/3/2022 2:03 PM	03:00	6.60 pH	14.39 °C	5,740.9 µS/cm	7.39 mg/L	327.69 NTU	32.7 mV	1,095.8 cm	200.00 ml/min
11/3/2022 2:06 PM	06:00	6.60 pH	14.28 °C	5,734.7 µS/cm	7.58 mg/L	308.06 NTU	36.9 mV	1,095.8 cm	200.00 ml/min
11/3/2022 2:09 PM	09:00	6.60 pH	14.34 °C	5,738.8 µS/cm	7.70 mg/L	89.24 NTU	40.7 mV	1,095.8 cm	200.00 ml/min
11/3/2022 2:12 PM	12:00	6.61 pH	14.28 °C	5,773.3 µS/cm	7.64 mg/L	212.96 NTU	43.3 mV	1,095.8 cm	200.00 ml/min
11/3/2022 2:15 PM	15:00	6.60 pH	14.36 °C	5,750.5 µS/cm	7.51 mg/L	108.12 NTU	46.1 mV	1,095.8 cm	200.00 ml/min
11/3/2022 2:18 PM	18:00	6.62 pH	14.33 °C	5,751.5 µS/cm	7.79 mg/L	28.91 NTU	47.7 mV	1,095.8 cm	200.00 ml/min
11/3/2022 2:21 PM	21:00	6.76 pH	14.37 °C	5,724.0 µS/cm	7.74 mg/L	63.79 NTU	50.5 mV	1,095.8 cm	200.00 ml/min
11/3/2022 2:24 PM	24:00	6.74 pH	14.44 °C	5,758.1 µS/cm	8.43 mg/L	24.74 NTU	49.8 mV	1,095.8 cm	200.00 ml/min

Samples

Sample ID:	Description:

Low-Flow Test Report:

Test Date / Time: 11/3/2022 10:36:40 AM

Project: AB BROWN (5)

Operator Name: Jon Hill

Location Name: CCR-AP-9 Well Diameter: 2 in Casing Type: PVC Screen Length: 10 ft Top of Screen: 25.2 ft Total Depth: 35.2 ft Initial Depth to Water: 8.88 ft	Pump Type: Dedicated Tubing Type: LDPE Pump Intake From TOC: 31 ft Estimated Total Volume Pumped: 4200 ml Flow Cell Volume: 130 ml Final Flow Rate: 200 ml/min Final Draw Down: 0 ft	Instrument Used: Aqua TROLL 500 Serial Number: 745345
---	---	--

Test Notes:

1.0 gallons purged

Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth to Water	Flow
		+/- 0.1	+/- 0.5	+/- 3 %	+/- 10 %	+/- 10	+/- 10	+/- 5	
11/3/2022 10:36 AM	00:00	7.27 pH	18.58 °C	9,521.5 µS/cm	0.71 mg/L	49.31 NTU	-7.0 mV	270.66 cm	200.00 ml/min
11/3/2022 10:39 AM	03:00	7.38 pH	18.67 °C	9,364.8 µS/cm	0.14 mg/L	18.98 NTU	-54.4 mV	270.66 cm	200.00 ml/min
11/3/2022 10:42 AM	06:00	7.37 pH	18.77 °C	9,397.3 µS/cm	0.02 mg/L	14.79 NTU	-78.5 mV	270.66 cm	200.00 ml/min
11/3/2022 10:45 AM	09:00	7.33 pH	18.81 °C	9,475.6 µS/cm	0.00 mg/L	8.87 NTU	-89.9 mV	270.66 cm	200.00 ml/min
11/3/2022 10:48 AM	12:00	7.35 pH	18.87 °C	9,590.4 µS/cm	0.00 mg/L	9.14 NTU	-100.4 mV	270.66 cm	200.00 ml/min
11/3/2022 10:51 AM	15:00	7.30 pH	18.86 °C	9,687.8 µS/cm	0.00 mg/L	7.14 NTU	-103.9 mV	270.66 cm	200.00 ml/min
11/3/2022 10:54 AM	18:00	7.33 pH	18.83 °C	9,843.4 µS/cm	0.00 mg/L	7.37 NTU	-111.1 mV	270.66 cm	200.00 ml/min
11/3/2022 10:57 AM	21:00	7.29 pH	18.78 °C	9,921.7 µS/cm	0.00 mg/L	7.98 NTU	-113.5 mV	270.66 cm	200.00 ml/min

Samples

Sample ID:	Description:
------------	--------------

Low-Flow Test Report:

Test Date / Time: 11/2/2022 2:55:53 PM

Project: AB BROWN (3)

Operator Name: Jon Hill

Location Name: CCR-AP-10 Well Diameter: 2 in Casing Type: PVC Screen Length: 10 ft Top of Screen: 33.2 ft Total Depth: 43.2 ft Initial Depth to Water: 37.2 ft	Pump Type: Dedicated Tubing Type: LDPE Pump Intake From TOC: 38 ft Estimated Total Volume Pumped: 8793.333 ml Flow Cell Volume: 130 ml Final Flow Rate: 200 ml/min Final Draw Down: 0 ft	Instrument Used: Aqua TROLL 500 Serial Number: 745345
---	---	--

Test Notes:

2.5 gallons purged

Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth to Water	Flow
		+/- 0.1	+/- 0.5	+/- 3 %	+/- 10 %	+/- 10	+/- 10	+/- 5	
11/2/2022 2:55 PM	00:00	7.65 pH	15.43 °C	4,038.7 µS/cm	1.43 mg/L	138.21 NTU	81.2 mV	1,133.9 cm	200.00 ml/min
11/2/2022 2:58 PM	03:00	7.64 pH	15.47 °C	3,787.9 µS/cm	1.00 mg/L	343.09 NTU	69.0 mV	1,133.9 cm	200.00 ml/min
11/2/2022 3:01 PM	06:00	7.67 pH	14.00 °C	3,678.6 µS/cm	1.53 mg/L	363.25 NTU	62.5 mV	1,133.9 cm	200.00 ml/min
11/2/2022 3:04 PM	09:00	7.54 pH	14.04 °C	3,540.6 µS/cm	1.31 mg/L	824.16 NTU	53.9 mV	1,133.9 cm	200.00 ml/min
11/2/2022 3:07 PM	12:00	7.57 pH	14.24 °C	3,651.5 µS/cm	0.89 mg/L	1,596.7 NTU	50.3 mV	1,133.9 cm	200.00 ml/min
11/2/2022 3:10 PM	15:00	7.58 pH	14.12 °C	3,605.3 µS/cm	0.66 mg/L	298.27 NTU	46.9 mV	1,133.9 cm	200.00 ml/min
11/2/2022 3:13 PM	18:00	7.59 pH	14.13 °C	3,596.3 µS/cm	0.76 mg/L	372.12 NTU	43.9 mV	1,133.9 cm	200.00 ml/min
11/2/2022 3:15 PM	19:58	7.59 pH	14.07 °C	3,200.1 µS/cm	0.78 mg/L	230.36 NTU	43.1 mV	1,133.9 cm	200.00 ml/min
11/2/2022 3:18 PM	22:58	7.60 pH	14.10 °C	3,600.0 µS/cm	0.76 mg/L	258.09 NTU	41.4 mV	1,133.9 cm	200.00 ml/min
11/2/2022 3:21 PM	25:58	7.58 pH	14.04 °C	3,599.9 µS/cm	0.65 mg/L	208.53 NTU	40.5 mV	1,133.9 cm	200.00 ml/min
11/2/2022 3:24 PM	28:58	7.59 pH	14.14 °C	3,591.4 µS/cm	0.66 mg/L	162.14 NTU	39.2 mV	1,133.9 cm	200.00 ml/min
11/2/2022 3:27 PM	31:58	7.57 pH	14.08 °C	3,591.0 µS/cm	0.71 mg/L	111.16 NTU	39.0 mV	1,133.9 cm	200.00 ml/min
11/2/2022 3:30 PM	34:58	7.58 pH	14.16 °C	3,588.5 µS/cm	0.66 mg/L	86.72 NTU	37.7 mV	1,133.9 cm	200.00 ml/min
11/2/2022 3:33 PM	37:58	7.57 pH	14.09 °C	3,583.5 µS/cm	0.63 mg/L	99.45 NTU	37.7 mV	1,133.9 cm	200.00 ml/min
11/2/2022 3:36 PM	40:58	7.58 pH	14.17 °C	3,581.5 µS/cm	0.61 mg/L	114.47 NTU	36.2 mV	1,133.9 cm	200.00 ml/min

11/2/2022 3:39 PM	43:58	7.57 pH	14.17 °C	3,588.6 µS/cm	0.63 mg/L	91.45 NTU	36.1 mV	1,133.9 cm	200.00 ml/min
----------------------	-------	---------	----------	------------------	-----------	-----------	---------	------------	---------------

Samples

Sample ID:	Description:

Created using VuSitu from In-Situ, Inc.

Low-Flow Test Report:

Test Date / Time: 11/3/2022 8:56:17 AM

Project: AB BROWN (4)

Operator Name: Jon Hill

Location Name: CCR-AP-11 Well Diameter: 2 in Casing Type: PVC Screen Length: 10 ft Top of Screen: 16 ft Total Depth: 26 ft Initial Depth to Water: 15.03 ft	Pump Type: Dedicated Tubing Type: LDPE Pump Intake From TOC: 21 ft Estimated Total Volume Pumped: 13800 ml Flow Cell Volume: 130 ml Final Flow Rate: 200 ml/min Final Draw Down: 0 ft	Instrument Used: Aqua TROLL 500 Serial Number: 745345
--	--	--

Test Notes:

3.0 gallons purged

Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth to Water	Flow
		+/- 0.1	+/- 0.5	+/- 3 %	+/- 10 %	+/- 10	+/- 10	+/- 5	
11/3/2022 8:56 AM	00:00	7.36 pH	15.98 °C	952.27 µS/cm	1.23 mg/L	1,106.4 NTU	51.7 mV	458.11 cm	200.00 ml/min
11/3/2022 8:59 AM	03:00	7.31 pH	16.41 °C	946.15 µS/cm	1.27 mg/L	592.68 NTU	46.8 mV	458.11 cm	200.00 ml/min
11/3/2022 9:02 AM	06:00	7.32 pH	16.55 °C	946.35 µS/cm	1.25 mg/L	534.24 NTU	42.2 mV	458.11 cm	200.00 ml/min
11/3/2022 9:05 AM	09:00	7.28 pH	16.71 °C	941.12 µS/cm	1.98 mg/L	491.98 NTU	38.6 mV	458.11 cm	200.00 ml/min
11/3/2022 9:08 AM	12:00	7.29 pH	16.69 °C	943.72 µS/cm	1.53 mg/L	615.41 NTU	37.5 mV	458.11 cm	200.00 ml/min
11/3/2022 9:11 AM	15:00	7.25 pH	16.82 °C	943.77 µS/cm	1.22 mg/L	697.71 NTU	38.7 mV	458.11 cm	200.00 ml/min
11/3/2022 9:14 AM	18:00	7.26 pH	16.81 °C	943.89 µS/cm	1.53 mg/L	951.99 NTU	36.9 mV	458.11 cm	200.00 ml/min
11/3/2022 9:17 AM	21:00	7.24 pH	16.84 °C	942.82 µS/cm	1.31 mg/L	1,165.3 NTU	37.0 mV	458.11 cm	200.00 ml/min
11/3/2022 9:20 AM	24:00	7.15 pH	16.81 °C	945.35 µS/cm	1.26 mg/L	1,468.9 NTU	42.2 mV	458.11 cm	200.00 ml/min
11/3/2022 9:23 AM	27:00	7.24 pH	16.82 °C	944.02 µS/cm	1.37 mg/L	1,422.8 NTU	36.3 mV	458.11 cm	200.00 ml/min
11/3/2022 9:26 AM	30:00	7.16 pH	16.80 °C	944.75 µS/cm	1.52 mg/L	1,775.2 NTU	40.7 mV	458.11 cm	200.00 ml/min
11/3/2022 9:29 AM	33:00	7.24 pH	16.84 °C	942.61 µS/cm	1.58 mg/L	1,568.2 NTU	35.3 mV	458.11 cm	200.00 ml/min
11/3/2022 9:32 AM	36:00	7.22 pH	16.77 °C	927.64 µS/cm	2.19 mg/L	2,015.7 NTU	37.4 mV	458.11 cm	200.00 ml/min
11/3/2022 9:35 AM	39:00	7.27 pH	16.81 °C	901.05 µS/cm	1.99 mg/L	1,726.1 NTU	33.5 mV	458.11 cm	200.00 ml/min
11/3/2022 9:38 AM	42:00	7.23 pH	16.84 °C	916.89 µS/cm	2.02 mg/L	1,357.6 NTU	35.7 mV	458.11 cm	200.00 ml/min

11/3/2022 9:41 AM	45:00	7.27 pH	16.82 °C	873.35 µS/cm	2.11 mg/L	871.07 NTU	33.3 mV	458.11 cm	200.00 ml/min
11/3/2022 9:44 AM	48:00	7.23 pH	16.80 °C	887.73 µS/cm	2.17 mg/L	506.41 NTU	36.4 mV	458.11 cm	200.00 ml/min
11/3/2022 9:47 AM	51:00	7.29 pH	16.78 °C	882.21 µS/cm	2.29 mg/L	377.60 NTU	32.9 mV	458.11 cm	200.00 ml/min
11/3/2022 9:50 AM	54:00	7.24 pH	16.79 °C	891.50 µS/cm	2.43 mg/L	311.30 NTU	36.3 mV	458.11 cm	200.00 ml/min
11/3/2022 9:53 AM	57:00	7.28 pH	16.74 °C	834.80 µS/cm	2.24 mg/L	180.25 NTU	33.6 mV	458.11 cm	200.00 ml/min
11/3/2022 9:56 AM	01:00:00	7.27 pH	16.78 °C	932.31 µS/cm	2.40 mg/L	131.26 NTU	35.0 mV	458.11 cm	200.00 ml/min
11/3/2022 9:59 AM	01:03:00	7.31 pH	16.74 °C	928.00 µS/cm	2.39 mg/L	111.93 NTU	32.7 mV	458.11 cm	200.00 ml/min
11/3/2022 10:02 AM	01:06:00	7.25 pH	16.77 °C	940.15 µS/cm	2.41 mg/L	93.52 NTU	36.2 mV	458.11 cm	200.00 ml/min
11/3/2022 10:05 AM	01:09:00	7.31 pH	16.75 °C	918.81 µS/cm	2.51 mg/L	96.97 NTU	33.0 mV	458.11 cm	200.00 ml/min

Samples

Sample ID:	Description:

Created using VuSitu from In-Situ, Inc.

Low-Flow Test Report:

Test Date / Time: 11/2/2022 2:07:42 PM

Project: AB Brown

Operator Name: Hayley Torres

Location Name: CCR-LF-1 Well Diameter: 2 in Casing Type: Pvc Screen Length: 10 ft Top of Screen: 9 ft Total Depth: 19 ft	Pump Type: Dedicated Tubing Type: LDPE Pump Intake From TOC: 14 ft Estimated Total Volume Pumped: 2200 ml Flow Cell Volume: 130 ml Final Flow Rate: 100 ml/min Final Draw Down: 1.2 ft	Instrument Used: Aqua TROLL 500 Serial Number: 625772
---	--	--

Test Notes:

Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth to Water	Flow
		+/- 0.1	+/- 0.5	+/- 3 %	+/- 10 %	+/- 10	+/- 10	+/- 5	
11/2/2022 2:07 PM	00:00	6.31 pH	19.51 °C	1,601.0 µS/cm	2.17 mg/L	25.73 NTU	-0.9 mV		100.00 ml/min
11/2/2022 2:11 PM	03:29	6.32 pH	19.73 °C	1,597.2 µS/cm	1.73 mg/L	8.57 NTU	6.6 mV		100.00 ml/min
11/2/2022 2:14 PM	06:51	6.31 pH	19.98 °C	1,588.0 µS/cm	1.63 mg/L	4.20 NTU	8.7 mV		100.00 ml/min
11/2/2022 2:15 PM	07:46	6.31 pH	19.82 °C	1,593.9 µS/cm	1.62 mg/L	3.54 NTU	10.4 mV		100.00 ml/min
11/2/2022 2:16 PM	08:29	6.31 pH	20.00 °C	1,595.8 µS/cm	1.59 mg/L	3.55 NTU	11.6 mV		100.00 ml/min
11/2/2022 2:19 PM	11:29	6.31 pH	19.87 °C	1,596.2 µS/cm	1.57 mg/L	2.53 NTU	16.2 mV		100.00 ml/min
11/2/2022 2:22 PM	14:29	6.31 pH	19.98 °C	1,594.5 µS/cm	1.52 mg/L	1.28 NTU	18.3 mV		100.00 ml/min
11/2/2022 2:25 PM	17:29	6.31 pH	19.80 °C	1,594.6 µS/cm	1.54 mg/L	0.72 NTU	24.4 mV		100.00 ml/min
11/2/2022 2:28 PM	20:29	6.31 pH	19.94 °C	1,588.2 µS/cm	1.52 mg/L	0.88 NTU	25.7 mV		100.00 ml/min
11/2/2022 2:31 PM	23:29	6.31 pH	19.92 °C	1,593.8 µS/cm	1.52 mg/L	1.03 NTU	30.6 mV		100.00 ml/min

Samples

Sample ID:	Description:
------------	--------------

Low-Flow Test Report:

Test Date / Time: 11/2/2022 3:06:47 PM

Project: AB Brown (2)

Operator Name: Hayley Torres

Location Name: CCR-LF-2 Well Diameter: 2 in Casing Type: Pvc Screen Length: 10 ft Top of Screen: 35 ft Total Depth: 45 ft Initial Depth to Water: 28.46 ft	Pump Type: Dedicated Tubing Type: LDPE Pump Intake From TOC: 40 ft Estimated Total Volume Pumped: 7200 ml Flow Cell Volume: 130 ml Final Flow Rate: 100 ml/min Final Draw Down: 0.1 in	Instrument Used: Aqua TROLL 500 Serial Number: 625772
---	--	--

Test Notes:

Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth to Water	Flow
		+/- 0.1	+/- 0.5	+/- 3 %	+/- 10 %	+/- 10	+/- 10	+/- 5	
11/2/2022 3:06 PM	00:00	6.56 pH	19.58 °C	16,525 µS/cm	5.25 mg/L	1.78 NTU	83.2 mV	867.46 cm	100.00 ml/min
11/2/2022 3:09 PM	03:00	6.35 pH	18.48 °C	18,153 µS/cm	2.00 mg/L	35.19 NTU	78.2 mV	867.46 cm	100.00 ml/min
11/2/2022 3:12 PM	06:00	6.33 pH	18.43 °C	17,342 µS/cm	1.05 mg/L	99.43 NTU	78.3 mV	867.46 cm	100.00 ml/min
11/2/2022 3:15 PM	09:00	6.32 pH	18.11 °C	16,676 µS/cm	0.79 mg/L	120.10 NTU	81.5 mV	867.46 cm	100.00 ml/min
11/2/2022 3:18 PM	12:00	6.32 pH	18.13 °C	16,244 µS/cm	0.61 mg/L	156.07 NTU	83.6 mV	867.46 cm	100.00 ml/min
11/2/2022 3:21 PM	15:00	6.32 pH	18.06 °C	16,184 µS/cm	0.50 mg/L	193.56 NTU	85.3 mV	867.46 cm	100.00 ml/min
11/2/2022 3:24 PM	18:00	6.31 pH	18.75 °C	16,146 µS/cm	0.43 mg/L	230.79 NTU	89.1 mV	867.46 cm	100.00 ml/min
11/2/2022 3:27 PM	21:00	6.31 pH	19.12 °C	16,172 µS/cm	0.43 mg/L	276.91 NTU	95.8 mV	867.46 cm	100.00 ml/min
11/2/2022 3:30 PM	24:00	6.30 pH	18.93 °C	16,204 µS/cm	0.44 mg/L	386.13 NTU	100.7 mV	867.46 cm	100.00 ml/min
11/2/2022 3:33 PM	27:00	6.31 pH	18.69 °C	16,423 µS/cm	0.45 mg/L	353.96 NTU	103.7 mV	867.46 cm	100.00 ml/min
11/2/2022 3:36 PM	30:00	6.31 pH	18.54 °C	16,337 µS/cm	0.43 mg/L	429.94 NTU	106.0 mV	867.46 cm	100.00 ml/min
11/2/2022 3:39 PM	33:00	6.31 pH	18.53 °C	16,544 µS/cm	0.42 mg/L	550.86 NTU	108.6 mV	867.46 cm	100.00 ml/min
11/2/2022 3:42 PM	36:00	6.30 pH	19.10 °C	16,320 µS/cm	0.41 mg/L	605.34 NTU	113.6 mV	867.46 cm	100.00 ml/min
11/2/2022 3:45 PM	39:00	6.30 pH	20.15 °C	16,321 µS/cm	0.42 mg/L	631.20 NTU	116.9 mV	867.46 cm	100.00 ml/min
11/2/2022 3:48 PM	42:00	6.29 pH	20.82 °C	16,312 µS/cm	0.44 mg/L	836.69 NTU	119.8 mV	867.46 cm	100.00 ml/min

11/2/2022 3:51 PM	45:00	6.28 pH	21.16 °C	16,408 µS/cm	0.50 mg/L	900.56 NTU	122.6 mV	867.46 cm	100.00 ml/min
11/2/2022 3:54 PM	48:00	6.28 pH	21.52 °C	16,368 µS/cm	0.58 mg/L	929.26 NTU	124.9 mV	867.46 cm	100.00 ml/min
11/2/2022 3:57 PM	51:00	6.28 pH	20.73 °C	16,329 µS/cm	0.89 mg/L	518.22 NTU	126.3 mV	867.46 cm	100.00 ml/min
11/2/2022 4:00 PM	54:00	6.29 pH	18.38 °C	17,020 µS/cm	0.67 mg/L	861.54 NTU	129.0 mV	867.46 cm	100.00 ml/min
11/2/2022 4:03 PM	57:00	6.30 pH	17.88 °C	16,777 µS/cm	0.40 mg/L	144.20 NTU	128.0 mV	867.46 cm	100.00 ml/min
11/2/2022 4:06 PM	01:00:00	6.30 pH	17.64 °C	16,479 µS/cm	0.33 mg/L	239.45 NTU	128.0 mV	867.46 cm	100.00 ml/min
11/2/2022 4:09 PM	01:03:00	6.30 pH	17.51 °C	16,439 µS/cm	0.29 mg/L	226.62 NTU	128.2 mV	867.46 cm	100.00 ml/min
11/2/2022 4:12 PM	01:06:00	6.30 pH	17.51 °C	16,288 µS/cm	0.26 mg/L	58.64 NTU	128.3 mV	867.46 cm	100.00 ml/min
11/2/2022 4:15 PM	01:09:00	6.30 pH	17.43 °C	16,248 µS/cm	0.25 mg/L	144.51 NTU	129.5 mV	867.46 cm	100.00 ml/min
11/2/2022 4:18 PM	01:12:00	6.30 pH	17.47 °C	16,075 µS/cm	0.24 mg/L	171.58 NTU	131.3 mV	867.46 cm	100.00 ml/min
11/2/2022 4:21 PM	01:15:00	6.30 pH	17.33 °C	16,038 µS/cm	0.22 mg/L	111.80 NTU	131.5 mV	867.46 cm	100.00 ml/min

Samples

Sample ID:	Description:

Created using VuSitu from In-Situ, Inc.

Low-Flow Test Report:

Test Date / Time: 11/3/2022 11:27:09 AM

Project: AB Brown (4)

Operator Name: Hayley Torres

Location Name: CCR-LF-3 Well Diameter: 2 in Casing Type: PVC Screen Length: 10 ft Top of Screen: 25 ft Total Depth: 35 ft Initial Depth to Water: 31.06 ft	Pump Type: Dedicated Tubing Type: LDPE Pump Intake From TOC: 30 ft Estimated Total Volume Pumped: 1800 ml Flow Cell Volume: 130 ml Final Flow Rate: 100 ml/min Final Draw Down: 0 ft	Instrument Used: Aqua TROLL 500 Serial Number: 625772
---	---	--

Test Notes:

Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth to Water	Flow
		+/- 0.1	+/- 0.5	+/- 3 %	+/- 10 %	+/- 10	+/- 10	+/- 5	
11/3/2022 11:27 AM	00:00	6.94 pH	18.72 °C	1,830.2 µS/cm	8.89 mg/L	0.60 NTU	10.6 mV	946.71 cm	100.00 ml/min
11/3/2022 11:30 AM	03:00	6.60 pH	18.10 °C	1,700.7 µS/cm	7.02 mg/L	2.04 NTU	12.9 mV	946.71 cm	100.00 ml/min
11/3/2022 11:33 AM	06:00	6.55 pH	17.74 °C	1,704.6 µS/cm	6.80 mg/L	6.19 NTU	22.0 mV	946.71 cm	100.00 ml/min
11/3/2022 11:36 AM	09:00	6.54 pH	17.61 °C	1,683.9 µS/cm	6.68 mg/L	5.12 NTU	26.2 mV	946.71 cm	100.00 ml/min
11/3/2022 11:39 AM	12:00	6.54 pH	17.58 °C	1,685.4 µS/cm	6.65 mg/L	1.65 NTU	32.4 mV	946.71 cm	100.00 ml/min
11/3/2022 11:42 AM	15:00	6.53 pH	17.39 °C	1,681.1 µS/cm	6.66 mg/L	1.27 NTU	35.8 mV	946.71 cm	100.00 ml/min
11/3/2022 11:45 AM	18:00	6.54 pH	17.71 °C	1,676.2 µS/cm	6.71 mg/L	0.44 NTU	41.4 mV	946.71 cm	100.00 ml/min
11/3/2022 12:12 PM	45:41	7.09 pH	31.72 °C	0.51 µS/cm	7.53 mg/L	2.62 NTU	67.9 mV	946.71 cm	100.00 ml/min

Samples

Sample ID:	Description:
------------	--------------

Low-Flow Test Report:

Test Date / Time: 11/3/2022 9:52:07 AM

Project: AB Brown (3)

Operator Name: Hayley Torres

Location Name: CCR-LF-4 Well Diameter: 2 in Casing Type: PVC Screen Length: 10 ft Top of Screen: 45 ft Total Depth: 55 ft Initial Depth to Water: 48.16 ft	Pump Type: Dedicated Tubing Type: LDPE Pump Intake From TOC: 50 ft Estimated Total Volume Pumped: 3200 ml Flow Cell Volume: 130 ml Final Flow Rate: 100 ml/min Final Draw Down: 0.77 ft	Instrument Used: Aqua TROLL 500 Serial Number: 625772
---	--	--

Test Notes:

Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth to Water	Flow
		+/- 0.1	+/- 0.5	+/- 3 %	+/- 10 %	+/- 10	+/- 10	+/- 5	
11/3/2022 9:52 AM	00:00	6.49 pH	14.99 °C	9,916.0 µS/cm	5.13 mg/L	22.60 NTU	44.3 mV	1,467.9 cm	100.00 ml/min
11/3/2022 9:55 AM	03:00	6.41 pH	14.93 °C	10,361 µS/cm	2.71 mg/L	8.91 NTU	43.8 mV	1,467.9 cm	100.00 ml/min
11/3/2022 9:58 AM	06:00	6.39 pH	15.03 °C	10,477 µS/cm	1.45 mg/L	5.70 NTU	38.3 mV	1,467.9 cm	100.00 ml/min
11/3/2022 10:01 AM	09:00	6.38 pH	15.08 °C	10,492 µS/cm	0.94 mg/L	3.15 NTU	33.1 mV	1,467.9 cm	100.00 ml/min
11/3/2022 10:04 AM	12:00	6.37 pH	15.19 °C	10,480 µS/cm	0.70 mg/L	5.42 NTU	29.3 mV	1,467.9 cm	100.00 ml/min
11/3/2022 10:07 AM	15:00	6.37 pH	15.31 °C	10,455 µS/cm	0.59 mg/L	4.49 NTU	26.2 mV	1,467.9 cm	100.00 ml/min
11/3/2022 10:10 AM	18:00	6.37 pH	15.38 °C	10,433 µS/cm	0.54 mg/L	4.63 NTU	23.9 mV	1,467.9 cm	100.00 ml/min
11/3/2022 10:13 AM	21:00	6.36 pH	15.43 °C	10,414 µS/cm	0.49 mg/L	8.17 NTU	21.9 mV	1,467.9 cm	100.00 ml/min
11/3/2022 10:16 AM	24:00	6.36 pH	15.51 °C	10,411 µS/cm	0.45 mg/L	13.63 NTU	20.3 mV	1,467.9 cm	100.00 ml/min
11/3/2022 10:19 AM	27:00	6.36 pH	15.50 °C	10,395 µS/cm	0.42 mg/L	17.83 NTU	18.9 mV	1,467.9 cm	100.00 ml/min
11/3/2022 10:22 AM	30:00	6.36 pH	15.60 °C	10,385 µS/cm	0.39 mg/L	22.03 NTU	17.7 mV	1,467.9 cm	100.00 ml/min
11/3/2022 10:25 AM	33:00	6.36 pH	15.57 °C	10,382 µS/cm	0.37 mg/L	22.65 NTU	16.6 mV	1,467.9 cm	100.00 ml/min

Samples

Sample ID:	Description:
------------	--------------

Low-Flow Test Report:

Test Date / Time: 11/3/2022 1:01:13 PM

Project: AB Brown (5)

Operator Name: Hayley Torres

Location Name: CCR-LF-5 Well Diameter: 2 in Casing Type: PVC Screen Length: 10 ft Top of Screen: 20 ft Total Depth: 30 ft Initial Depth to Water: 22.26 ft	Pump Type: Dedicated Tubing Type: LDPE Pump Intake From TOC: 25 ft Estimated Total Volume Pumped: 8400 ml Flow Cell Volume: 130 ml Final Flow Rate: 100 ml/min Final Draw Down: 0.17 ft	Instrument Used: Aqua TROLL 500 Serial Number: 625772
---	--	--

Test Notes:

Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth to Water	Flow
		+/- 0.1	+/- 0.5	+/- 3 %	+/- 10 %	+/- 10	+/- 10	+/- 5	
11/3/2022 1:01 PM	00:00	6.82 pH	19.43 °C	3,421.1 µS/cm	5.43 mg/L	12.95 NTU	45.3 mV	678.48 cm	100.00 ml/min
11/3/2022 1:04 PM	03:00	6.73 pH	17.86 °C	3,111.7 µS/cm	2.07 mg/L	10.04 NTU	43.3 mV	678.48 cm	100.00 ml/min
11/3/2022 1:07 PM	06:00	6.72 pH	17.31 °C	2,996.9 µS/cm	1.21 mg/L	10.63 NTU	43.6 mV	678.48 cm	100.00 ml/min
11/3/2022 1:10 PM	09:00	6.71 pH	17.34 °C	2,945.9 µS/cm	0.85 mg/L	14.62 NTU	44.4 mV	678.48 cm	100.00 ml/min
11/3/2022 1:13 PM	12:00	6.70 pH	17.25 °C	2,921.3 µS/cm	0.63 mg/L	16.40 NTU	45.5 mV	678.48 cm	100.00 ml/min
11/3/2022 1:16 PM	15:00	6.70 pH	17.28 °C	2,922.2 µS/cm	0.49 mg/L	18.70 NTU	46.9 mV	678.48 cm	100.00 ml/min
11/3/2022 1:19 PM	18:00	6.69 pH	17.17 °C	2,938.7 µS/cm	0.39 mg/L	18.42 NTU	48.2 mV	678.48 cm	100.00 ml/min
11/3/2022 1:22 PM	21:00	6.69 pH	17.23 °C	2,947.5 µS/cm	0.33 mg/L	17.19 NTU	49.3 mV	678.48 cm	100.00 ml/min
11/3/2022 1:25 PM	24:00	6.69 pH	17.09 °C	2,967.6 µS/cm	0.29 mg/L	18.13 NTU	50.3 mV	678.48 cm	100.00 ml/min
11/3/2022 1:28 PM	27:00	6.69 pH	17.01 °C	2,982.7 µS/cm	0.26 mg/L	22.17 NTU	51.3 mV	678.48 cm	100.00 ml/min
11/3/2022 1:31 PM	30:00	6.68 pH	17.22 °C	3,028.8 µS/cm	0.24 mg/L	21.19 NTU	52.5 mV	678.48 cm	100.00 ml/min
11/3/2022 1:34 PM	33:00	6.68 pH	17.01 °C	3,089.1 µS/cm	0.24 mg/L	27.17 NTU	53.8 mV	678.48 cm	100.00 ml/min
11/3/2022 1:37 PM	36:00	6.68 pH	17.13 °C	3,133.5 µS/cm	0.23 mg/L	45.89 NTU	55.2 mV	678.48 cm	100.00 ml/min
11/3/2022 1:40 PM	39:00	6.68 pH	17.14 °C	3,206.6 µS/cm	0.21 mg/L	58.37 NTU	56.2 mV	678.48 cm	100.00 ml/min
11/3/2022 1:43 PM	42:00	6.69 pH	17.24 °C	3,256.0 µS/cm	0.20 mg/L	66.09 NTU	57.4 mV	678.48 cm	100.00 ml/min

11/3/2022 1:46 PM	45:00	6.68 pH	17.12 °C	3,316.7 µS/cm	0.19 mg/L	106.96 NTU	58.0 mV	678.48 cm	100.00 ml/min
11/3/2022 1:49 PM	48:00	6.68 pH	17.27 °C	3,342.2 µS/cm	0.18 mg/L	117.36 NTU	58.2 mV	678.48 cm	100.00 ml/min
11/3/2022 1:52 PM	51:00	6.67 pH	17.31 °C	3,370.9 µS/cm	0.17 mg/L	177.63 NTU	57.0 mV	678.48 cm	100.00 ml/min
11/3/2022 1:55 PM	54:00	6.67 pH	17.45 °C	3,409.0 µS/cm	0.16 mg/L	197.95 NTU	55.3 mV	678.48 cm	100.00 ml/min
11/3/2022 1:58 PM	57:00	6.67 pH	17.42 °C	3,447.1 µS/cm	0.16 mg/L	212.41 NTU	52.6 mV	678.48 cm	100.00 ml/min
11/3/2022 2:01 PM	01:00:00	6.66 pH	17.68 °C	3,485.3 µS/cm	0.16 mg/L	232.45 NTU	49.6 mV	678.48 cm	100.00 ml/min
11/3/2022 2:04 PM	01:03:00	6.67 pH	17.48 °C	3,504.3 µS/cm	1.37 mg/L	6.68 NTU	51.7 mV	678.48 cm	100.00 ml/min
11/3/2022 2:07 PM	01:06:00	6.66 pH	17.29 °C	3,505.7 µS/cm	0.49 mg/L	6.96 NTU	52.8 mV	678.48 cm	100.00 ml/min
11/3/2022 2:10 PM	01:09:00	6.65 pH	17.22 °C	3,548.3 µS/cm	0.21 mg/L	7.90 NTU	54.3 mV	678.48 cm	100.00 ml/min
11/3/2022 2:13 PM	01:12:00	6.65 pH	17.03 °C	3,573.8 µS/cm	0.16 mg/L	7.72 NTU	55.7 mV	678.48 cm	100.00 ml/min
11/3/2022 2:16 PM	01:15:00	6.64 pH	17.14 °C	3,598.7 µS/cm	0.14 mg/L	8.69 NTU	57.0 mV	678.48 cm	100.00 ml/min
11/3/2022 2:19 PM	01:18:00	6.64 pH	17.15 °C	3,620.7 µS/cm	0.13 mg/L	14.85 NTU	58.1 mV	678.48 cm	100.00 ml/min
11/3/2022 2:22 PM	01:21:00	6.64 pH	17.31 °C	3,640.2 µS/cm	0.12 mg/L	19.49 NTU	59.2 mV	678.48 cm	100.00 ml/min
11/3/2022 2:25 PM	01:24:00	6.63 pH	17.16 °C	3,670.4 µS/cm	0.12 mg/L	19.06 NTU	60.2 mV	678.48 cm	100.00 ml/min

Samples

Sample ID:	Description:

Created using VuSitu from In-Situ, Inc.

Low-Flow Test Report:

Test Date / Time: 11/3/2022 4:50:57 PM

Project: AB Brown (6)

Operator Name: Hayley Torres

Location Name: CCR-LF-6 Well Diameter: 2 in Casing Type: PVC Screen Length: 5 ft Top of Screen: 4.66 ft Total Depth: 9.66 ft Initial Depth to Water: 8.45 ft	Pump Type: Dedicated Tubing Type: LDPE Pump Intake From TOC: Estimated Total Volume Pumped: 3300 ml Flow Cell Volume: 130 ml Final Flow Rate: 100 ml/min Final Draw Down: 0.01 ft	Instrument Used: Aqua TROLL 500 Serial Number: 625772
---	--	--

Test Notes:

Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth to Water	Flow
		+/- 0.1	+/- 0.5	+/- 3 %	+/- 10 %	+/- 10	+/- 10	+/- 5	
11/3/2022 4:50 PM	00:00	7.19 pH	21.44 °C	1,206.6 µS/cm	6.87 mg/L	15.59 NTU	34.9 mV	257.56 cm	100.00 ml/min
11/3/2022 4:53 PM	03:00	6.91 pH	19.76 °C	880.99 µS/cm	2.87 mg/L	54.32 NTU	21.5 mV	257.56 cm	100.00 ml/min
11/3/2022 4:56 PM	06:00	6.84 pH	19.44 °C	828.83 µS/cm	1.79 mg/L	64.16 NTU	23.2 mV	257.56 cm	100.00 ml/min
11/3/2022 4:59 PM	09:00	6.80 pH	19.17 °C	810.63 µS/cm	1.39 mg/L	71.06 NTU	25.5 mV	257.56 cm	100.00 ml/min
11/3/2022 5:02 PM	12:00	6.77 pH	19.29 °C	805.92 µS/cm	1.16 mg/L	74.19 NTU	27.3 mV	257.56 cm	100.00 ml/min
11/3/2022 5:05 PM	15:00	6.74 pH	19.20 °C	808.95 µS/cm	1.03 mg/L	44.49 NTU	29.7 mV	257.56 cm	100.00 ml/min
11/3/2022 5:08 PM	18:00	6.73 pH	19.31 °C	809.79 µS/cm	0.94 mg/L	53.48 NTU	32.3 mV	257.56 cm	100.00 ml/min
11/3/2022 5:11 PM	21:00	6.71 pH	19.09 °C	811.51 µS/cm	0.85 mg/L	31.74 NTU	34.1 mV	257.56 cm	100.00 ml/min
11/3/2022 5:14 PM	24:00	6.70 pH	19.35 °C	817.01 µS/cm	0.78 mg/L	30.95 NTU	35.4 mV	257.56 cm	100.00 ml/min
11/3/2022 5:17 PM	27:00	6.70 pH	19.13 °C	820.43 µS/cm	0.75 mg/L	18.12 NTU	37.2 mV	257.56 cm	100.00 ml/min
11/3/2022 5:20 PM	30:00	6.69 pH	19.25 °C	818.15 µS/cm	0.73 mg/L	23.24 NTU	38.3 mV	257.56 cm	100.00 ml/min
11/3/2022 5:23 PM	33:00	6.69 pH	19.01 °C	829.88 µS/cm	0.72 mg/L	17.21 NTU	40.0 mV	257.56 cm	100.00 ml/min

Samples

Sample ID:	Description:
------------	--------------

Low-Flow Test Report:

Test Date / Time: 11/4/2022 11:15:18 AM

Project: AB Brown (7)

Operator Name: Hayley Torres

Location Name: CCR-SP-1 Well Diameter: 2 in Casing Type: PVC Screen Length: 10 ft Top of Screen: 10 ft Total Depth: 20 ft Initial Depth to Water: 14.42 ft	Pump Type: Dedicated Tubing Type: LDPE Pump Intake From TOC: 15 ft Estimated Total Volume Pumped: 4700 ml Flow Cell Volume: 130 ml Final Flow Rate: 100 ml/min Final Draw Down: 0.11 ft	Instrument Used: Aqua TROLL 500 Serial Number: 625772
---	--	--

Test Notes:

Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth to Water	Flow
		+/- 0.1	+/- 0.5	+/- 3 %	+/- 10 %	+/- 10	+/- 10	+/- 5	
11/4/2022 11:15 AM	00:00	6.37 pH	17.91 °C	1,661.2 µS/cm	1.78 mg/L	393.20 NTU	-172.8 mV	439.52 cm	100.00 ml/min
11/4/2022 11:18 AM	03:00	6.31 pH	17.91 °C	1,663.3 µS/cm	1.22 mg/L	443.30 NTU	-176.8 mV	439.52 cm	100.00 ml/min
11/4/2022 11:21 AM	06:00	6.29 pH	17.93 °C	1,661.7 µS/cm	0.82 mg/L	455.89 NTU	-180.9 mV	439.52 cm	100.00 ml/min
11/4/2022 11:24 AM	09:00	6.27 pH	17.99 °C	1,661.4 µS/cm	0.92 mg/L	442.33 NTU	-185.3 mV	439.52 cm	100.00 ml/min
11/4/2022 11:27 AM	12:00	6.26 pH	17.95 °C	1,660.0 µS/cm	0.76 mg/L	671.08 NTU	-188.5 mV	439.52 cm	100.00 ml/min
11/4/2022 11:30 AM	15:00	6.26 pH	18.03 °C	1,660.1 µS/cm	0.43 mg/L	705.61 NTU	-190.8 mV	439.52 cm	100.00 ml/min
11/4/2022 11:33 AM	18:00	6.26 pH	18.08 °C	1,660.5 µS/cm	0.31 mg/L	715.21 NTU	-192.5 mV	439.52 cm	100.00 ml/min
11/4/2022 11:36 AM	21:00	6.25 pH	18.06 °C	1,657.6 µS/cm	0.25 mg/L	732.98 NTU	-193.9 mV	439.52 cm	100.00 ml/min
11/4/2022 11:39 AM	24:00	6.25 pH	18.04 °C	1,660.5 µS/cm	0.22 mg/L	749.43 NTU	-194.0 mV	439.52 cm	100.00 ml/min
11/4/2022 11:42 AM	27:00	6.25 pH	18.04 °C	1,660.2 µS/cm	0.20 mg/L	772.72 NTU	-195.3 mV	439.52 cm	100.00 ml/min
11/4/2022 11:45 AM	30:18	6.33 pH	18.37 °C	1,913.5 µS/cm	5.19 mg/L	0.00 NTU	-189.2 mV	439.52 cm	100.00 ml/min
11/4/2022 11:46 AM	31:19	6.27 pH	18.30 °C	1,579.5 µS/cm	0.85 mg/L	0.05 NTU	-192.2 mV	439.52 cm	100.00 ml/min
11/4/2022 11:47 AM	32:21	6.26 pH	18.34 °C	1,541.7 µS/cm	0.32 mg/L	0.00 NTU	-193.5 mV	439.52 cm	100.00 ml/min
11/4/2022 11:50 AM	35:21	6.25 pH	18.37 °C	1,538.1 µS/cm	0.19 mg/L	0.00 NTU	-194.1 mV	439.52 cm	100.00 ml/min
11/4/2022 11:52 AM	37:40	6.25 pH	18.49 °C	1,537.8 µS/cm	0.18 mg/L	0.00 NTU	-194.6 mV	439.52 cm	100.00 ml/min

11/4/2022 11:55 AM	40:40	6.25 pH	18.59 °C	1,387.2 µS/cm	0.19 mg/L	0.00 NTU	-194.1 mV	439.52 cm	100.00 ml/min
11/4/2022 11:58 AM	43:40	6.25 pH	18.56 °C	1,375.6 µS/cm	0.17 mg/L	0.00 NTU	-194.2 mV	439.52 cm	100.00 ml/min
11/4/2022 12:01 PM	46:40	6.25 pH	18.71 °C	1,363.8 µS/cm	0.18 mg/L	0.00 NTU	-194.2 mV	439.52 cm	100.00 ml/min

Samples

Sample ID:	Description:

Created using VuSitu from In-Situ, Inc.

Low-Flow Test Report:

Test Date / Time: 11/7/2022 10:22:31 AM

Project: AB Brown (8)

Operator Name: Hayley Torres

Location Name: CCR-SP-2 Well Diameter: 2 in Casing Type: PVC Screen Length: 10 ft Top of Screen: 10 ft Total Depth: 20 ft Initial Depth to Water: 15.96 ft	Pump Type: Dedicated Tubing Type: LDPE Pump Intake From TOC: 15 ft Estimated Total Volume Pumped: 2400 ml Flow Cell Volume: 130 ml Final Flow Rate: 100 ml/min Final Draw Down: 1.1 ft	Instrument Used: Aqua TROLL 500 Serial Number: 625772
---	---	--

Test Notes:

Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth to Water	Flow
		+/- 0.1	+/- 0.5	+/- 3 %	+/- 10 %	+/- 10	+/- 10	+/- 5	
11/7/2022 10:22 AM	00:00	6.74 pH	17.34 °C	1,113.8 µS/cm	0.81 mg/L	3.41 NTU	-67.0 mV	486.46 cm	100.00 ml/min
11/7/2022 10:25 AM	03:00	6.72 pH	17.22 °C	1,130.8 µS/cm	0.36 mg/L	4.21 NTU	-83.8 mV	486.46 cm	100.00 ml/min
11/7/2022 10:28 AM	06:00	6.69 pH	17.27 °C	1,138.4 µS/cm	0.21 mg/L	1.91 NTU	-89.8 mV	486.46 cm	100.00 ml/min
11/7/2022 10:31 AM	09:00	6.68 pH	17.27 °C	1,143.7 µS/cm	0.15 mg/L	0.63 NTU	-91.7 mV	486.46 cm	100.00 ml/min
11/7/2022 10:34 AM	12:00	6.67 pH	17.26 °C	1,146.8 µS/cm	0.13 mg/L	0.29 NTU	-94.6 mV	486.46 cm	100.00 ml/min
11/7/2022 10:37 AM	15:00	6.66 pH	17.23 °C	1,148.1 µS/cm	0.11 mg/L	0.43 NTU	-95.1 mV	486.46 cm	100.00 ml/min
11/7/2022 10:40 AM	18:00	6.66 pH	17.23 °C	1,149.4 µS/cm	0.11 mg/L	0.53 NTU	-95.9 mV	486.46 cm	100.00 ml/min
11/7/2022 10:43 AM	21:00	6.66 pH	17.19 °C	1,149.6 µS/cm	0.10 mg/L	0.00 NTU	-96.6 mV	486.46 cm	100.00 ml/min
11/7/2022 10:46 AM	24:00	6.66 pH	17.24 °C	1,150.5 µS/cm	0.10 mg/L	0.00 NTU	-97.0 mV	486.46 cm	100.00 ml/min

Samples

Sample ID:	Description:

Low-Flow Test Report:

Test Date / Time: 11/7/2022 11:43:27 AM

Project: AB Brown (9)

Operator Name: Hayley Torres

Location Name: CCR-SP-3 Well Diameter: 2 in Casing Type: PVC Screen Length: 10 ft Top of Screen: 10 ft Total Depth: 20 ft Initial Depth to Water: 11.04 ft	Pump Type: Dedicated Tubing Type: LDPE Pump Intake From TOC: 15 ft Estimated Total Volume Pumped: 2100 ml Flow Cell Volume: 130 ml Final Flow Rate: 100 ml/min Final Draw Down: 0.77 ft	Instrument Used: Aqua TROLL 500 Serial Number: 625772
---	---	--

Test Notes:

Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth to Water	Flow
		+/- 0.1	+/- 0.5	+/- 3 %	+/- 10 %	+/- 10	+/- 10	+/- 5	
11/7/2022 11:43 AM	00:00	6.88 pH	18.22 °C	518.10 µS/cm	2.63 mg/L	83.18 NTU	-25.3 mV	336.50 cm	100.00 ml/min
11/7/2022 11:46 AM	03:00	6.83 pH	18.34 °C	496.69 µS/cm	0.72 mg/L	167.03 NTU	-37.2 mV	336.50 cm	100.00 ml/min
11/7/2022 11:49 AM	06:00	6.80 pH	18.40 °C	494.34 µS/cm	0.45 mg/L	106.83 NTU	-39.8 mV	336.50 cm	100.00 ml/min
11/7/2022 11:52 AM	09:00	6.79 pH	18.44 °C	491.86 µS/cm	0.33 mg/L	66.29 NTU	-42.3 mV	336.50 cm	100.00 ml/min
11/7/2022 11:55 AM	12:00	6.78 pH	18.49 °C	489.63 µS/cm	0.27 mg/L	102.39 NTU	-43.2 mV	336.50 cm	100.00 ml/min
11/7/2022 11:58 AM	15:00	6.78 pH	18.58 °C	488.44 µS/cm	0.23 mg/L	133.70 NTU	-43.4 mV	336.50 cm	100.00 ml/min
11/7/2022 12:01 PM	18:00	6.76 pH	18.58 °C	477.67 µS/cm	0.21 mg/L	142.80 NTU	-42.4 mV	336.50 cm	100.00 ml/min
11/7/2022 12:04 PM	21:00	6.76 pH	18.98 °C	476.55 µS/cm	0.23 mg/L	139.52 NTU	-41.0 mV	336.50 cm	100.00 ml/min

Samples

Sample ID:	Description:

Low-Flow Test Report:

Test Date / Time: 11/8/2022 10:30:20 AM

Project: AB Brown (10)

Operator Name: Hayley Torres

Location Name: CCR-BK-1 Well Diameter: 2 in Casing Type: PVC Screen Length: 10 ft Top of Screen: 54 ft Total Depth: 64 ft	Pump Type: Dedicated Tubing Type: LDPE Pump Intake From TOC: 59 ft Estimated Total Volume Pumped: 3600 ml Flow Cell Volume: 130 ml Final Flow Rate: 100 ml/min	Instrument Used: Aqua TROLL 500 Serial Number: 625772
--	---	--

Test Notes:

Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth to Water	Flow
		+/- 0.1	+/- 0.5	+/- 3 %	+/- 10 %	+/- 10	+/- 10	+/- 5	
11/8/2022 10:30 AM	00:00	6.97 pH	15.32 °C	336.48 µS/cm	6.66 mg/L	193.71 NTU	67.4 mV		100.00 ml/min
11/8/2022 10:33 AM	03:00	6.85 pH	15.31 °C	325.89 µS/cm	6.64 mg/L	168.08 NTU	75.1 mV		100.00 ml/min
11/8/2022 10:36 AM	06:00	6.75 pH	15.35 °C	324.18 µS/cm	6.42 mg/L	167.39 NTU	80.0 mV		100.00 ml/min
11/8/2022 10:39 AM	09:00	6.70 pH	15.31 °C	324.14 µS/cm	6.19 mg/L	168.41 NTU	83.6 mV		100.00 ml/min
11/8/2022 10:42 AM	12:00	6.66 pH	15.33 °C	325.16 µS/cm	6.03 mg/L	180.38 NTU	86.2 mV		100.00 ml/min
11/8/2022 10:45 AM	15:00	6.64 pH	15.48 °C	326.97 µS/cm	5.88 mg/L	186.00 NTU	88.1 mV		100.00 ml/min
11/8/2022 10:48 AM	18:00	6.62 pH	15.58 °C	328.38 µS/cm	5.75 mg/L	194.39 NTU	89.5 mV		100.00 ml/min
11/8/2022 10:51 AM	21:00	6.62 pH	15.70 °C	329.81 µS/cm	6.37 mg/L	690.20 NTU	87.3 mV		100.00 ml/min
11/8/2022 10:54 AM	24:00	6.61 pH	15.62 °C	330.95 µS/cm	5.83 mg/L	1,061.3 NTU	90.3 mV		100.00 ml/min
11/8/2022 10:57 AM	27:00	6.61 pH	15.68 °C	332.55 µS/cm	5.73 mg/L	1.30 NTU	89.3 mV		100.00 ml/min
11/8/2022 11:00 AM	30:00	6.60 pH	15.83 °C	333.02 µS/cm	5.21 mg/L	2.64 NTU	90.8 mV		100.00 ml/min
11/8/2022 11:03 AM	33:00	6.58 pH	15.83 °C	332.92 µS/cm	5.08 mg/L	3.25 NTU	92.0 mV		100.00 ml/min
11/8/2022 11:06 AM	36:00	6.59 pH	15.59 °C	332.66 µS/cm	5.04 mg/L	6.60 NTU	92.8 mV		100.00 ml/min

Samples

Sample ID:	Description:
------------	--------------

Low-Flow Test Report:

Test Date / Time: 11/8/2022 12:30:36 PM

Project: AB Brown (11)

Operator Name: Hayley Torres

Location Name: CCR-BK-2 Well Diameter: 2 in Casing Type: PVC Screen Length: 10 ft Top of Screen: 15.5 ft Total Depth: 25.5 ft	Pump Type: Dedicated Tubing Type: LDPE Pump Intake From TOC: 20.5 ft Estimated Total Volume Pumped: 2700 ml Flow Cell Volume: 130 ml Final Flow Rate: 100 ml/min	Instrument Used: Aqua TROLL 500 Serial Number: 625772
--	--	--

Test Notes:

Low-Flow Readings:

Date Time	Elapsed Time	pH	Temperature	Specific Conductivity	RDO Concentration	Turbidity	ORP	Depth to Water	Flow
		+/- 0.1	+/- 0.5	+/- 3 %	+/- 10 %	+/- 10	+/- 10	+/- 5	
11/8/2022 12:30 PM	00:00	6.45 pH	18.60 °C	281.68 µS/cm	3.17 mg/L	199.25 NTU	78.9 mV		100.00 ml/min
11/8/2022 12:33 PM	03:00	6.44 pH	19.40 °C	284.31 µS/cm	3.05 mg/L	101.43 NTU	83.3 mV		100.00 ml/min
11/8/2022 12:36 PM	06:00	6.44 pH	19.84 °C	284.65 µS/cm	3.13 mg/L	123.70 NTU	81.8 mV		100.00 ml/min
11/8/2022 12:39 PM	09:00	6.44 pH	20.21 °C	284.77 µS/cm	3.21 mg/L	119.79 NTU	80.7 mV		100.00 ml/min
11/8/2022 12:42 PM	12:00	6.44 pH	20.54 °C	284.95 µS/cm	3.27 mg/L	117.44 NTU	79.9 mV		100.00 ml/min
11/8/2022 12:45 PM	15:00	6.45 pH	20.85 °C	285.25 µS/cm	3.31 mg/L	112.61 NTU	79.1 mV		100.00 ml/min
11/8/2022 12:48 PM	18:00	6.45 pH	21.14 °C	285.52 µS/cm	3.32 mg/L	110.77 NTU	78.5 mV		100.00 ml/min
11/8/2022 12:51 PM	21:00	6.45 pH	21.41 °C	285.77 µS/cm	3.28 mg/L	106.97 NTU	78.0 mV		100.00 ml/min
11/8/2022 12:54 PM	24:00	6.46 pH	21.67 °C	286.04 µS/cm	3.25 mg/L	111.83 NTU	77.5 mV		100.00 ml/min
11/8/2022 12:57 PM	27:00	6.46 pH	21.90 °C	286.13 µS/cm	3.28 mg/L	110.29 NTU	77.0 mV		100.00 ml/min

Samples

Sample ID:	Description:

VECTREN - AB BROWN STATION
 CCR Groundwater Sampling Event
 Gauging Date: May 16, 2022
 ATC Project No. 170LF01280

WELL ID	DATE	TIME	DTW FROM TOC (feet)
French Drain Area Locations			
HA-PP-1	5/16/2022	11:40	2.75
HA-PP-2	5/16/2022	11:40	2.49
FD PZ-1	5/16/2022	14:25	7.21
FD PZ-2	5/16/2022	14:32	2.85
FD PZ-3S	5/16/2022	13:53	9.30
FD PZ-3D	5/16/2022	13:57	13.05
FD PZ-4	5/16/2022	13:45	9.72
CCR-SG-3	5/16/2022	11:39	1.08
MH-1	5/16/2022	14:10	9.75
MH-2	5/16/2022	14:28	9.10
Ash Pond Wells			
CCR-AP-1R	5/16/2022	13:15	15.95
CCR-AP-2R	5/16/2022	13:38	42.46
CCR-AP-2I	5/16/2022	13:39	31.20
CCR-AP-3R	5/16/2022	13:25	25.30
CCR-AP-3I	5/16/2022	13:26	24.85
CCR-AP-4R	5/16/2022	13:07	32.92
CCR-AP-5R	5/16/2022	13:30	35.70
CCR-AP-6	5/16/2022	11:49	17.32
CCR-AP-7R	5/16/2022	11:52	34.98
CCR-AP-8	5/16/2022	11:45	4.16
CCR-AP-9	5/16/2022	11:35	8.07
CCR-AP-10	5/16/2022	12:55	35.11
CCR-AP-11	5/16/2022	11:20	11.07
Landfill Wells			
CCR-LF-1	5/16/2022	12:42	8.11
CCR-LF-2	5/16/2022	12:27	27.25
CCR-LF-3	5/16/2022	12:35	30.25
CCR-LF-4	5/16/2022	11:57	47.78
CCR-LF-5	5/16/2022	12:00	21.25
CCR-LF-6	5/16/2022	12:02	8.32
Sedimentation Pond Wells			
CCR-SP-1	5/16/2022	12:10	11.26
CCR-SP-2	5/16/2022	12:15	13.75
CCR-SP-3	5/16/2022	12:20	6.69
Background Wells			
CCR-BK-1R	5/16/2022	10:55	dry to pump
CCR-BK-2	5/16/2022	10:50	15.81

DTW= Depth to Water

TOC= Top of Casing

VECTREN - AB BROWN GENERATING STATION

CCR Groundwater Sampling Event

Gauging Date: November 1, 2022

ATC Project No. 170LF01280

WELL ID	DATE	TIME	DTW FROM TOC (feet)
French Drain Area Locations			
HA-PP-1	11/1/2022	12:48	2.80
HA-PP-2	11/1/2022	12:50	4.10
FD PZ-1	11/1/2022	14:17	7.55
FD PZ-2	11/1/2022	14:25	2.78
FD PZ-3S	11/1/2022	14:30	9.62
FD PZ-3D	11/1/2022	14:33	12.61
FD PZ-4	11/1/2022	14:20	9.99
CCR-SG-3	11/1/2022	12:55	0.95
MH-1	11/1/2022	14:40	9.60
MH-2	11/1/2022	14:51	9.05
Ash Pond Wells			
CCR-AP-1R	11/1/2022	13:45	19.71
CCR-AP-2R	11/1/2022	14:21	45.50
CCR-AP-2I	11/1/2022	14:15	35.60
CCR-AP-3R	11/1/2022	14:00	36.21
CCR-AP-3I	11/1/2022	14:05	28.72
CCR-AP-4R	11/1/2022	13:40	35.05
CCR-AP-5R	11/1/2022	14:10	36.15
CCR-AP-6	11/1/2022	12:02	19.80
CCR-AP-7R	11/1/2022	12:12	35.88
CCR-AP-8	11/1/2022	15:00	6.35
CCR-AP-9	11/1/2022	13:00	8.67
CCR-AP-10	11/1/2022	13:34	37.42
CCR-AP-11	11/1/2022	13:18	15.10
Landfill Wells			
CCR-LF-1	11/1/2022	13:35	11.07
CCR-LF-2	11/1/2022	13:45	28.47
CCR-LF-3	11/1/2022	13:53	31.04
CCR-LF-4	11/1/2022	14:40	48.24
CCR-LF-5	11/1/2022	14:06	21.27
CCR-LF-6	11/1/2022	14:09	8.39
Sedimentation Pond Wells			
CCR-SP-1	11/1/2022	14:30	13.08
CCR-SP-2	11/1/2022	14:24	16.02
CCR-SP-3	11/1/2022	14:20	11.68
Background Wells			
CCR-BK-1R	11/1/2022	15:10	dry to pump
CCR-BK-2	11/1/2022	15:22	15.81

DTW= Depth to Water

TOC= Top of Casing

APPENDIX C
Laboratory Analytical Report



Environment Testing
America



ANALYTICAL REPORT

Eurofins Pittsburgh
301 Alpha Drive
RIDC Park
Pittsburgh, PA 15238
Tel: (412)963-7058

Laboratory Job ID: 180-138465-1

Client Project/Site: CCR Groundwater Monitoring AB Brown

For:
Haley & Aldrich, Inc.
400 Augusta Street
Suite 100
Greenville, South Carolina 29601

Attn: Mark Miesfeldt

Authorized for release by:

6/17/2022 1:38:20 PM

Ken Hayes, Project Manager II
(615)301-5035
Ken.Hayes@et.eurofinsus.com

LINKS

Review your project
results through



Have a Question?



Visit us at:

www.eurofinsus.com/Env

This report has been electronically signed and authorized by the signatory. Electronic signature is intended to be the legally binding equivalent of a traditionally handwritten signature.

Results relate only to the items tested and the sample(s) as received by the laboratory.

PA Lab ID: 02-00416

Table of Contents

Cover Page	1
Table of Contents	2
Case Narrative	3
Definitions/Glossary	5
Certification Summary	6
Sample Summary	8
Method Summary	9
Lab Chronicle	10
Client Sample Results	17
QC Sample Results	28
QC Association Summary	35
Chain of Custody	39
Receipt Checklists	40

Case Narrative

Client: Haley & Aldrich, Inc.

Project/Site: CCR Groundwater Monitoring AB Brown

Job ID: 180-138465-1

Job ID: 180-138465-1

Laboratory: Eurofins Pittsburgh

Narrative

Report Job Narrative 180-138465-1

Comments

No additional comments.

Receipt

The samples were received on 5/20/2022 7:45 AM. Unless otherwise noted below, the samples arrived in good condition, and where required, properly preserved and on ice. The temperatures of the 3 coolers at receipt time were 2.7° C, 2.8° C and 3.6° C.

GC Semi VOA

Method 9056A: The following samples were diluted to bring the concentration of target analytes within the calibration range for Sulfate: MH-1 (180-138465-6), MH-2 (180-138465-7) and FD-PZ-1 (180-138465-8). Elevated reporting limits (RLs) are provided.

No additional analytical or quality issues were noted, other than those described above or in the Definitions/Glossary page.

RAD

Methods 903.0, 9315, RA-06-RC: Radium-226 batch 567275

Any minimum detectable concentration (MDC), critical value (DLC), or Safe Drinking Water Act detection limit (SDWA DL) is sample-specific unless otherwise stated elsewhere in this narrative. Radiochemistry sample results are reported with the count date/time applied as the Activity Reference Date. :MH-2 (180-138465-7), FD-PZ-1 (180-138465-8), (LCS 160-567275/1-A), (MB 160-567275/18-A), (410-84839-B-1-A), (410-84839-B-1-B MS) and (410-84839-A-1-A MSD)

Methods 903.0, 9315: Radium-226 batch 567238

Any minimum detectable concentration (MDC), critical value (DLC), or Safe Drinking Water Act detection limit (SDWA DL) is sample-specific unless otherwise stated elsewhere in this narrative. Radiochemistry sample results are reported with the count date/time applied as the Activity Reference Date. :CCR-SP-1 (180-138465-1), CCR-SP-1 (180-138465-1[DU]), CCR-SP-2 (180-138465-2), CCR-SP-3 (180-138465-3), DUPLICATE-2 (180-138465-4), FIELD BLANK-2 (180-138465-5), MH-1 (180-138465-6), FD-PZ-2 (180-138465-9), (LCS 160-567238/1-A) and (MB 160-567238/21-A)

Method 9320: Radium-228 batch 567278

The detection goal was not met for the following sample(s). Samples were prepped at a reduced volume due to the presence of matrix interferences: MH-2 (180-138465-7) and FD-PZ-1 (180-138465-8). Analytical results are reported with the detection limit achieved.

Methods 904.0, 9320, RA-06-RC: Radium-228 batch 567278

Any minimum detectable concentration (MDC), critical value (DLC), or Safe Drinking Water Act detection limit (SDWA DL) is sample-specific unless otherwise stated elsewhere in this narrative. Radiochemistry sample results are reported with the count date/time applied as the Activity Reference Date. :MH-2 (180-138465-7), FD-PZ-1 (180-138465-8), (LCS 160-567278/1-A), (MB 160-567278/18-A), (410-84839-B-1-C), (410-84839-B-1-D MS) and (410-84839-A-1-B MSD)

Methods 904.0, 9320: Radium-228 batch 567244

Any minimum detectable concentration (MDC), critical value (DLC), or Safe Drinking Water Act detection limit (SDWA DL) is sample-specific unless otherwise stated elsewhere in this narrative. Radiochemistry sample results are reported with the count date/time applied as the Activity Reference Date. :CCR-SP-1 (180-138465-1), CCR-SP-1 (180-138465-1[DU]), CCR-SP-2 (180-138465-2), CCR-SP-3 (180-138465-3), DUPLICATE-2 (180-138465-4), FIELD BLANK-2 (180-138465-5), MH-1 (180-138465-6), FD-PZ-2 (180-138465-9), (LCS 160-567244/1-A) and (MB 160-567244/21-A)

No additional analytical or quality issues were noted, other than those described above or in the Definitions/Glossary page.

Metals

Method 3005A: The following sample was diluted due to the nature of the sample matrix: Elevated reporting limits (RLs) are provided.

Method 6020A: The post digestion spike % recovery for multiple analytes associated with batch 180-401512 was outside of control limits. The associated sample is: CCR-SP-1 (180-138465-1).

Case Narrative

Client: Haley & Aldrich, Inc.

Project/Site: CCR Groundwater Monitoring AB Brown

Job ID: 180-138465-1

Job ID: 180-138465-1 (Continued)

Laboratory: Eurofins Pittsburgh (Continued)

Method 6020A: The post digestion spike % recovery for boron associated with batch 180-401660 was outside of control limits. The associated sample is: CCR-SP-1 (180-138465-1).

Method 6020A: The following samples were diluted to bring the concentration of target analytes within the calibration range: MH-1 (180-138465-6) and MH-2 (180-138465-7). Elevated reporting limits (RLs) are provided.

No additional analytical or quality issues were noted, other than those described above or in the Definitions/Glossary page.

General Chemistry

No analytical or quality issues were noted, other than those described in the Definitions/Glossary page.

Definitions/Glossary

Client: Haley & Aldrich, Inc.

Job ID: 180-138465-1

Project/Site: CCR Groundwater Monitoring AB Brown

Qualifiers

Metals

Qualifier	Qualifier Description
4	MS, MSD: The analyte present in the original sample is greater than 4 times the matrix spike concentration; therefore, control limits are not applicable.
B	Compound was found in the blank and sample.
J	Result is less than the RL but greater than or equal to the MDL and the concentration is an approximate value.

General Chemistry

Qualifier	Qualifier Description
HF	Field parameter with a holding time of 15 minutes. Test performed by laboratory at client's request.
Rad	
Qualifier	Qualifier Description

G	The Sample MDC is greater than the requested RL.
U	Result is less than the sample detection limit.

Glossary

Abbreviation	These commonly used abbreviations may or may not be present in this report.
¤	Listed under the "D" column to designate that the result is reported on a dry weight basis
%R	Percent Recovery
CFL	Contains Free Liquid
CFU	Colony Forming Unit
CNF	Contains No Free Liquid
DER	Duplicate Error Ratio (normalized absolute difference)
Dil Fac	Dilution Factor
DL	Detection Limit (DoD/DOE)
DL, RA, RE, IN	Indicates a Dilution, Re-analysis, Re-extraction, or additional Initial metals/anion analysis of the sample
DLC	Decision Level Concentration (Radiochemistry)
EDL	Estimated Detection Limit (Dioxin)
LOD	Limit of Detection (DoD/DOE)
LOQ	Limit of Quantitation (DoD/DOE)
MCL	EPA recommended "Maximum Contaminant Level"
MDA	Minimum Detectable Activity (Radiochemistry)
MDC	Minimum Detectable Concentration (Radiochemistry)
MDL	Method Detection Limit
ML	Minimum Level (Dioxin)
MPN	Most Probable Number
MQL	Method Quantitation Limit
NC	Not Calculated
ND	Not Detected at the reporting limit (or MDL or EDL if shown)
NEG	Negative / Absent
POS	Positive / Present
PQL	Practical Quantitation Limit
PRES	Presumptive
QC	Quality Control
RER	Relative Error Ratio (Radiochemistry)
RL	Reporting Limit or Requested Limit (Radiochemistry)
RPD	Relative Percent Difference, a measure of the relative difference between two points
TEF	Toxicity Equivalent Factor (Dioxin)
TEQ	Toxicity Equivalent Quotient (Dioxin)
TNTC	Too Numerous To Count

Accreditation/Certification Summary

Client: Haley & Aldrich, Inc.

Project/Site: CCR Groundwater Monitoring AB Brown

Job ID: 180-138465-1

Laboratory: Eurofins Pittsburgh

All accreditations/certifications held by this laboratory are listed. Not all accreditations/certifications are applicable to this report.

Authority	Program	Identification Number	Expiration Date
Arkansas DEQ	State	19-033-0	06-27-22
California	State	2891	04-30-22 *
Connecticut	State	PH-0688	09-30-22
Florida	NELAP	E871008	06-30-22
Georgia	State	PA 02-00416	04-30-23
Illinois	NELAP	004375	06-30-22
Kansas	NELAP	E-10350	03-31-23
Kentucky (UST)	State	162013	04-30-22 *
Kentucky (WW)	State	KY98043	12-31-22
Louisiana	NELAP	04041	06-30-22
Maine	State	PA00164	03-06-24
Minnesota	NELAP	042-999-482	12-31-22
Nevada	State	PA00164	08-31-22
New Hampshire	NELAP	2030	04-04-23
New Jersey	NELAP	PA005	06-30-23
New York	NELAP	11182	04-01-23
North Carolina (WW/SW)	State	434	12-31-22
North Dakota	State	R-227	04-30-22 *
Oregon	NELAP	PA-2151	02-07-23
Pennsylvania	NELAP	02-00416	04-30-23
Rhode Island	State	LAO00362	12-31-21 *
South Carolina	State	89014	06-30-22
Texas	NELAP	T104704528	03-31-23
USDA	Federal	P-Soil-01	06-26-22
USDA	US Federal Programs	P330-16-00211	06-26-22
Utah	NELAP	PA001462019-8	05-31-22 *
Virginia	NELAP	10043	09-14-22
West Virginia DEP	State	142	01-31-23
Wisconsin	State	998027800	08-31-22

Laboratory: Eurofins St. Louis

All accreditations/certifications held by this laboratory are listed. Not all accreditations/certifications are applicable to this report.

Authority	Program	Identification Number	Expiration Date
Alaska (UST)	State	20-001	05-06-25
ANAB	Dept. of Defense ELAP	L2305	04-06-25
ANAB	Dept. of Energy	L2305.01	04-06-25
ANAB	ISO/IEC 17025	L2305	04-06-25
Arizona	State	AZ0813	12-08-22
California	Los Angeles County Sanitation Districts	10259	06-30-22
California	State	2886	07-01-22
Connecticut	State	PH-0241	03-31-23
Florida	NELAP	E87689	06-30-22
HI - RadChem Recognition	State	n/a	06-30-22
Illinois	NELAP	200023	11-30-22
Iowa	State	373	12-01-22
Kansas	NELAP	E-10236	10-31-22
Kentucky (DW)	State	KY90125	12-31-22
Kentucky (WW)	State	KY90125 (Permit KY0004049)	12-31-22

* Accreditation/Certification renewal pending - accreditation/certification considered valid.

Eurofins Pittsburgh

Accreditation/Certification Summary

Client: Haley & Aldrich, Inc.

Project/Site: CCR Groundwater Monitoring AB Brown

Job ID: 180-138465-1

Laboratory: Eurofins St. Louis (Continued)

All accreditations/certifications held by this laboratory are listed. Not all accreditations/certifications are applicable to this report.

Authority	Program	Identification Number	Expiration Date
Louisiana	NELAP	04080	06-30-22
Louisiana (DW)	State	LA011	12-31-22
Maryland	State	310	09-30-22
MI - RadChem Recognition	State	9005	06-30-22
Missouri	State	780	06-30-22
Nevada	State	MO000542020-1	07-31-22
New Jersey	NELAP	MO002	06-30-22
New York	NELAP	11616	04-01-23
North Dakota	State	R-207	06-30-22
NRC	NRC	24-24817-01	12-31-22
Oklahoma	NELAP	9997	08-31-22
Oregon	NELAP	4157	09-01-22
Pennsylvania	NELAP	68-00540	02-28-23
South Carolina	State	85002001	06-30-22
Texas	NELAP	T104704193	07-31-22
US Fish & Wildlife	US Federal Programs	058448	07-31-22
USDA	US Federal Programs	P330-17-00028	03-11-23
Utah	NELAP	MO000542021-14	08-01-22
Virginia	NELAP	10310	06-14-23
Washington	State	C592	08-30-22
West Virginia DEP	State	381	10-31-22

Sample Summary

Client: Haley & Aldrich, Inc.

Project/Site: CCR Groundwater Monitoring AB Brown

Job ID: 180-138465-1

Lab Sample ID	Client Sample ID	Matrix	Collected	Received
180-138465-1	CCR-SP-1	Water	05/19/22 06:22	05/20/22 07:45
180-138465-2	CCR-SP-2	Water	05/19/22 07:10	05/20/22 07:45
180-138465-3	CCR-SP-3	Water	05/19/22 07:55	05/20/22 07:45
180-138465-4	DUPLICATE-2	Water	05/19/22 00:00	05/20/22 07:45
180-138465-5	FIELD BLANK-2	Water	05/19/22 05:57	05/20/22 07:45
180-138465-6	MH-1	Water	05/19/22 09:10	05/20/22 07:45
180-138465-7	MH-2	Water	05/19/22 08:40	05/20/22 07:45
180-138465-8	FD-PZ-1	Water	05/19/22 09:35	05/20/22 07:45
180-138465-9	FD-PZ-2	Water	05/19/22 10:22	05/20/22 07:45

Method Summary

Client: Haley & Aldrich, Inc.

Project/Site: CCR Groundwater Monitoring AB Brown

Job ID: 180-138465-1

Method	Method Description	Protocol	Laboratory
EPA 9056A	Anions, Ion Chromatography	SW846	TAL PIT
EPA 6020A	Metals (ICP/MS)	SW846	TAL PIT
EPA 7470A	Mercury (CVAA)	SW846	TAL PIT
EPA 9040C	pH	SW846	TAL PIT
SM 2540C	Solids, Total Dissolved (TDS)	SM	TAL PIT
9315	Radium-226 (GFPC)	SW846	TAL SL
9320	Radium-228 (GFPC)	SW846	TAL SL
Ra226_Ra228	Combined Radium-226 and Radium-228	TAL-STL	TAL SL
3005A	Preparation, Total Recoverable or Dissolved Metals	SW846	TAL PIT
7470A	Preparation, Mercury	SW846	TAL PIT
PrecSep_0	Preparation, Precipitate Separation	None	TAL SL
PrecSep-21	Preparation, Precipitate Separation (21-Day In-Growth)	None	TAL SL

Protocol References:

None = None

SM = "Standard Methods For The Examination Of Water And Wastewater"

SW846 = "Test Methods For Evaluating Solid Waste, Physical/Chemical Methods", Third Edition, November 1986 And Its Updates.

TAL-STL = TestAmerica Laboratories, St. Louis, Facility Standard Operating Procedure.

Laboratory References:

TAL PIT = Eurofins Pittsburgh, 301 Alpha Drive, RIDC Park, Pittsburgh, PA 15238, TEL (412)963-7058

TAL SL = Eurofins St. Louis, 13715 Rider Trail North, Earth City, MO 63045, TEL (314)298-8566

Lab Chronicle

Client: Haley & Aldrich, Inc.

Job ID: 180-138465-1

Project/Site: CCR Groundwater Monitoring AB Brown

Client Sample ID: CCR-SP-1

Lab Sample ID: 180-138465-1

Matrix: Water

Date Collected: 05/19/22 06:22

Date Received: 05/20/22 07:45

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	EPA 9056A		1			400775	06/03/22 23:51	LWM	TAL PIT
		Instrument ID: CHICS2100B								
Total Recoverable	Prep	3005A			25 mL	25 mL	400451	06/01/22 10:30	EMR	TAL PIT
Total Recoverable	Analysis	EPA 6020A		1			401512	06/09/22 13:48	RSK	TAL PIT
		Instrument ID: DORY								
Total Recoverable	Prep	3005A			25 mL	25 mL	400451	06/01/22 10:30	EMR	TAL PIT
Total Recoverable	Analysis	EPA 6020A		1			401660	06/10/22 10:48	RSK	TAL PIT
		Instrument ID: NEMO								
Total/NA	Prep	7470A			50 mL	50 mL	400613	06/02/22 07:03	RJR	TAL PIT
Total/NA	Analysis	EPA 7470A		1			400744	06/02/22 16:12	RJR	TAL PIT
		Instrument ID: HGY								
Total/NA	Analysis	EPA 9040C		1			399828	05/24/22 14:45	HEK	TAL PIT
		Instrument ID: PHTITRATOR								
Total/NA	Analysis	SM 2540C		1	100 mL	100 mL	399706	05/23/22 16:48	JCR	TAL PIT
		Instrument ID: NOEQUIP								
Total/NA	Prep	PrecSep-21			754.59 mL	1.0 g	567238	05/25/22 10:59	MS	TAL SL
Total/NA	Analysis	9315		1			570309	06/16/22 08:18	FLC	TAL SL
		Instrument ID: GFPCBLUE								
Total/NA	Prep	PrecSep_0			754.59 mL	1.0 g	567244	05/25/22 11:43	MS	TAL SL
Total/NA	Analysis	9320		1			569971	06/14/22 15:29	FLC	TAL SL
		Instrument ID: GFPCRED								
Total/NA	Analysis	Ra226_Ra228		1			570420	06/16/22 17:51	EMH	TAL SL
		Instrument ID: NOEQUIP								

Client Sample ID: CCR-SP-2

Lab Sample ID: 180-138465-2

Matrix: Water

Date Collected: 05/19/22 07:10

Date Received: 05/20/22 07:45

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	EPA 9056A		1			400775	06/04/22 00:35	LWM	TAL PIT
		Instrument ID: CHICS2100B								
Total Recoverable	Prep	3005A			25 mL	25 mL	400451	06/01/22 10:30	EMR	TAL PIT
Total Recoverable	Analysis	EPA 6020A		1			401512	06/09/22 14:12	RSK	TAL PIT
		Instrument ID: DORY								
Total Recoverable	Prep	3005A			25 mL	25 mL	400451	06/01/22 10:30	EMR	TAL PIT
Total Recoverable	Analysis	EPA 6020A		1			401660	06/10/22 11:01	RSK	TAL PIT
		Instrument ID: NEMO								
Total/NA	Prep	7470A			50 mL	50 mL	400613	06/02/22 07:03	RJR	TAL PIT
Total/NA	Analysis	EPA 7470A		1			400744	06/02/22 16:15	RJR	TAL PIT
		Instrument ID: HGY								
Total/NA	Analysis	EPA 9040C		1			400077	05/26/22 13:17	HEK	TAL PIT
		Instrument ID: NOEQUIP								
Total/NA	Analysis	SM 2540C		1	100 mL	100 mL	399680	05/23/22 12:46	JCR	TAL PIT
		Instrument ID: NOEQUIP								

Eurofins Pittsburgh

Lab Chronicle

Client: Haley & Aldrich, Inc.

Job ID: 180-138465-1

Project/Site: CCR Groundwater Monitoring AB Brown

Client Sample ID: CCR-SP-2

Lab Sample ID: 180-138465-2

Matrix: Water

Date Collected: 05/19/22 07:10

Date Received: 05/20/22 07:45

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	PrecSep-21			747.79 mL	1.0 g	567238	05/25/22 10:59	MS	TAL SL
Total/NA	Analysis	9315 Instrument ID: GFPCBLUE		1			570309	06/16/22 08:18	FLC	TAL SL
Total/NA	Prep	PrecSep_0			747.79 mL	1.0 g	567244	05/25/22 11:43	MS	TAL SL
Total/NA	Analysis	9320 Instrument ID: GFPCRED		1			569971	06/14/22 15:29	FLC	TAL SL
Total/NA	Analysis	Ra226_Ra228 Instrument ID: NOEQUIP		1			570420	06/16/22 17:51	EMH	TAL SL

Client Sample ID: CCR-SP-3

Lab Sample ID: 180-138465-3

Matrix: Water

Date Collected: 05/19/22 07:55

Date Received: 05/20/22 07:45

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	EPA 9056A Instrument ID: CHICS2100B		1			400512	06/02/22 01:55	LWM	TAL PIT
Total/NA	Analysis	EPA 9056A Instrument ID: CHICS2100B		1			400775	06/04/22 00:50	LWM	TAL PIT
Total Recoverable	Prep	3005A			25 mL	25 mL	400451	06/01/22 10:30	EMR	TAL PIT
Total Recoverable	Analysis	EPA 6020A Instrument ID: DORY		1			401512	06/09/22 14:16	RSK	TAL PIT
Total Recoverable	Prep	3005A			25 mL	25 mL	400451	06/01/22 10:30	EMR	TAL PIT
Total Recoverable	Analysis	EPA 6020A Instrument ID: NEMO		1			401660	06/10/22 11:03	RSK	TAL PIT
Total/NA	Prep	7470A			50 mL	50 mL	400613	06/02/22 07:03	RJR	TAL PIT
Total/NA	Analysis	EPA 7470A Instrument ID: HGY		1			400744	06/02/22 16:16	RJR	TAL PIT
Total/NA	Analysis	EPA 9040C Instrument ID: NOEQUIP		1			400077	05/26/22 13:19	HEK	TAL PIT
Total/NA	Analysis	SM 2540C Instrument ID: NOEQUIP		1	100 mL	100 mL	399706	05/23/22 16:48	JCR	TAL PIT
Total/NA	Prep	PrecSep-21			991.50 mL	1.0 g	567238	05/25/22 10:59	MS	TAL SL
Total/NA	Analysis	9315 Instrument ID: GFPCBLUE		1			570309	06/16/22 08:18	FLC	TAL SL
Total/NA	Prep	PrecSep_0			991.50 mL	1.0 g	567244	05/25/22 11:43	MS	TAL SL
Total/NA	Analysis	9320 Instrument ID: GFPCRED		1			569971	06/14/22 15:30	FLC	TAL SL
Total/NA	Analysis	Ra226_Ra228 Instrument ID: NOEQUIP		1			570420	06/16/22 17:51	EMH	TAL SL

Lab Chronicle

Client: Haley & Aldrich, Inc.

Job ID: 180-138465-1

Project/Site: CCR Groundwater Monitoring AB Brown

Client Sample ID: DUPLICATE-2

Lab Sample ID: 180-138465-4

Matrix: Water

Date Collected: 05/19/22 00:00

Date Received: 05/20/22 07:45

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	EPA 9056A		1			400512	06/02/22 02:25	LWM	TAL PIT
		Instrument ID: CHICS2100B								
Total/NA	Analysis	EPA 9056A		1			400775	06/04/22 01:05	LWM	TAL PIT
		Instrument ID: CHICS2100B								
Total Recoverable	Prep	3005A			25 mL	25 mL	400451	06/01/22 10:30	EMR	TAL PIT
Total Recoverable	Analysis	EPA 6020A		1			401512	06/09/22 14:19	RSK	TAL PIT
		Instrument ID: DORY								
Total Recoverable	Prep	3005A			25 mL	25 mL	400451	06/01/22 10:30	EMR	TAL PIT
Total Recoverable	Analysis	EPA 6020A		1			401660	06/10/22 11:11	RSK	TAL PIT
		Instrument ID: NEMO								
Total/NA	Prep	7470A			50 mL	50 mL	400613	06/02/22 07:03	RJR	TAL PIT
Total/NA	Analysis	EPA 7470A		1			400744	06/02/22 16:20	RJR	TAL PIT
		Instrument ID: HGY								
Total/NA	Analysis	EPA 9040C		1			400077	05/26/22 13:22	HEK	TAL PIT
		Instrument ID: NOEQUIP								
Total/NA	Analysis	SM 2540C		1	100 mL	100 mL	399706	05/23/22 16:48	JCR	TAL PIT
		Instrument ID: NOEQUIP								
Total/NA	Prep	PrecSep-21			991.69 mL	1.0 g	567238	05/25/22 10:59	MS	TAL SL
Total/NA	Analysis	9315		1			570309	06/16/22 08:18	FLC	TAL SL
		Instrument ID: GFPCBLUE								
Total/NA	Prep	PrecSep_0			991.69 mL	1.0 g	567244	05/25/22 11:43	MS	TAL SL
Total/NA	Analysis	9320		1			569971	06/14/22 15:30	FLC	TAL SL
		Instrument ID: GFPCRED								
Total/NA	Analysis	Ra226_Ra228		1			570420	06/16/22 17:51	EMH	TAL SL
		Instrument ID: NOEQUIP								

Client Sample ID: FIELD BLANK-2

Lab Sample ID: 180-138465-5

Matrix: Water

Date Collected: 05/19/22 05:57

Date Received: 05/20/22 07:45

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	EPA 9056A		1			400512	06/02/22 02:54	LWM	TAL PIT
		Instrument ID: CHICS2100B								
Total Recoverable	Prep	3005A			25 mL	25 mL	400451	06/01/22 10:30	EMR	TAL PIT
Total Recoverable	Analysis	EPA 6020A		1			401512	06/09/22 14:23	RSK	TAL PIT
		Instrument ID: DORY								
Total Recoverable	Prep	3005A			25 mL	25 mL	400451	06/01/22 10:30	EMR	TAL PIT
Total Recoverable	Analysis	EPA 6020A		1			401660	06/10/22 11:14	RSK	TAL PIT
		Instrument ID: NEMO								
Total/NA	Prep	7470A			50 mL	50 mL	400613	06/02/22 07:03	RJR	TAL PIT
Total/NA	Analysis	EPA 7470A		1			400744	06/02/22 16:21	RJR	TAL PIT
		Instrument ID: HGY								
Total/NA	Analysis	EPA 9040C		1			399828	05/24/22 14:54	HEK	TAL PIT
		Instrument ID: PHTITRATOR								

Eurofins Pittsburgh

Lab Chronicle

Client: Haley & Aldrich, Inc.

Job ID: 180-138465-1

Project/Site: CCR Groundwater Monitoring AB Brown

Client Sample ID: FIELD BLANK-2

Date Collected: 05/19/22 05:57

Date Received: 05/20/22 07:45

Lab Sample ID: 180-138465-5

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	SM 2540C		1	100 mL	100 mL	399706	05/23/22 16:48	JCR	TAL PIT
Total/NA	Prep	PrecSep-21			998.30 mL	1.0 g	567238	05/25/22 10:59	MS	TAL SL
Total/NA	Analysis	9315 Instrument ID: GFPCBLUE		1			570309	06/16/22 08:19	FLC	TAL SL
Total/NA	Prep	PrecSep_0			998.30 mL	1.0 g	567244	05/25/22 11:43	MS	TAL SL
Total/NA	Analysis	9320 Instrument ID: GFPCRED		1			569971	06/14/22 15:30	FLC	TAL SL
Total/NA	Analysis	Ra226_Ra228 Instrument ID: NOEQUIP		1			570420	06/16/22 17:51	EMH	TAL SL

Client Sample ID: MH-1

Date Collected: 05/19/22 09:10

Date Received: 05/20/22 07:45

Lab Sample ID: 180-138465-6

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	EPA 9056A Instrument ID: CHICS2100B		5			400512	06/02/22 03:09	LWM	TAL PIT
Total/NA	Analysis	EPA 9056A Instrument ID: CHICS2100B		50			400775	06/04/22 01:20	LWM	TAL PIT
Total Recoverable	Prep	3005A			25 mL	25 mL	400451	06/01/22 10:30	EMR	TAL PIT
Total Recoverable	Analysis	EPA 6020A Instrument ID: DORY		1			401512	06/09/22 14:26	RSK	TAL PIT
Total Recoverable	Prep	3005A			25 mL	25 mL	400451	06/01/22 10:30	EMR	TAL PIT
Total Recoverable	Analysis	EPA 6020A Instrument ID: NEMO		10			401660	06/10/22 11:16	RSK	TAL PIT
Total/NA	Prep	7470A			50 mL	50 mL	400613	06/02/22 07:03	RJR	TAL PIT
Total/NA	Analysis	EPA 7470A Instrument ID: HGY		1			400744	06/02/22 16:22	RJR	TAL PIT
Total/NA	Analysis	EPA 9040C Instrument ID: PHTITRATOR		1			399828	05/24/22 14:59	HEK	TAL PIT
Total/NA	Analysis	SM 2540C Instrument ID: NOEQUIP		1	25 mL	100 mL	399706	05/23/22 16:48	JCR	TAL PIT
Total/NA	Prep	PrecSep-21			1005.12 mL	1.0 g	567238	05/25/22 10:59	MS	TAL SL
Total/NA	Analysis	9315 Instrument ID: GFPCBLUE		1			570309	06/16/22 08:19	FLC	TAL SL
Total/NA	Prep	PrecSep_0			1005.12 mL	1.0 g	567244	05/25/22 11:43	MS	TAL SL
Total/NA	Analysis	9320 Instrument ID: GFPCRED		1			569971	06/14/22 15:31	FLC	TAL SL
Total/NA	Analysis	Ra226_Ra228 Instrument ID: NOEQUIP		1			570420	06/16/22 17:51	EMH	TAL SL

Eurofins Pittsburgh

Lab Chronicle

Client: Haley & Aldrich, Inc.

Job ID: 180-138465-1

Project/Site: CCR Groundwater Monitoring AB Brown

Client Sample ID: MH-2

Lab Sample ID: 180-138465-7

Matrix: Water

Date Collected: 05/19/22 08:40

Date Received: 05/20/22 07:45

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	EPA 9056A		10			400512	06/02/22 03:39	LWM	TAL PIT
		Instrument ID: CHICS2100B								
Total/NA	Analysis	EPA 9056A		10			400775	06/04/22 01:35	LWM	TAL PIT
		Instrument ID: CHICS2100B								
Total Recoverable	Prep	3005A			25 mL	25 mL	400451	06/01/22 10:30	EMR	TAL PIT
Total Recoverable	Analysis	EPA 6020A		1			401512	06/09/22 14:51	RSK	TAL PIT
		Instrument ID: DORY								
Total Recoverable	Prep	3005A			25 mL	25 mL	400451	06/01/22 10:30	EMR	TAL PIT
Total Recoverable	Analysis	EPA 6020A		10			401660	06/10/22 11:19	RSK	TAL PIT
		Instrument ID: NEMO								
Total/NA	Prep	7470A			50 mL	50 mL	400613	06/02/22 07:03	RJR	TAL PIT
Total/NA	Analysis	EPA 7470A		1			400744	06/02/22 16:23	RJR	TAL PIT
		Instrument ID: HGY								
Total/NA	Analysis	EPA 9040C		1			399828	05/24/22 15:03	HEK	TAL PIT
		Instrument ID: PHTITRATOR								
Total/NA	Analysis	SM 2540C		1	10 mL	100 mL	399706	05/23/22 16:48	JCR	TAL PIT
		Instrument ID: NOEQUIP								
Total/NA	Prep	PrecSep-21			252.03 mL	1.0 g	567275	05/25/22 14:50	MS	TAL SL
Total/NA	Analysis	9315		1			570287	06/16/22 07:58	FLC	TAL SL
		Instrument ID: GFPCRED								
Total/NA	Prep	PrecSep_0			252.03 mL	1.0 g	567278	05/25/22 15:23	MS	TAL SL
Total/NA	Analysis	9320		1			570095	06/14/22 16:01	FLC	TAL SL
		Instrument ID: GFPCORANGE								
Total/NA	Analysis	Ra226_Ra228		1			570420	06/16/22 17:51	EMH	TAL SL
		Instrument ID: NOEQUIP								

Client Sample ID: FD-PZ-1

Lab Sample ID: 180-138465-8

Matrix: Water

Date Collected: 05/19/22 09:35

Date Received: 05/20/22 07:45

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	EPA 9056A		5			400512	06/02/22 04:09	LWM	TAL PIT
		Instrument ID: CHICS2100B								
Total/NA	Analysis	EPA 9056A		50			400775	06/04/22 01:50	LWM	TAL PIT
		Instrument ID: CHICS2100B								
Total Recoverable	Prep	3005A			2.5 mL	25 mL	400451	06/01/22 10:30	EMR	TAL PIT
Total Recoverable	Analysis	EPA 6020A		1			401512	06/09/22 15:05	RSK	TAL PIT
		Instrument ID: DORY								
Total Recoverable	Prep	3005A			2.5 mL	25 mL	400451	06/01/22 10:30	EMR	TAL PIT
Total Recoverable	Analysis	EPA 6020A		1			401660	06/10/22 11:22	RSK	TAL PIT
		Instrument ID: NEMO								
Total/NA	Prep	7470A			50 mL	50 mL	400613	06/02/22 07:03	RJR	TAL PIT
Total/NA	Analysis	EPA 7470A		1			400744	06/02/22 16:24	RJR	TAL PIT
		Instrument ID: HGY								

Eurofins Pittsburgh

Lab Chronicle

Client: Haley & Aldrich, Inc.

Job ID: 180-138465-1

Project/Site: CCR Groundwater Monitoring AB Brown

Client Sample ID: FD-PZ-1

Lab Sample ID: 180-138465-8

Matrix: Water

Date Collected: 05/19/22 09:35

Date Received: 05/20/22 07:45

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	EPA 9040C		1			399828	05/24/22 15:08	HEK	TAL PIT
Total/NA	Analysis	SM 2540C		1	25 mL	100 mL	399706	05/23/22 16:48	JCR	TAL PIT
		Instrument ID: NOEQUIP								
Total/NA	Prep	PrecSep-21			246.86 mL	1.0 g	567275	05/25/22 14:50	MS	TAL SL
Total/NA	Analysis	9315		1			570287	06/16/22 07:58	FLC	TAL SL
		Instrument ID: GFPCRED								
Total/NA	Prep	PrecSep_0			246.86 mL	1.0 g	567278	05/25/22 15:23	MS	TAL SL
Total/NA	Analysis	9320		1			570095	06/14/22 16:01	FLC	TAL SL
		Instrument ID: GFPCORANGE								
Total/NA	Analysis	Ra226_Ra228		1			570420	06/16/22 17:51	EMH	TAL SL
		Instrument ID: NOEQUIP								

Client Sample ID: FD-PZ-2

Lab Sample ID: 180-138465-9

Matrix: Water

Date Collected: 05/19/22 10:22

Date Received: 05/20/22 07:45

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	EPA 9056A		1			400512	06/02/22 05:08	LWM	TAL PIT
		Instrument ID: CHICS2100B								
Total/NA	Analysis	EPA 9056A		1			400775	06/04/22 02:34	LWM	TAL PIT
		Instrument ID: CHICS2100B								
Total Recoverable	Prep	3005A			25 mL	25 mL	400451	06/01/22 10:30	EMR	TAL PIT
Total Recoverable	Analysis	EPA 6020A		1			401512	06/09/22 15:08	RSK	TAL PIT
		Instrument ID: DORY								
Total Recoverable	Prep	3005A			25 mL	25 mL	400451	06/01/22 10:30	EMR	TAL PIT
Total Recoverable	Analysis	EPA 6020A		1			401660	06/10/22 11:24	RSK	TAL PIT
		Instrument ID: NEMO								
Total/NA	Prep	7470A			50 mL	50 mL	400613	06/02/22 07:03	RJR	TAL PIT
Total/NA	Analysis	EPA 7470A		1			400744	06/02/22 16:25	RJR	TAL PIT
		Instrument ID: HGY								
Total/NA	Analysis	EPA 9040C		1			399828	05/24/22 15:14	HEK	TAL PIT
		Instrument ID: PHTITRATOR								
Total/NA	Analysis	SM 2540C		1	100 mL	100 mL	399706	05/23/22 16:48	JCR	TAL PIT
		Instrument ID: NOEQUIP								
Total/NA	Prep	PrecSep-21			502.02 mL	1.0 g	567238	05/25/22 10:59	MS	TAL SL
Total/NA	Analysis	9315		1			570309	06/16/22 08:19	FLC	TAL SL
		Instrument ID: GFPCBLUE								
Total/NA	Prep	PrecSep_0			502.02 mL	1.0 g	567244	05/25/22 11:43	MS	TAL SL
Total/NA	Analysis	9320		1			569971	06/14/22 15:31	FLC	TAL SL
		Instrument ID: GFPCRED								
Total/NA	Analysis	Ra226_Ra228		1			570420	06/16/22 17:51	EMH	TAL SL
		Instrument ID: NOEQUIP								

Eurofins Pittsburgh

Lab Chronicle

Client: Haley & Aldrich, Inc.

Project/Site: CCR Groundwater Monitoring AB Brown

Job ID: 180-138465-1

Laboratory References:

TAL PIT = Eurofins Pittsburgh, 301 Alpha Drive, RIDC Park, Pittsburgh, PA 15238, TEL (412)963-7058

TAL SL = Eurofins St. Louis, 13715 Rider Trail North, Earth City, MO 63045, TEL (314)298-8566

Analyst References:

Lab: TAL PIT

Batch Type: Prep

EMR = Elizabeth Rarick

RJR = Ron Rosenbaum

Batch Type: Analysis

HEK = Hope Kiesling

JCR = Jessica Rodgers

LWM = Larry Matko

RJR = Ron Rosenbaum

RSK = Robert Kurtz

Lab: TAL SL

Batch Type: Prep

MS = Matthew Swaringam

Batch Type: Analysis

EMH = Elizabeth Hoerchler

FLC = Fernando Cruz

1

2

3

4

5

6

7

8

9

10

11

12

13

Client Sample Results

Client: Haley & Aldrich, Inc.

Job ID: 180-138465-1

Project/Site: CCR Groundwater Monitoring AB Brown

Client Sample ID: CCR-SP-1

Lab Sample ID: 180-138465-1

Matrix: Water

Date Collected: 05/19/22 06:22

Date Received: 05/20/22 07:45

Method: EPA 9056A - Anions, Ion Chromatography

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Chloride	100		1.0	0.71	mg/L			06/03/22 23:51	1
Fluoride	0.17		0.10	0.026	mg/L			06/03/22 23:51	1
Sulfate	530		1.0	0.76	mg/L			06/03/22 23:51	1

Method: EPA 6020A - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Antimony	ND		0.0020	0.00051	mg/L			06/01/22 10:30	1
Arsenic	0.0040		0.0010	0.00028	mg/L			06/01/22 10:30	1
Barium	0.094		0.010	0.0031	mg/L			06/01/22 10:30	1
Beryllium	ND		0.0010	0.00027	mg/L			06/01/22 10:30	1
Boron	0.31		0.080	0.060	mg/L			06/01/22 10:30	1
Cadmium	ND		0.0010	0.00022	mg/L			06/01/22 10:30	1
Calcium	240		0.50	0.13	mg/L			06/01/22 10:30	1
Chromium	ND		0.0020	0.0015	mg/L			06/01/22 10:30	1
Cobalt	0.0081		0.00050	0.00026	mg/L			06/01/22 10:30	1
Lead	0.00021 J		0.0010	0.00017	mg/L			06/01/22 10:30	1
Lithium	0.0043 J		0.0050	0.00083	mg/L			06/01/22 10:30	1
Molybdenum	0.00092 J		0.0050	0.00061	mg/L			06/01/22 10:30	1
Selenium	ND		0.0050	0.00074	mg/L			06/01/22 10:30	1
Thallium	ND		0.0010	0.00047	mg/L			06/01/22 10:30	1

Method: EPA 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	ND		0.00020	0.00013	mg/L			06/02/22 07:03	1

General Chemistry

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Total Dissolved Solids	1600		10	10	mg/L			05/23/22 16:48	1
Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
pH	7.6	HF	0.1	0.1	SU			05/24/22 14:45	1

Method: 9315 - Radium-226 (GFPC)

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			(2σ+/-)	(2σ+/-)						
Radium-226	0.199	U	0.183	0.184	1.00	0.281	pCi/L	05/25/22 10:59	06/16/22 08:18	1
Carrier	%Yield	Qualifier	Limits					Prepared	Analyzed	Dil Fac
Ba Carrier	92.8		40 - 110					05/25/22 10:59	06/16/22 08:18	1

Method: 9320 - Radium-228 (GFPC)

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			(2σ+/-)	(2σ+/-)						
Radium-228	0.477	U	0.379	0.382	1.00	0.579	pCi/L	05/25/22 11:43	06/14/22 15:29	1
Carrier	%Yield	Qualifier	Limits					Prepared	Analyzed	Dil Fac
Ba Carrier	92.8		40 - 110					05/25/22 11:43	06/14/22 15:29	1
Y Carrier	83.4		40 - 110					05/25/22 11:43	06/14/22 15:29	1

Eurofins Pittsburgh

Client Sample Results

Client: Haley & Aldrich, Inc.

Job ID: 180-138465-1

Project/Site: CCR Groundwater Monitoring AB Brown

Client Sample ID: CCR-SP-1

Lab Sample ID: 180-138465-1

Matrix: Water

Date Collected: 05/19/22 06:22

Date Received: 05/20/22 07:45

Method: Ra226_Ra228 - Combined Radium-226 and Radium-228

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			(2σ+/-)	(2σ+/-)						
Combined Radium 226 + 228	0.676		0.421	0.424	5.00	0.579	pCi/L		06/16/22 17:51	1

Client Sample ID: CCR-SP-2

Lab Sample ID: 180-138465-2

Matrix: Water

Date Collected: 05/19/22 07:10

Date Received: 05/20/22 07:45

Method: EPA 9056A - Anions, Ion Chromatography

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Chloride	53		1.0	0.71	mg/L			06/04/22 00:35	1
Fluoride	0.24		0.10	0.026	mg/L			06/04/22 00:35	1
Sulfate	260		1.0	0.76	mg/L			06/04/22 00:35	1

Method: EPA 6020A - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Antimony	ND		0.0020	0.00051	mg/L		06/01/22 10:30	06/09/22 14:12	1
Arsenic	0.016		0.0010	0.00028	mg/L		06/01/22 10:30	06/09/22 14:12	1
Barium	0.081		0.010	0.0031	mg/L		06/01/22 10:30	06/09/22 14:12	1
Beryllium	ND		0.0010	0.00027	mg/L		06/01/22 10:30	06/09/22 14:12	1
Boron	0.12		0.080	0.060	mg/L		06/01/22 10:30	06/10/22 11:01	1
Cadmium	ND		0.0010	0.00022	mg/L		06/01/22 10:30	06/09/22 14:12	1
Calcium	180		0.50	0.13	mg/L		06/01/22 10:30	06/09/22 14:12	1
Chromium	0.0016	J B	0.0020	0.0015	mg/L		06/01/22 10:30	06/09/22 14:12	1
Cobalt	0.00087		0.00050	0.00026	mg/L		06/01/22 10:30	06/09/22 14:12	1
Lead	0.00071	J	0.0010	0.00017	mg/L		06/01/22 10:30	06/09/22 14:12	1
Lithium	0.0056		0.0050	0.00083	mg/L		06/01/22 10:30	06/09/22 14:12	1
Molybdenum	0.0017	J	0.0050	0.00061	mg/L		06/01/22 10:30	06/09/22 14:12	1
Selenium	ND		0.0050	0.00074	mg/L		06/01/22 10:30	06/09/22 14:12	1
Thallium	ND		0.0010	0.00047	mg/L		06/01/22 10:30	06/09/22 14:12	1

Method: EPA 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	ND		0.00020	0.00013	mg/L		06/02/22 07:03	06/02/22 16:15	1

General Chemistry

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Total Dissolved Solids	940		10	10	mg/L			05/23/22 12:46	1
Analyte	Result	Qualifier	RL	RL	Unit	D	Prepared	Analyzed	Dil Fac
pH	7.1	HF	0.1	0.1	SU			05/26/22 13:17	1

Method: 9315 - Radium-226 (GFPC)

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			(2σ+/-)	(2σ+/-)						
Radium-226	0.0175	U	0.199	0.199	1.00	0.387	pCi/L	05/25/22 10:59	06/16/22 08:18	1
Carrier	%Yield	Qualifier	Limits					Prepared	Analyzed	Dil Fac
Ba Carrier	77.6		40 - 110					05/25/22 10:59	06/16/22 08:18	1

Eurofins Pittsburgh

Client Sample Results

Client: Haley & Aldrich, Inc.

Job ID: 180-138465-1

Project/Site: CCR Groundwater Monitoring AB Brown

Client Sample ID: CCR-SP-2

Lab Sample ID: 180-138465-2

Date Collected: 05/19/22 07:10

Matrix: Water

Date Received: 05/20/22 07:45

Method: 9320 - Radium-228 (GFPC)

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			Uncert. (2σ+/-)	Uncert. (2σ+/-)						
Radium-228	0.334	U	0.495	0.496	1.00	0.835	pCi/L	05/25/22 11:43	06/14/22 15:29	1
Carrier										
Ba Carrier	77.6		40 - 110					05/25/22 11:43	06/14/22 15:29	1
Y Carrier	87.9		40 - 110					05/25/22 11:43	06/14/22 15:29	1

Method: Ra226_Ra228 - Combined Radium-226 and Radium-228

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			Uncert. (2σ+/-)	Uncert. (2σ+/-)						
Combined Radium 226 + 228	0.351	U	0.534	0.534	5.00	0.835	pCi/L		06/16/22 17:51	1

Client Sample ID: CCR-SP-3

Lab Sample ID: 180-138465-3

Date Collected: 05/19/22 07:55

Matrix: Water

Date Received: 05/20/22 07:45

Method: EPA 9056A - Anions, Ion Chromatography

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Chloride	12		1.0	0.71	mg/L			06/02/22 01:55	1
Fluoride	0.41		0.10	0.026	mg/L			06/02/22 01:55	1
Sulfate	28		1.0	0.76	mg/L			06/04/22 00:50	1

Method: EPA 6020A - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Antimony	ND		0.0020	0.00051	mg/L		06/01/22 10:30	06/09/22 14:16	1
Arsenic	0.0071		0.0010	0.00028	mg/L		06/01/22 10:30	06/09/22 14:16	1
Barium	0.080		0.010	0.0031	mg/L		06/01/22 10:30	06/09/22 14:16	1
Beryllium	ND		0.0010	0.00027	mg/L		06/01/22 10:30	06/09/22 14:16	1
Boron	ND		0.080	0.060	mg/L		06/01/22 10:30	06/10/22 11:03	1
Cadmium	ND		0.0010	0.00022	mg/L		06/01/22 10:30	06/09/22 14:16	1
Calcium	100		0.50	0.13	mg/L		06/01/22 10:30	06/09/22 14:16	1
Chromium	ND		0.0020	0.0015	mg/L		06/01/22 10:30	06/09/22 14:16	1
Cobalt	0.0011		0.00050	0.00026	mg/L		06/01/22 10:30	06/09/22 14:16	1
Lead	0.00026 J		0.0010	0.00017	mg/L		06/01/22 10:30	06/09/22 14:16	1
Lithium	0.0018 J		0.0050	0.00083	mg/L		06/01/22 10:30	06/09/22 14:16	1
Molybdenum	0.0042 J		0.0050	0.00061	mg/L		06/01/22 10:30	06/09/22 14:16	1
Selenium	ND		0.0050	0.00074	mg/L		06/01/22 10:30	06/09/22 14:16	1
Thallium	ND		0.0010	0.00047	mg/L		06/01/22 10:30	06/09/22 14:16	1

Method: EPA 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	ND		0.00020	0.00013	mg/L		06/02/22 07:03	06/02/22 16:16	1

General Chemistry

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Total Dissolved Solids	420		10	10	mg/L			05/23/22 16:48	1
pH	7.3 HF		0.1	0.1	SU			05/26/22 13:19	1

Eurofins Pittsburgh

Client Sample Results

Client: Haley & Aldrich, Inc.

Job ID: 180-138465-1

Project/Site: CCR Groundwater Monitoring AB Brown

Client Sample ID: CCR-SP-3

Lab Sample ID: 180-138465-3

Matrix: Water

Date Collected: 05/19/22 07:55

Date Received: 05/20/22 07:45

Method: 9315 - Radium-226 (GFPC)

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			Uncert. (2σ+/-)	Uncert. (2σ+/-)						
Radium-226	0.0775	U	0.143	0.143	1.00	0.251	pCi/L	05/25/22 10:59	06/16/22 08:18	1
Carrier	%Yield	Qualifier	Limits					Prepared	Analyzed	Dil Fac
Ba Carrier	95.3		40 - 110					05/25/22 10:59	06/16/22 08:18	1

Method: 9320 - Radium-228 (GFPC)

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			Uncert. (2σ+/-)	Uncert. (2σ+/-)						
Radium-228	0.431	U	0.325	0.327	1.00	0.499	pCi/L	05/25/22 11:43	06/14/22 15:30	1
Carrier	%Yield	Qualifier	Limits					Prepared	Analyzed	Dil Fac
Ba Carrier	95.3		40 - 110					05/25/22 11:43	06/14/22 15:30	1
Y Carrier	89.0		40 - 110					05/25/22 11:43	06/14/22 15:30	1

Method: Ra226_Ra228 - Combined Radium-226 and Radium-228

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			Uncert. (2σ+/-)	Uncert. (2σ+/-)						
Combined Radium 226 + 228	0.509		0.355	0.357	5.00	0.499	pCi/L		06/16/22 17:51	1

Client Sample ID: DUPLICATE-2

Lab Sample ID: 180-138465-4

Matrix: Water

Date Collected: 05/19/22 00:00

Date Received: 05/20/22 07:45

Method: EPA 9056A - Anions, Ion Chromatography

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
			Uncert. (2σ+/-)						
Chloride	12		1.0	0.71	mg/L			06/02/22 02:25	1
Fluoride	0.34		0.10	0.026	mg/L			06/02/22 02:25	1
Sulfate	25		1.0	0.76	mg/L			06/04/22 01:05	1

Method: EPA 6020A - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac	
			Uncert. (2σ+/-)							
Antimony	ND		0.0020	0.00051	mg/L			06/01/22 10:30	06/09/22 14:19	1
Arsenic	0.0072		0.0010	0.00028	mg/L			06/01/22 10:30	06/09/22 14:19	1
Barium	0.077		0.010	0.0031	mg/L			06/01/22 10:30	06/09/22 14:19	1
Beryllium	ND		0.0010	0.00027	mg/L			06/01/22 10:30	06/09/22 14:19	1
Boron	ND		0.080	0.060	mg/L			06/01/22 10:30	06/10/22 11:11	1
Cadmium	ND		0.0010	0.00022	mg/L			06/01/22 10:30	06/09/22 14:19	1
Calcium	96		0.50	0.13	mg/L			06/01/22 10:30	06/09/22 14:19	1
Chromium	ND		0.0020	0.0015	mg/L			06/01/22 10:30	06/09/22 14:19	1
Cobalt	0.0010		0.00050	0.00026	mg/L			06/01/22 10:30	06/09/22 14:19	1
Lead	0.00025	J	0.0010	0.00017	mg/L			06/01/22 10:30	06/09/22 14:19	1
Lithium	0.0019	J	0.0050	0.00083	mg/L			06/01/22 10:30	06/09/22 14:19	1
Molybdenum	0.0043	J	0.0050	0.00061	mg/L			06/01/22 10:30	06/09/22 14:19	1
Selenium	ND		0.0050	0.00074	mg/L			06/01/22 10:30	06/09/22 14:19	1
Thallium	ND		0.0010	0.00047	mg/L			06/01/22 10:30	06/09/22 14:19	1

Eurofins Pittsburgh

Client Sample Results

Client: Haley & Aldrich, Inc.

Job ID: 180-138465-1

Project/Site: CCR Groundwater Monitoring AB Brown

Client Sample ID: DUPLICATE-2

Lab Sample ID: 180-138465-4

Matrix: Water

Date Collected: 05/19/22 00:00

Date Received: 05/20/22 07:45

Method: EPA 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	ND		0.00020	0.00013	mg/L	D	06/02/22 07:03	06/02/22 16:20	1

General Chemistry

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Total Dissolved Solids	410		10	10	mg/L	D		05/23/22 16:48	1
pH	7.3	HF	0.1	0.1	SU	D	Prepared	Analyzed	Dil Fac

Method: 9315 - Radium-226 (GFPC)

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			(2σ+/-)	(2σ+/-)						
Radium-226	0.0725	U	0.136	0.136	1.00	0.239	pCi/L	05/25/22 10:59	06/16/22 08:18	1
Carrier	%Yield	Qualifier	Limits					Prepared	Analyzed	Dil Fac
Ba Carrier	97.5		40 - 110					05/25/22 10:59	06/16/22 08:18	1

Method: 9320 - Radium-228 (GFPC)

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			(2σ+/-)	(2σ+/-)						
Radium-228	0.0798	U	0.226	0.226	1.00	0.407	pCi/L	05/25/22 11:43	06/14/22 15:30	1
Carrier	%Yield	Qualifier	Limits					Prepared	Analyzed	Dil Fac
Ba Carrier	97.5		40 - 110					05/25/22 11:43	06/14/22 15:30	1
Y Carrier	87.5		40 - 110					05/25/22 11:43	06/14/22 15:30	1

Method: Ra226_Ra228 - Combined Radium-226 and Radium-228

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			(2σ+/-)	(2σ+/-)						
Combined Radium 226 + 228	0.152	U	0.264	0.264	5.00	0.407	pCi/L		06/16/22 17:51	1

Client Sample ID: FIELD BLANK-2

Lab Sample ID: 180-138465-5

Matrix: Water

Date Collected: 05/19/22 05:57

Date Received: 05/20/22 07:45

Method: EPA 9056A - Anions, Ion Chromatography

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Chloride	1.2		1.0	0.71	mg/L	D		06/02/22 02:54	1
Fluoride	ND		0.10	0.026	mg/L	D		06/02/22 02:54	1
Sulfate	ND		1.0	0.76	mg/L	D		06/02/22 02:54	1

Method: EPA 6020A - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Antimony	ND		0.0020	0.00051	mg/L	D	06/01/22 10:30	06/09/22 14:23	1
Arsenic	ND		0.0010	0.00028	mg/L	D	06/01/22 10:30	06/09/22 14:23	1
Barium	ND		0.010	0.0031	mg/L	D	06/01/22 10:30	06/09/22 14:23	1
Beryllium	ND		0.0010	0.00027	mg/L	D	06/01/22 10:30	06/09/22 14:23	1
Boron	ND		0.080	0.060	mg/L	D	06/01/22 10:30	06/10/22 11:14	1
Cadmium	ND		0.0010	0.00022	mg/L	D	06/01/22 10:30	06/09/22 14:23	1

Eurofins Pittsburgh

Client Sample Results

Client: Haley & Aldrich, Inc.

Job ID: 180-138465-1

Project/Site: CCR Groundwater Monitoring AB Brown

Client Sample ID: FIELD BLANK-2

Lab Sample ID: 180-138465-5

Matrix: Water

Date Collected: 05/19/22 05:57

Date Received: 05/20/22 07:45

Method: EPA 6020A - Metals (ICP/MS) - Total Recoverable (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Calcium	ND		0.50	0.13	mg/L		06/01/22 10:30	06/09/22 14:23	1
Chromium	ND		0.0020	0.0015	mg/L		06/01/22 10:30	06/09/22 14:23	1
Cobalt	ND		0.00050	0.00026	mg/L		06/01/22 10:30	06/09/22 14:23	1
Lead	ND		0.0010	0.00017	mg/L		06/01/22 10:30	06/09/22 14:23	1
Lithium	ND		0.0050	0.00083	mg/L		06/01/22 10:30	06/09/22 14:23	1
Molybdenum	ND		0.0050	0.00061	mg/L		06/01/22 10:30	06/09/22 14:23	1
Selenium	ND		0.0050	0.00074	mg/L		06/01/22 10:30	06/09/22 14:23	1
Thallium	ND		0.0010	0.00047	mg/L		06/01/22 10:30	06/09/22 14:23	1

Method: EPA 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	ND		0.00020	0.00013	mg/L		06/02/22 07:03	06/02/22 16:21	1

General Chemistry

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Total Dissolved Solids	ND		10	10	mg/L			05/23/22 16:48	1
Analyte	Result	Qualifier	RL	RL	Unit	D	Prepared	Analyzed	Dil Fac
pH	3.7	HF	0.1	0.1	SU			05/24/22 14:54	1

Method: 9315 - Radium-226 (GFPC)

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			(2σ+/-)	(2σ+/-)						
Radium-226	0.0381	U	0.138	0.138	1.00	0.256	pCi/L	05/25/22 10:59	06/16/22 08:19	1
<i>Carrier</i>										
Ba Carrier	%Yield	Qualifier	Limits					Prepared	Analyzed	Dil Fac
	93.8		40 - 110					05/25/22 10:59	06/16/22 08:19	1

Method: 9320 - Radium-228 (GFPC)

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			(2σ+/-)	(2σ+/-)						
Radium-228	-0.0153	U	0.227	0.227	1.00	0.435	pCi/L	05/25/22 11:43	06/14/22 15:30	1
<i>Carrier</i>										
Ba Carrier	%Yield	Qualifier	Limits					Prepared	Analyzed	Dil Fac
	93.8		40 - 110					05/25/22 11:43	06/14/22 15:30	1
Y Carrier			40 - 110					05/25/22 11:43	06/14/22 15:30	1

Method: Ra226_Ra228 - Combined Radium-226 and Radium-228

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			(2σ+/-)	(2σ+/-)						
Combined Radium 226 + 228	0.0228	U	0.266	0.266	5.00	0.435	pCi/L		06/16/22 17:51	1

Client Sample ID: MH-1

Lab Sample ID: 180-138465-6

Matrix: Water

Date Collected: 05/19/22 09:10

Date Received: 05/20/22 07:45

Method: EPA 9056A - Anions, Ion Chromatography

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Chloride	520		5.0	3.6	mg/L		06/02/22 03:09		5

Eurofins Pittsburgh

Client Sample Results

Client: Haley & Aldrich, Inc.

Job ID: 180-138465-1

Project/Site: CCR Groundwater Monitoring AB Brown

Client Sample ID: MH-1

Lab Sample ID: 180-138465-6

Matrix: Water

Date Collected: 05/19/22 09:10

Date Received: 05/20/22 07:45

Method: EPA 9056A - Anions, Ion Chromatography (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Fluoride	0.53		0.50	0.13	mg/L			06/02/22 03:09	5
Sulfate	2900		50	38	mg/L			06/04/22 01:20	50

Method: EPA 6020A - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Antimony	ND		0.0020	0.00051	mg/L			06/09/22 14:26	1
Arsenic	0.00062	J		0.0010	mg/L			06/09/22 14:26	1
Barium	0.025			0.0031	mg/L			06/09/22 14:26	1
Beryllium	ND		0.0010	0.00027	mg/L			06/09/22 14:26	1
Boron	13		0.80	0.60	mg/L			06/10/22 11:16	10
Cadmium	0.00025	J		0.00022	mg/L			06/09/22 14:26	1
Calcium	400		0.50	0.13	mg/L			06/09/22 14:26	1
Chromium	ND		0.0020	0.0015	mg/L			06/09/22 14:26	1
Cobalt	0.0021			0.00050	mg/L			06/09/22 14:26	1
Lead	ND		0.0010	0.00017	mg/L			06/09/22 14:26	1
Lithium	0.036		0.0050	0.00083	mg/L			06/09/22 14:26	1
Molybdenum	1.4		0.0050	0.00061	mg/L			06/09/22 14:26	1
Selenium	ND		0.0050	0.00074	mg/L			06/09/22 14:26	1
Thallium	ND		0.0010	0.00047	mg/L			06/09/22 14:26	1

Method: EPA 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	ND		0.00020	0.00013	mg/L			06/02/22 16:22	1

General Chemistry

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Total Dissolved Solids	5500		40	40	mg/L			05/23/22 16:48	1
Analyte	Result	Qualifier	RL	RL	Unit	D	Prepared	Analyzed	Dil Fac
pH	7.7	HF	0.1	0.1	SU			05/24/22 14:59	1

Method: 9315 - Radium-226 (GFPC)

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			Uncert. (2σ+/-)	Uncert. (2σ+/-)						
Radium-226	0.000	U	0.140	0.140	1.00	0.276	pCi/L	05/25/22 10:59	06/16/22 08:19	1
Carrier	%Yield	Qualifier	Limits					Prepared	Analyzed	Dil Fac
Ba Carrier	87.0		40 - 110					05/25/22 10:59	06/16/22 08:19	1

Method: 9320 - Radium-228 (GFPC)

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			Uncert. (2σ+/-)	Uncert. (2σ+/-)						
Radium-228	0.162	U	0.293	0.293	1.00	0.507	pCi/L	05/25/22 11:43	06/14/22 15:31	1
Carrier	%Yield	Qualifier	Limits					Prepared	Analyzed	Dil Fac
Ba Carrier	87.0		40 - 110					05/25/22 11:43	06/14/22 15:31	1
Y Carrier	89.7		40 - 110					05/25/22 11:43	06/14/22 15:31	1

Eurofins Pittsburgh

Client Sample Results

Client: Haley & Aldrich, Inc.

Job ID: 180-138465-1

Project/Site: CCR Groundwater Monitoring AB Brown

Client Sample ID: MH-1

Lab Sample ID: 180-138465-6

Matrix: Water

Date Collected: 05/19/22 09:10

Date Received: 05/20/22 07:45

Method: Ra226_Ra228 - Combined Radium-226 and Radium-228

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			(2σ+/-)	(2σ+/-)						
Combined Radium 226 + 228	0.162	U	0.325	0.325	5.00	0.507	pCi/L		06/16/22 17:51	1

Client Sample ID: MH-2

Lab Sample ID: 180-138465-7

Matrix: Water

Date Collected: 05/19/22 08:40

Date Received: 05/20/22 07:45

Method: EPA 9056A - Anions, Ion Chromatography

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Chloride	580		10	7.1	mg/L			06/02/22 03:39	10
Fluoride	4.1		1.0	0.26	mg/L			06/02/22 03:39	10
Sulfate	4500		10	7.6	mg/L			06/04/22 01:35	10

Method: EPA 6020A - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Antimony	0.0017	J	0.0020	0.00051	mg/L		06/01/22 10:30	06/09/22 14:51	1
Arsenic	0.0015		0.0010	0.00028	mg/L		06/01/22 10:30	06/09/22 14:51	1
Barium	0.12		0.010	0.0031	mg/L		06/01/22 10:30	06/09/22 14:51	1
Beryllium	ND		0.0010	0.00027	mg/L		06/01/22 10:30	06/09/22 14:51	1
Boron	13		0.80	0.60	mg/L		06/01/22 10:30	06/10/22 11:19	10
Cadmium	ND		0.0010	0.00022	mg/L		06/01/22 10:30	06/09/22 14:51	1
Calcium	340		0.50	0.13	mg/L		06/01/22 10:30	06/09/22 14:51	1
Chromium	0.027	B	0.0020	0.0015	mg/L		06/01/22 10:30	06/09/22 14:51	1
Cobalt	ND		0.00050	0.00026	mg/L		06/01/22 10:30	06/09/22 14:51	1
Lead	0.00075	J	0.0010	0.00017	mg/L		06/01/22 10:30	06/09/22 14:51	1
Lithium	0.073		0.0050	0.00083	mg/L		06/01/22 10:30	06/09/22 14:51	1
Molybdenum	0.82		0.0050	0.00061	mg/L		06/01/22 10:30	06/09/22 14:51	1
Selenium	0.35		0.0050	0.00074	mg/L		06/01/22 10:30	06/09/22 14:51	1
Thallium	ND		0.0010	0.00047	mg/L		06/01/22 10:30	06/09/22 14:51	1

Method: EPA 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	ND		0.00020	0.00013	mg/L		06/02/22 07:03	06/02/22 16:23	1

General Chemistry

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Total Dissolved Solids	11000		100	100	mg/L			05/23/22 16:48	1
Analyte	Result	Qualifier	RL	RL	Unit	D	Prepared	Analyzed	Dil Fac
pH	12.5	HF	0.1	0.1	SU			05/24/22 15:03	1

Method: 9315 - Radium-226 (GFPC)

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			(2σ+/-)	(2σ+/-)						
Radium-226	4.56		1.04	1.12	1.00	0.688	pCi/L	05/25/22 14:50	06/16/22 07:58	1
Carrier	%Yield	Qualifier	Limits					Prepared	Analyzed	Dil Fac
Ba Carrier	98.3		40 - 110					05/25/22 14:50	06/16/22 07:58	1

Eurofins Pittsburgh

Client Sample Results

Client: Haley & Aldrich, Inc.

Job ID: 180-138465-1

Project/Site: CCR Groundwater Monitoring AB Brown

Client Sample ID: MH-2

Lab Sample ID: 180-138465-7

Matrix: Water

Date Collected: 05/19/22 08:40

Date Received: 05/20/22 07:45

Method: 9320 - Radium-228 (GFPC)

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			Uncert. (2σ+/-)	Uncert. (2σ+/-)						
Radium-228	0.584	U G	1.04	1.04	1.00	1.80	pCi/L	05/25/22 15:23	06/14/22 16:01	1
Carrier	%Yield	Qualifier	Limits					Prepared	Analyzed	Dil Fac
Ba Carrier	98.3		40 - 110					05/25/22 15:23	06/14/22 16:01	1
Y Carrier	81.1		40 - 110					05/25/22 15:23	06/14/22 16:01	1

Method: Ra226_Ra228 - Combined Radium-226 and Radium-228

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			Uncert. (2σ+/-)	Uncert. (2σ+/-)						
Combined Radium 226 + 228	5.14		1.47	1.53	5.00	1.80	pCi/L		06/16/22 17:51	1

Client Sample ID: FD-PZ-1

Lab Sample ID: 180-138465-8

Matrix: Water

Date Collected: 05/19/22 09:35

Date Received: 05/20/22 07:45

Method: EPA 9056A - Anions, Ion Chromatography

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Chloride	460		5.0	3.6	mg/L			06/02/22 04:09	5
Fluoride	0.65		0.50	0.13	mg/L			06/02/22 04:09	5
Sulfate	3000		50	38	mg/L			06/04/22 01:50	50

Method: EPA 6020A - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Antimony	0.024		0.020	0.0051	mg/L		06/01/22 10:30	06/09/22 15:05	1
Arsenic	0.032		0.010	0.0028	mg/L		06/01/22 10:30	06/09/22 15:05	1
Barium	0.26		0.10	0.031	mg/L		06/01/22 10:30	06/09/22 15:05	1
Beryllium	0.0033	J	0.010	0.0027	mg/L		06/01/22 10:30	06/09/22 15:05	1
Boron	8.8		0.80	0.60	mg/L		06/01/22 10:30	06/10/22 11:22	1
Cadmium	0.0049	J	0.010	0.0022	mg/L		06/01/22 10:30	06/09/22 15:05	1
Calcium	640		5.0	1.3	mg/L		06/01/22 10:30	06/09/22 15:05	1
Chromium	0.085	B	0.020	0.015	mg/L		06/01/22 10:30	06/09/22 15:05	1
Cobalt	0.033		0.0050	0.0026	mg/L		06/01/22 10:30	06/09/22 15:05	1
Lead	0.044		0.010	0.0017	mg/L		06/01/22 10:30	06/09/22 15:05	1
Lithium	0.098		0.050	0.0083	mg/L		06/01/22 10:30	06/09/22 15:05	1
Molybdenum	0.42		0.050	0.0061	mg/L		06/01/22 10:30	06/09/22 15:05	1
Selenium	ND		0.050	0.0074	mg/L		06/01/22 10:30	06/09/22 15:05	1
Thallium	ND		0.010	0.0047	mg/L		06/01/22 10:30	06/09/22 15:05	1

Method: EPA 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	0.00049		0.00020	0.00013	mg/L		06/02/22 07:03	06/02/22 16:24	1

General Chemistry

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Total Dissolved Solids	5700		40	40	mg/L			05/23/22 16:48	1
pH	7.8	HF	0.1	0.1	SU			05/24/22 15:08	1

Eurofins Pittsburgh

Client Sample Results

Client: Haley & Aldrich, Inc.

Job ID: 180-138465-1

Project/Site: CCR Groundwater Monitoring AB Brown

Client Sample ID: FD-PZ-1

Lab Sample ID: 180-138465-8

Date Collected: 05/19/22 09:35

Matrix: Water

Date Received: 05/20/22 07:45

Method: 9315 - Radium-226 (GFPC)

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			Uncert. (2σ+/-)	Uncert. (2σ+/-)						
Radium-226	8.90		1.54	1.73	1.00	0.984	pCi/L	05/25/22 14:50	06/16/22 07:58	1
Carrier	%Yield	Qualifier	Limits					Prepared	Analyzed	Dil Fac
Ba Carrier	89.0		40 - 110					05/25/22 14:50	06/16/22 07:58	1

Method: 9320 - Radium-228 (GFPC)

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			Uncert. (2σ+/-)	Uncert. (2σ+/-)						
Radium-228	5.74	G	1.80	1.87	1.00	2.03	pCi/L	05/25/22 15:23	06/14/22 16:01	1
Carrier	%Yield	Qualifier	Limits					Prepared	Analyzed	Dil Fac
Ba Carrier	90.5		40 - 110					05/25/22 15:23	06/14/22 16:01	1
Y Carrier	83.7		40 - 110					05/25/22 15:23	06/14/22 16:01	1

Method: Ra226_Ra228 - Combined Radium-226 and Radium-228

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			Uncert. (2σ+/-)	Uncert. (2σ+/-)						
Combined Radium 226 + 228	14.6		2.37	2.55	5.00	2.03	pCi/L		06/16/22 17:51	1

Client Sample ID: FD-PZ-2

Lab Sample ID: 180-138465-9

Date Collected: 05/19/22 10:22

Matrix: Water

Date Received: 05/20/22 07:45

Method: EPA 9056A - Anions, Ion Chromatography

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
			Uncert. (2σ+/-)	Uncert. (2σ+/-)					
Chloride	6.0		1.0	0.71	mg/L			06/02/22 05:08	1
Fluoride	0.19		0.10	0.026	mg/L			06/02/22 05:08	1
Sulfate	9.8		1.0	0.76	mg/L			06/04/22 02:34	1

Method: EPA 6020A - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac	
			Uncert. (2σ+/-)	Uncert. (2σ+/-)						
Antimony	ND		0.0020	0.00051	mg/L			06/01/22 10:30	06/09/22 15:08	1
Arsenic	0.00079 J		0.0010	0.00028	mg/L			06/01/22 10:30	06/09/22 15:08	1
Barium	0.15		0.010	0.0031	mg/L			06/01/22 10:30	06/09/22 15:08	1
Beryllium	ND		0.0010	0.00027	mg/L			06/01/22 10:30	06/09/22 15:08	1
Boron	0.068 J		0.080	0.060	mg/L			06/01/22 10:30	06/10/22 11:24	1
Cadmium	ND		0.0010	0.00022	mg/L			06/01/22 10:30	06/09/22 15:08	1
Calcium	110		0.50	0.13	mg/L			06/01/22 10:30	06/09/22 15:08	1
Chromium	0.0026 B		0.0020	0.0015	mg/L			06/01/22 10:30	06/09/22 15:08	1
Cobalt	0.0017		0.00050	0.00026	mg/L			06/01/22 10:30	06/09/22 15:08	1
Lead	0.0012		0.0010	0.00017	mg/L			06/01/22 10:30	06/09/22 15:08	1
Lithium	0.0060		0.0050	0.00083	mg/L			06/01/22 10:30	06/09/22 15:08	1
Molybdenum	0.0019 J		0.0050	0.00061	mg/L			06/01/22 10:30	06/09/22 15:08	1
Selenium	ND		0.0050	0.00074	mg/L			06/01/22 10:30	06/09/22 15:08	1
Thallium	ND		0.0010	0.00047	mg/L			06/01/22 10:30	06/09/22 15:08	1

Eurofins Pittsburgh

Client Sample Results

Client: Haley & Aldrich, Inc.

Job ID: 180-138465-1

Project/Site: CCR Groundwater Monitoring AB Brown

Client Sample ID: FD-PZ-2

Lab Sample ID: 180-138465-9

Matrix: Water

Date Collected: 05/19/22 10:22

Date Received: 05/20/22 07:45

Method: EPA 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	ND		0.00020	0.00013	mg/L		06/02/22 07:03	06/02/22 16:25	1

General Chemistry

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Total Dissolved Solids	460		10	10	mg/L			05/23/22 16:48	1
pH	7.8	HF	0.1	0.1	SU			05/24/22 15:14	1

Method: 9315 - Radium-226 (GFPC)

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			(2σ+/-)	(2σ+/-)						
Radium-226	0.312	U	0.255	0.256	1.00	0.369	pCi/L	05/25/22 10:59	06/16/22 08:19	1
Carrier	%Yield	Qualifier	Limits					Prepared	Analyzed	Dil Fac
Ba Carrier	94.0		40 - 110					05/25/22 10:59	06/16/22 08:19	1

Method: 9320 - Radium-228 (GFPC)

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			(2σ+/-)	(2σ+/-)						
Radium-228	0.530	U	0.578	0.580	1.00	0.941	pCi/L	05/25/22 11:43	06/14/22 15:31	1
Carrier	%Yield	Qualifier	Limits					Prepared	Analyzed	Dil Fac
Ba Carrier	94.0		40 - 110					05/25/22 11:43	06/14/22 15:31	1
Y Carrier	86.7		40 - 110					05/25/22 11:43	06/14/22 15:31	1

Method: Ra226_Ra228 - Combined Radium-226 and Radium-228

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			(2σ+/-)	(2σ+/-)						
Combined Radium 226 + 228	0.842	U	0.632	0.634	5.00	0.941	pCi/L		06/16/22 17:51	1

Eurofins Pittsburgh

QC Sample Results

Client: Haley & Aldrich, Inc.

Job ID: 180-138465-1

Project/Site: CCR Groundwater Monitoring AB Brown

Method: EPA 9056A - Anions, Ion Chromatography

Lab Sample ID: MB 180-400512/7

Matrix: Water

Analysis Batch: 400512

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Chloride	ND		1.0	0.71	mg/L			06/01/22 17:10	1
Fluoride	ND		0.10	0.026	mg/L			06/01/22 17:10	1
Sulfate	ND		1.0	0.76	mg/L			06/01/22 17:10	1

Lab Sample ID: LCS 180-400512/6

Matrix: Water

Analysis Batch: 400512

Analyte	Spike Added	LCS		Unit	D	%Rec	%Rec Limits
		Result	Qualifier				
Chloride	50.0	49.9		mg/L		100	80 - 120
Fluoride	2.50	2.48		mg/L		99	80 - 120
Sulfate	50.0	49.7		mg/L		99	80 - 120

Lab Sample ID: MB 180-400775/48

Matrix: Water

Analysis Batch: 400775

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Chloride	ND		1.0	0.71	mg/L			06/03/22 22:06	1
Fluoride	ND		0.10	0.026	mg/L			06/03/22 22:06	1
Sulfate	ND		1.0	0.76	mg/L			06/03/22 22:06	1

Lab Sample ID: LCS 180-400775/47

Matrix: Water

Analysis Batch: 400775

Analyte	Spike Added	LCS		Unit	D	%Rec	%Rec Limits
		Result	Qualifier				
Chloride	50.0	45.5		mg/L		91	80 - 120
Fluoride	2.50	2.42		mg/L		97	80 - 120
Sulfate	50.0	46.4		mg/L		93	80 - 120

Method: EPA 6020A - Metals (ICP/MS)

Lab Sample ID: MB 180-400451/1-A

Matrix: Water

Analysis Batch: 401512

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Antimony	ND		0.0020	0.00051	mg/L		06/01/22 10:30	06/09/22 12:59	1
Arsenic	ND		0.0010	0.00028	mg/L		06/01/22 10:30	06/09/22 12:59	1
Barium	ND		0.010	0.0031	mg/L		06/01/22 10:30	06/09/22 12:59	1
Beryllium	ND		0.0010	0.00027	mg/L		06/01/22 10:30	06/09/22 12:59	1
Cadmium	ND		0.0010	0.00022	mg/L		06/01/22 10:30	06/09/22 12:59	1
Calcium	ND		0.50	0.13	mg/L		06/01/22 10:30	06/09/22 12:59	1
Chromium	0.00163	J	0.0020	0.0015	mg/L		06/01/22 10:30	06/09/22 12:59	1
Cobalt	ND		0.00050	0.00026	mg/L		06/01/22 10:30	06/09/22 12:59	1
Lead	ND		0.0010	0.00017	mg/L		06/01/22 10:30	06/09/22 12:59	1
Lithium	ND		0.0050	0.00083	mg/L		06/01/22 10:30	06/09/22 12:59	1
Molybdenum	ND		0.0050	0.00061	mg/L		06/01/22 10:30	06/09/22 12:59	1
Selenium	ND		0.0050	0.00074	mg/L		06/01/22 10:30	06/09/22 12:59	1

Client Sample ID: Method Blank
Prep Type: Total Recoverable
Prep Batch: 400451

Eurofins Pittsburgh

QC Sample Results

Client: Haley & Aldrich, Inc.

Job ID: 180-138465-1

Project/Site: CCR Groundwater Monitoring AB Brown

Method: EPA 6020A - Metals (ICP/MS) (Continued)

Lab Sample ID: MB 180-400451/1-A

Matrix: Water

Analysis Batch: 401512

Analyte	MB	MB	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
	Result	Qualifier									
Thallium	ND				0.0010	0.00047	mg/L		06/01/22 10:30	06/09/22 12:59	1

Lab Sample ID: MB 180-400451/1-A

Matrix: Water

Analysis Batch: 401660

Analyte	MB	MB	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
	Result	Qualifier									
Boron	ND				0.080	0.060	mg/L		06/01/22 10:30	06/10/22 10:43	1

Lab Sample ID: LCS 180-400451/2-A

Matrix: Water

Analysis Batch: 401512

Analyte	Spike Added	LCS	LCS	Result	Qualifier	Unit	D	%Rec	Limits	
		Result	Qualifier							
Antimony	0.250	0.265				mg/L		106	80 - 120	
Arsenic	1.00	0.993				mg/L		99	80 - 120	
Barium	1.00	1.01				mg/L		101	80 - 120	
Beryllium	0.500	0.510				mg/L		102	80 - 120	
Cadmium	0.500	0.510				mg/L		102	80 - 120	
Calcium	25.0	29.0				mg/L		116	80 - 120	
Chromium	0.500	0.513				mg/L		103	80 - 120	
Cobalt	0.500	0.507				mg/L		101	80 - 120	
Lead	0.500	0.507				mg/L		101	80 - 120	
Lithium	0.500	0.484				mg/L		97	80 - 120	
Molybdenum	0.500	0.516				mg/L		103	80 - 120	
Selenium	1.00	1.00				mg/L		100	80 - 120	
Thallium	1.00	1.02				mg/L		102	80 - 120	

Lab Sample ID: LCS 180-400451/2-A

Matrix: Water

Analysis Batch: 401660

Analyte	Spike Added	LCS	LCS	Result	Qualifier	Unit	D	%Rec	Limits	
	Result	Qualifier								
Boron	1.25	1.22				mg/L		97	80 - 120	

Lab Sample ID: 180-138465-1 MS

Matrix: Water

Analysis Batch: 401512

Analyte	Sample	Sample	Spike	MS	MS	Result	Qualifier	Unit	D	%Rec	Limits
	Result	Qualifier	Added	Result	Qualifier						
Antimony	ND		0.250	0.265				mg/L		106	75 - 125
Arsenic	0.0040		1.00	0.996				mg/L		99	75 - 125
Barium	0.094		1.00	1.09				mg/L		99	75 - 125
Beryllium	ND		0.500	0.511				mg/L		102	75 - 125
Cadmium	ND		0.500	0.495				mg/L		99	75 - 125
Calcium	240		25.0	266	4			mg/L		111	75 - 125
Chromium	ND		0.500	0.510				mg/L		102	75 - 125
Cobalt	0.0081		0.500	0.508				mg/L		100	75 - 125
Lead	0.00021	J	0.500	0.505				mg/L		101	75 - 125
Lithium	0.0043	J	0.500	0.486				mg/L		96	75 - 125

Client Sample ID: Lab Control Sample

Prep Type: Total Recoverable

Prep Batch: 400451

Client Sample ID: CCR-SP-1

Prep Type: Total Recoverable

Prep Batch: 400451

QC Sample Results

Client: Haley & Aldrich, Inc.

Job ID: 180-138465-1

Project/Site: CCR Groundwater Monitoring AB Brown

Method: EPA 6020A - Metals (ICP/MS) (Continued)

Lab Sample ID: 180-138465-1 MS

Matrix: Water

Analysis Batch: 401512

Client Sample ID: CCR-SP-1

Prep Type: Total Recoverable

Prep Batch: 400451

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec Limits		
Molybdenum	0.00092	J	0.500	0.515		mg/L		103	75 - 125		
Selenium	ND		1.00	0.953		mg/L		95	75 - 125		
Thallium	ND		1.00	1.02		mg/L		102	75 - 125		

Lab Sample ID: 180-138465-1 MS

Matrix: Water

Analysis Batch: 401660

Client Sample ID: CCR-SP-1

Prep Type: Total Recoverable

Prep Batch: 400451

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec Limits		
Boron	0.31		1.25	1.54		mg/L		99	75 - 125		

Lab Sample ID: 180-138465-1 MSD

Matrix: Water

Analysis Batch: 401512

Client Sample ID: CCR-SP-1

Prep Type: Total Recoverable

Prep Batch: 400451

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec Limits	RPD	RPD Limit
Antimony	ND		0.250	0.264		mg/L		106	75 - 125	0	20
Arsenic	0.0040		1.00	1.02		mg/L		102	75 - 125	3	20
Barium	0.094		1.00	1.13		mg/L		104	75 - 125	4	20
Beryllium	ND		0.500	0.517		mg/L		103	75 - 125	1	20
Cadmium	ND		0.500	0.509		mg/L		102	75 - 125	3	20
Calcium	240		25.0	268.4		mg/L		120	75 - 125	1	20
Chromium	ND		0.500	0.512		mg/L		102	75 - 125	0	20
Cobalt	0.0081		0.500	0.516		mg/L		102	75 - 125	2	20
Lead	0.00021	J	0.500	0.513		mg/L		103	75 - 125	2	20
Lithium	0.0043	J	0.500	0.495		mg/L		98	75 - 125	2	20
Molybdenum	0.00092	J	0.500	0.528		mg/L		105	75 - 125	2	20
Selenium	ND		1.00	0.988		mg/L		99	75 - 125	4	20
Thallium	ND		1.00	1.04		mg/L		104	75 - 125	2	20

Lab Sample ID: 180-138465-1 MSD

Matrix: Water

Analysis Batch: 401660

Client Sample ID: CCR-SP-1

Prep Type: Total Recoverable

Prep Batch: 400451

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec Limits	RPD	RPD Limit
Boron	0.31		1.25	1.52		mg/L		96	75 - 125	2	20

Method: EPA 7470A - Mercury (CVAA)

Lab Sample ID: MB 180-400613/1-A

Matrix: Water

Analysis Batch: 400744

Client Sample ID: Method Blank

Prep Type: Total/NA

Prep Batch: 400613

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	ND		0.00020	0.00013	mg/L		06/02/22 07:03	06/02/22 16:07	1

Eurofins Pittsburgh

QC Sample Results

Client: Haley & Aldrich, Inc.

Job ID: 180-138465-1

Project/Site: CCR Groundwater Monitoring AB Brown

Method: EPA 7470A - Mercury (CVAA) (Continued)

Lab Sample ID: LCS 180-400613/2-A Matrix: Water Analysis Batch: 400744				Client Sample ID: Lab Control Sample Prep Type: Total/NA Prep Batch: 400613					
Analyte		Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits	
Mercury		0.00250	0.00276		mg/L	110		80 - 120	
Lab Sample ID: 180-138465-1 MS Matrix: Water Analysis Batch: 400744						Client Sample ID: CCR-SP-1 Prep Type: Total/NA Prep Batch: 400613			
Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	
Mercury	ND		0.00100	0.000861		mg/L	86	75 - 125	
Lab Sample ID: 180-138465-1 MSD Matrix: Water Analysis Batch: 400744						Client Sample ID: CCR-SP-1 Prep Type: Total/NA Prep Batch: 400613			
Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	RPD RPD Limit
Mercury	ND		0.00100	0.000912		mg/L	91	75 - 125	6 20

Method: EPA 9040C - pH

Lab Sample ID: LCS 180-399828/26 Matrix: Water Analysis Batch: 399828				Client Sample ID: Lab Control Sample Prep Type: Total/NA					
Analyte		Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits	
pH		7.00	7.0		SU	100		99 - 101	
Lab Sample ID: 180-138465-1 DU Matrix: Water Analysis Batch: 399828						Client Sample ID: CCR-SP-1 Prep Type: Total/NA			
Analyte	Sample Result	Sample Qualifier	DU Result	DU Qualifier	Unit	D			RPD RPD Limit
pH	7.6	HF	7.5	HF	SU				0.9 2
Lab Sample ID: LCS 180-400077/1 Matrix: Water Analysis Batch: 400077						Client Sample ID: Lab Control Sample Prep Type: Total/NA			
Analyte		Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits	
pH		7.00	7.0		SU	100		99 - 101	

Method: SM 2540C - Solids, Total Dissolved (TDS)

Lab Sample ID: MB 180-399680/2 Matrix: Water Analysis Batch: 399680				Client Sample ID: Method Blank Prep Type: Total/NA					
Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Total Dissolved Solids	ND		10	10	mg/L		05/23/22 12:46		1

Eurofins Pittsburgh

QC Sample Results

Client: Haley & Aldrich, Inc.

Job ID: 180-138465-1

Project/Site: CCR Groundwater Monitoring AB Brown

Method: SM 2540C - Solids, Total Dissolved (TDS) (Continued)

Lab Sample ID: LCS 180-399680/1

Matrix: Water

Analysis Batch: 399680

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
Total Dissolved Solids	251	256		mg/L	102		85 - 115

Lab Sample ID: MB 180-399706/2

Matrix: Water

Analysis Batch: 399706

Client Sample ID: Method Blank
Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Total Dissolved Solids	ND		10	10	mg/L			05/23/22 16:48	1

Lab Sample ID: LCS 180-399706/1

Matrix: Water

Analysis Batch: 399706

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
Total Dissolved Solids	251	238		mg/L	95		85 - 115

Lab Sample ID: 180-138465-1 DU

Matrix: Water

Analysis Batch: 399706

Client Sample ID: CCR-SP-1
Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	DU Result	DU Qualifier	Unit	D	RPD	Limit
Total Dissolved Solids	1600		1670		mg/L		2	10

Method: 9315 - Radium-226 (GFPC)

Lab Sample ID: MB 160-567238/21-A

Client Sample ID: Method Blank
Prep Type: Total/NA
Prep Batch: 567238

Analysis Batch: 570287

Analyte	MB Result	MB Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			(2σ+/-)	(2σ+/-)						
Radium-226	0.03972	U	0.118	0.118	1.00	0.219	pCi/L	05/25/22 11:37	06/16/22 11:24	1

Carrier	MB %Yield	MB Qualifier	Limits	Prepared	Analyzed	Dil Fac
Ba Carrier	90.5		40 - 110	05/25/22 11:37	06/16/22 11:24	1

Lab Sample ID: LCS 160-567238/1-A

Client Sample ID: Lab Control Sample
Prep Type: Total/NA
Prep Batch: 567238

Analysis Batch: 570287

Analyte	Spike Added	LCS Result	LCS Qual	Count	Total	RL	MDC	Unit	%Rec	%Rec Limits
				(2σ+/-)	(2σ+/-)					
Radium-226	11.3	9.477		1.17	1.00	0.197	pCi/L		84	75 - 125

Carrier	LCSS %Yield	LCSS Qualifier	Limits	Prepared	Analyzed	Dil Fac
Ba Carrier	75.8		40 - 110	05/25/22 11:37	06/16/22 11:24	1

Eurofins Pittsburgh

QC Sample Results

Client: Haley & Aldrich, Inc.

Job ID: 180-138465-1

Project/Site: CCR Groundwater Monitoring AB Brown

Method: 9315 - Radium-226 (GFPC) (Continued)

Lab Sample ID: 180-138465-1 DU

Matrix: Water

Analysis Batch: 570309

Client Sample ID: CCR-SP-1

Prep Type: Total/NA

Prep Batch: 567238

Analyte	Sample	Sample	DU		DU		Total		RER	Limit	
	Result	Qual	Result	Qual	(2σ+/-)	Uncert.	RL	MDC	Unit		
Radium-226	0.199	U	0.1431	U	0.204	0.204	1.00	0.345	pCi/L	0.14	1
Carrier											
Ba Carrier											
DU DU											
%Yield Qualifier Limits											
77.6 40 - 110											

Lab Sample ID: MB 160-567275/18-A

Matrix: Water

Analysis Batch: 570287

Client Sample ID: Method Blank

Prep Type: Total/NA

Prep Batch: 567275

Analyte	MB	MB	Count		Total		Prepared	Analyzed	Dil Fac	
	Result	Qualifier	Uncert.	(2σ+/-)	Uncert.	(2σ+/-)				
Radium-226	-0.02884	U	0.0824	0.0825	1.00	0.192	pCi/L	05/25/22 15:00	06/16/22 07:58	1
Carrier										
Ba Carrier										
MB MB										
%Yield Qualifier Limits										
96.0 40 - 110										
Prepared										
05/25/22 15:00										
Analyzed										
06/16/22 07:58										
Dil Fac										
1										

Lab Sample ID: LCS 160-567275/1-A

Matrix: Water

Analysis Batch: 570287

Client Sample ID: Lab Control Sample

Prep Type: Total/NA

Prep Batch: 567275

Analyte	Spiked	LCS	LCS	Total		Prepared	Analyzed	%Rec	Limits
	Added	Result	Qual	Uncert.	(2σ+/-)				
Radium-226	11.3	9.085		1.13	1.00	0.221	pCi/L	80	75 - 125
Carrier									
Ba Carrier									
LCS LCS									
%Yield Qualifier Limits									
76.8 40 - 110									
Prepared									
05/25/22 11:43									
Analyzed									
06/14/22 15:33									
Dil Fac									
1									

Method: 9320 - Radium-228 (GFPC)

Lab Sample ID: MB 160-567244/21-A

Matrix: Water

Analysis Batch: 569971

Client Sample ID: Method Blank

Prep Type: Total/NA

Prep Batch: 567244

Analyte	MB	MB	Count		Total		Prepared	Analyzed	Dil Fac	
	Result	Qualifier	Uncert.	(2σ+/-)	Uncert.	(2σ+/-)				
Radium-228	0.2185	U	0.284	0.284	1.00	0.473	pCi/L	05/25/22 11:43	06/14/22 15:33	1
Carrier										
Ba Carrier										
90.5 40 - 110										
Prepared										
05/25/22 11:43										
Analyzed										
06/14/22 15:33										
Dil Fac										
1										
Y Carrier										
86.7 40 - 110										

Eurofins Pittsburgh

QC Sample Results

Client: Haley & Aldrich, Inc.

Job ID: 180-138465-1

Project/Site: CCR Groundwater Monitoring AB Brown

Method: 9320 - Radium-228 (GFPC) (Continued)

Lab Sample ID: LCS 160-567244/1-A

Matrix: Water

Analysis Batch: 569971

Client Sample ID: Lab Control Sample

Prep Type: Total/NA

Prep Batch: 567244

Analyte	Spike Added	LCS		Total		RL	MDC	Unit	%Rec	%Rec Limits
		Result	Qual	Uncert. (2σ+/-)	Uncert.					
Radium-228	8.53	8.392		1.25	1.00	0.603	pCi/L		98	75 - 125
Carrier										
<i>LCS</i> <i>LCS</i>										
<i>%Yield</i>		<i>Qualifier</i>	<i>Limits</i>							
Ba Carrier	75.8		40 - 110							
Y Carrier	83.4		40 - 110							

Lab Sample ID: 180-138465-1 DU

Matrix: Water

Analysis Batch: 569971

Client Sample ID: CCR-SP-1

Prep Type: Total/NA

Prep Batch: 567244

Analyte	Sample		DU		Total		RER					
	Result	Qual	Result	Qual	Uncert. (2σ+/-)	Uncert.						
Radium-228	0.477	U	0.2113	U	0.413	1.00	0.719	pCi/L	0.33	1		
Carrier												
<i>DU</i> <i>DU</i>												
<i>%Yield</i>		<i>Qualifier</i>	<i>Limits</i>									
Ba Carrier	77.6		40 - 110									
Y Carrier	84.9		40 - 110									

Lab Sample ID: MB 160-567278/18-A

Matrix: Water

Analysis Batch: 569964

Client Sample ID: Method Blank

Prep Type: Total/NA

Prep Batch: 567278

Analyte	MB		Count		Total		Dil Fac			
	Result	Qualifier	Uncert. (2σ+/-)	Uncert. (2σ+/-)	RL	MDC	Unit			
Radium-228	-0.1130	U	0.246	0.247	1.00	0.498	pCi/L	1		
Carrier										
<i>MB</i> <i>MB</i>										
<i>%Yield</i>		<i>Qualifier</i>	<i>Limits</i>					<i>Prepared</i>	<i>Analyzed</i>	<i>Dil Fac</i>
Ba Carrier	97.0		40 - 110					05/25/22 15:23	06/14/22 16:03	1
Y Carrier	84.9		40 - 110					05/25/22 15:23	06/14/22 16:03	1

Lab Sample ID: LCS 160-567278/1-A

Matrix: Water

Analysis Batch: 569971

Client Sample ID: Lab Control Sample

Prep Type: Total/NA

Prep Batch: 567278

Analyte	Spike		LCS		Total		%Rec
	Added	Result	Result	Qual	Uncert. (2σ+/-)	Uncert.	
Radium-228	8.53	8.689	8.392		1.28	1.00	102
Carrier							
<i>LCS</i> <i>LCS</i>							
<i>%Yield</i>		<i>Qualifier</i>	<i>Limits</i>				
Ba Carrier	77.1		40 - 110				
Y Carrier	89.0		40 - 110				

Eurofins Pittsburgh

QC Association Summary

Client: Haley & Aldrich, Inc.

Job ID: 180-138465-1

Project/Site: CCR Groundwater Monitoring AB Brown

HPLC/IC

Analysis Batch: 400512

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
180-138465-3	CCR-SP-3	Total/NA	Water	EPA 9056A	
180-138465-4	DUPLICATE-2	Total/NA	Water	EPA 9056A	
180-138465-5	FIELD BLANK-2	Total/NA	Water	EPA 9056A	
180-138465-6	MH-1	Total/NA	Water	EPA 9056A	
180-138465-7	MH-2	Total/NA	Water	EPA 9056A	
180-138465-8	FD-PZ-1	Total/NA	Water	EPA 9056A	
180-138465-9	FD-PZ-2	Total/NA	Water	EPA 9056A	
MB 180-400512/7	Method Blank	Total/NA	Water	EPA 9056A	
LCS 180-400512/6	Lab Control Sample	Total/NA	Water	EPA 9056A	

Analysis Batch: 400775

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
180-138465-1	CCR-SP-1	Total/NA	Water	EPA 9056A	
180-138465-2	CCR-SP-2	Total/NA	Water	EPA 9056A	
180-138465-3	CCR-SP-3	Total/NA	Water	EPA 9056A	
180-138465-4	DUPLICATE-2	Total/NA	Water	EPA 9056A	
180-138465-6	MH-1	Total/NA	Water	EPA 9056A	
180-138465-7	MH-2	Total/NA	Water	EPA 9056A	
180-138465-8	FD-PZ-1	Total/NA	Water	EPA 9056A	
180-138465-9	FD-PZ-2	Total/NA	Water	EPA 9056A	
MB 180-400775/48	Method Blank	Total/NA	Water	EPA 9056A	
LCS 180-400775/47	Lab Control Sample	Total/NA	Water	EPA 9056A	
180-138465-1 MS	CCR-SP-1	Total/NA	Water	EPA 9056A	
180-138465-1 MSD	CCR-SP-1	Total/NA	Water	EPA 9056A	

Metals

Prep Batch: 400451

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
180-138465-1	CCR-SP-1	Total Recoverable	Water	3005A	
180-138465-2	CCR-SP-2	Total Recoverable	Water	3005A	
180-138465-3	CCR-SP-3	Total Recoverable	Water	3005A	
180-138465-4	DUPLICATE-2	Total Recoverable	Water	3005A	
180-138465-5	FIELD BLANK-2	Total Recoverable	Water	3005A	
180-138465-6	MH-1	Total Recoverable	Water	3005A	
180-138465-7	MH-2	Total Recoverable	Water	3005A	
180-138465-8	FD-PZ-1	Total Recoverable	Water	3005A	
180-138465-9	FD-PZ-2	Total Recoverable	Water	3005A	
MB 180-400451/1-A	Method Blank	Total Recoverable	Water	3005A	
LCS 180-400451/2-A	Lab Control Sample	Total Recoverable	Water	3005A	
180-138465-1 MS	CCR-SP-1	Total Recoverable	Water	3005A	
180-138465-1 MSD	CCR-SP-1	Total Recoverable	Water	3005A	

Prep Batch: 400613

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
180-138465-1	CCR-SP-1	Total/NA	Water	7470A	
180-138465-2	CCR-SP-2	Total/NA	Water	7470A	
180-138465-3	CCR-SP-3	Total/NA	Water	7470A	
180-138465-4	DUPLICATE-2	Total/NA	Water	7470A	
180-138465-5	FIELD BLANK-2	Total/NA	Water	7470A	
180-138465-6	MH-1	Total/NA	Water	7470A	

QC Association Summary

Client: Haley & Aldrich, Inc.

Project/Site: CCR Groundwater Monitoring AB Brown

Job ID: 180-138465-1

Metals (Continued)

Prep Batch: 400613 (Continued)

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
180-138465-7	MH-2	Total/NA	Water	7470A	
180-138465-8	FD-PZ-1	Total/NA	Water	7470A	
180-138465-9	FD-PZ-2	Total/NA	Water	7470A	
MB 180-400613/1-A	Method Blank	Total/NA	Water	7470A	
LCS 180-400613/2-A	Lab Control Sample	Total/NA	Water	7470A	
180-138465-1 MS	CCR-SP-1	Total/NA	Water	7470A	
180-138465-1 MSD	CCR-SP-1	Total/NA	Water	7470A	

Analysis Batch: 400744

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
180-138465-1	CCR-SP-1	Total/NA	Water	EPA 7470A	400613
180-138465-2	CCR-SP-2	Total/NA	Water	EPA 7470A	400613
180-138465-3	CCR-SP-3	Total/NA	Water	EPA 7470A	400613
180-138465-4	DUPLICATE-2	Total/NA	Water	EPA 7470A	400613
180-138465-5	FIELD BLANK-2	Total/NA	Water	EPA 7470A	400613
180-138465-6	MH-1	Total/NA	Water	EPA 7470A	400613
180-138465-7	MH-2	Total/NA	Water	EPA 7470A	400613
180-138465-8	FD-PZ-1	Total/NA	Water	EPA 7470A	400613
180-138465-9	FD-PZ-2	Total/NA	Water	EPA 7470A	400613
MB 180-400613/1-A	Method Blank	Total/NA	Water	EPA 7470A	400613
LCS 180-400613/2-A	Lab Control Sample	Total/NA	Water	EPA 7470A	400613
180-138465-1 MS	CCR-SP-1	Total/NA	Water	EPA 7470A	400613
180-138465-1 MSD	CCR-SP-1	Total/NA	Water	EPA 7470A	400613

Analysis Batch: 401512

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
180-138465-1	CCR-SP-1	Total Recoverable	Water	EPA 6020A	400451
180-138465-2	CCR-SP-2	Total Recoverable	Water	EPA 6020A	400451
180-138465-3	CCR-SP-3	Total Recoverable	Water	EPA 6020A	400451
180-138465-4	DUPLICATE-2	Total Recoverable	Water	EPA 6020A	400451
180-138465-5	FIELD BLANK-2	Total Recoverable	Water	EPA 6020A	400451
180-138465-6	MH-1	Total Recoverable	Water	EPA 6020A	400451
180-138465-7	MH-2	Total Recoverable	Water	EPA 6020A	400451
180-138465-8	FD-PZ-1	Total Recoverable	Water	EPA 6020A	400451
180-138465-9	FD-PZ-2	Total Recoverable	Water	EPA 6020A	400451
MB 180-400451/1-A	Method Blank	Total Recoverable	Water	EPA 6020A	400451
LCS 180-400451/2-A	Lab Control Sample	Total Recoverable	Water	EPA 6020A	400451
180-138465-1 MS	CCR-SP-1	Total Recoverable	Water	EPA 6020A	400451
180-138465-1 MSD	CCR-SP-1	Total Recoverable	Water	EPA 6020A	400451

Analysis Batch: 401660

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
180-138465-1	CCR-SP-1	Total Recoverable	Water	EPA 6020A	400451
180-138465-2	CCR-SP-2	Total Recoverable	Water	EPA 6020A	400451
180-138465-3	CCR-SP-3	Total Recoverable	Water	EPA 6020A	400451
180-138465-4	DUPLICATE-2	Total Recoverable	Water	EPA 6020A	400451
180-138465-5	FIELD BLANK-2	Total Recoverable	Water	EPA 6020A	400451
180-138465-6	MH-1	Total Recoverable	Water	EPA 6020A	400451
180-138465-7	MH-2	Total Recoverable	Water	EPA 6020A	400451
180-138465-8	FD-PZ-1	Total Recoverable	Water	EPA 6020A	400451
180-138465-9	FD-PZ-2	Total Recoverable	Water	EPA 6020A	400451

Eurofins Pittsburgh

QC Association Summary

Client: Haley & Aldrich, Inc.

Project/Site: CCR Groundwater Monitoring AB Brown

Job ID: 180-138465-1

Metals (Continued)

Analysis Batch: 401660 (Continued)

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
MB 180-400451/1-A	Method Blank	Total Recoverable	Water	EPA 6020A	400451
LCS 180-400451/2-A	Lab Control Sample	Total Recoverable	Water	EPA 6020A	400451
180-138465-1 MS	CCR-SP-1	Total Recoverable	Water	EPA 6020A	400451
180-138465-1 MSD	CCR-SP-1	Total Recoverable	Water	EPA 6020A	400451

General Chemistry

Analysis Batch: 399680

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
180-138465-2	CCR-SP-2	Total/NA	Water	SM 2540C	9
MB 180-399680/2	Method Blank	Total/NA	Water	SM 2540C	10
LCS 180-399680/1	Lab Control Sample	Total/NA	Water	SM 2540C	

Analysis Batch: 399706

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
180-138465-1	CCR-SP-1	Total/NA	Water	SM 2540C	11
180-138465-3	CCR-SP-3	Total/NA	Water	SM 2540C	12
180-138465-4	DUPLICATE-2	Total/NA	Water	SM 2540C	
180-138465-5	FIELD BLANK-2	Total/NA	Water	SM 2540C	13
180-138465-6	MH-1	Total/NA	Water	SM 2540C	
180-138465-7	MH-2	Total/NA	Water	SM 2540C	
180-138465-8	FD-PZ-1	Total/NA	Water	SM 2540C	
180-138465-9	FD-PZ-2	Total/NA	Water	SM 2540C	
MB 180-399706/2	Method Blank	Total/NA	Water	SM 2540C	
LCS 180-399706/1	Lab Control Sample	Total/NA	Water	SM 2540C	
180-138465-1 DU	CCR-SP-1	Total/NA	Water	SM 2540C	

Analysis Batch: 399828

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
180-138465-1	CCR-SP-1	Total/NA	Water	EPA 9040C	
180-138465-5	FIELD BLANK-2	Total/NA	Water	EPA 9040C	
180-138465-6	MH-1	Total/NA	Water	EPA 9040C	
180-138465-7	MH-2	Total/NA	Water	EPA 9040C	
180-138465-8	FD-PZ-1	Total/NA	Water	EPA 9040C	
180-138465-9	FD-PZ-2	Total/NA	Water	EPA 9040C	
LCS 180-399828/26	Lab Control Sample	Total/NA	Water	EPA 9040C	
180-138465-1 DU	CCR-SP-1	Total/NA	Water	EPA 9040C	

Analysis Batch: 400077

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
180-138465-2	CCR-SP-2	Total/NA	Water	EPA 9040C	
180-138465-3	CCR-SP-3	Total/NA	Water	EPA 9040C	
180-138465-4	DUPLICATE-2	Total/NA	Water	EPA 9040C	
LCS 180-400077/1	Lab Control Sample	Total/NA	Water	EPA 9040C	

Rad

Prep Batch: 567238

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
180-138465-1	CCR-SP-1	Total/NA	Water	PrecSep-21	
180-138465-2	CCR-SP-2	Total/NA	Water	PrecSep-21	
180-138465-3	CCR-SP-3	Total/NA	Water	PrecSep-21	

Eurofins Pittsburgh

QC Association Summary

Client: Haley & Aldrich, Inc.

Project/Site: CCR Groundwater Monitoring AB Brown

Job ID: 180-138465-1

Rad (Continued)

Prep Batch: 567238 (Continued)

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
180-138465-4	DUPLICATE-2	Total/NA	Water	PrecSep-21	
180-138465-5	FIELD BLANK-2	Total/NA	Water	PrecSep-21	
180-138465-6	MH-1	Total/NA	Water	PrecSep-21	
180-138465-9	FD-PZ-2	Total/NA	Water	PrecSep-21	
MB 160-567238/21-A	Method Blank	Total/NA	Water	PrecSep-21	
LCS 160-567238/1-A	Lab Control Sample	Total/NA	Water	PrecSep-21	
180-138465-1 DU	CCR-SP-1	Total/NA	Water	PrecSep-21	

Prep Batch: 567244

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
180-138465-1	CCR-SP-1	Total/NA	Water	PrecSep_0	
180-138465-2	CCR-SP-2	Total/NA	Water	PrecSep_0	
180-138465-3	CCR-SP-3	Total/NA	Water	PrecSep_0	
180-138465-4	DUPLICATE-2	Total/NA	Water	PrecSep_0	
180-138465-5	FIELD BLANK-2	Total/NA	Water	PrecSep_0	
180-138465-6	MH-1	Total/NA	Water	PrecSep_0	
180-138465-9	FD-PZ-2	Total/NA	Water	PrecSep_0	
MB 160-567244/21-A	Method Blank	Total/NA	Water	PrecSep_0	
LCS 160-567244/1-A	Lab Control Sample	Total/NA	Water	PrecSep_0	
180-138465-1 DU	CCR-SP-1	Total/NA	Water	PrecSep_0	

Prep Batch: 567275

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
180-138465-7	MH-2	Total/NA	Water	PrecSep-21	
180-138465-8	FD-PZ-1	Total/NA	Water	PrecSep-21	
MB 160-567275/18-A	Method Blank	Total/NA	Water	PrecSep-21	
LCS 160-567275/1-A	Lab Control Sample	Total/NA	Water	PrecSep-21	

Prep Batch: 567278

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
180-138465-7	MH-2	Total/NA	Water	PrecSep_0	
180-138465-8	FD-PZ-1	Total/NA	Water	PrecSep_0	
MB 160-567278/18-A	Method Blank	Total/NA	Water	PrecSep_0	
LCS 160-567278/1-A	Lab Control Sample	Total/NA	Water	PrecSep_0	

Chain of Custody Record

Client Information		Sampler: <i>Son Hill</i>		Lab PM: Bortot, Veronica		Carrier Tracking No(s):		COC No: 180-52202-8058.1					
Client Contact: Angela Casbon Scheller		Phone: <i>317-473-1325</i>		E-Mail: veronica.bortot@testamericainc.com				Page: Page 1 of 1					
Company: Vectren Corporation								Job #:					
Address: PO BOX 209		Due Date Requested:				Analysis Requested		Preservation Codes:					
City: Evansville		TAT Requested (days):						A - HCL B - NaOH C - Zn Acetate D - Nitric Acid E - NaHSO4 F - MeOH G - Amchlor H - Ascorbic Acid I - Ice J - DI Water K - EDTA L - EDA	M - Hexane N - None O - AsNaO2 P - Na2O4S Q - Na2SO3 R - Na2S2O3 S - H2SO4 T - TSP Dodecahydrate U - Acetone V - MCAA W - pH 4-5 Z - other (specify)				
State, Zip: IN, 47702													
Phone: 864-214-8750(Tel)		PO #: Purchase Order Requested											
Email:		WO #:											
Project Name: CCR Groundwater MonitoringAB Brown		Project #: 18016014											
Site:		SSOW#:											
Sample Identification		Sample Date	Sample Time	Sample Type (C=comp, G=grab)	Matrix (W=water, S=solid, O=waste/soil, T=tissue, A=air)	Field Filtered Sample (Yes or No)	Inform / Notify (Yes or No)	9316_Ra226, 9320_Ra228	9040C, 9066A_ORGM_28D	6010C, 6020A, 7470A	2640C_Caled - Local Method	180-138465 Chain of Custody	Note:
												#202	
<i>CCR - SP - 1</i>		<i>5.19.22</i>	<i>0622</i>	<i>G</i>	<i>Water</i>								
<i>CCR - SP - 2</i>			<i>0710</i>		<i>Water</i>								
<i>CCR - SP - 3</i>			<i>0755</i>		<i>Water</i>								
<i>Duplicate - 2</i>			<i>-</i>		<i>Water</i>								
<i>FIELD BLANK - 2</i>			<i>0557</i>		<i>Water</i>								
<i>MS - 2</i>			<i>0622</i>		<i>Water</i>								
<i>MSD - 2</i>			<i>0622</i>		<i>Water</i>								
<i>mH - 1</i>			<i>0910</i>		<i>Water</i>								
<i>mH - 2</i>			<i>0840</i>		<i>Water</i>								
<i>FD - P2 - 1</i>			<i>0935</i>		<i>Water</i>								
<i>FD - P2 - 2</i>		<i>↓</i>	<i>1022</i>	<i>↓</i>									
Possible Hazard Identification <input checked="" type="checkbox"/> Non-Hazard <input type="checkbox"/> Flammable <input type="checkbox"/> Skin Irritant <input type="checkbox"/> Poison B <input type="checkbox"/> Unknown <input type="checkbox"/> Radiological						Sample Disposal (A fee may be assessed if samples are retained longer than 1 month) <input type="checkbox"/> Return To Client <input type="checkbox"/> Disposal By Lab <input type="checkbox"/> Archive For _____ Months							
Deliverable Requested: I, II, III, IV, Other (specify)						Special Instructions/QC Requirements:							
Empty Kit Relinquished by:		Date:		Time:		Method of Shipment:		<i>PWT</i>					
Relinquished by: <i>J Hill</i>		Date/Time: <i>5.19.22/1600</i>		Company <i>ATLAS</i>		Received by: <i>Alma Walker</i>		Date/Time: <i>5.21.22</i>		Company <i>BOT API</i>			
Relinquished by:		Date/Time:		Company		Received by:		Date/Time:		Company			
Relinquished by:		Date/Time:		Company		Received by:		Date/Time:		Company			
Custody Seals Intact: <input checked="" type="checkbox"/> Yes <input type="checkbox"/> No		Custody Seal No.:				Cooler Temperature(s) °C and Other Remarks:							

Login Sample Receipt Checklist

Client: Haley & Aldrich, Inc.

Job Number: 180-138465-1

Login Number: 138465

List Source: Eurofins Pittsburgh

List Number: 1

Creator: Watson, Debbie

Question	Answer	Comment
Radioactivity wasn't checked or is </= background as measured by a survey meter.	N/A	
The cooler's custody seal, if present, is intact.	True	
Sample custody seals, if present, are intact.	True	
The cooler or samples do not appear to have been compromised or tampered with.	True	
Samples were received on ice.	True	
Cooler Temperature is acceptable.	True	
Cooler Temperature is recorded.	True	
COC is present.	True	
COC is filled out in ink and legible.	True	
COC is filled out with all pertinent information.	True	
Is the Field Sampler's name present on COC?	True	
There are no discrepancies between the containers received and the COC.	True	
Samples are received within Holding Time (excluding tests with immediate HTs)	True	
Sample containers have legible labels.	True	
Containers are not broken or leaking.	True	
Sample collection date/times are provided.	True	
Appropriate sample containers are used.	True	
Sample bottles are completely filled.	True	
Sample Preservation Verified.	True	
There is sufficient vol. for all requested analyses, incl. any requested MS/MSDs	True	
Containers requiring zero headspace have no headspace or bubble is <6mm (1/4").	True	
Multiphasic samples are not present.	True	
Samples do not require splitting or compositing.	True	
Residual Chlorine Checked.	N/A	

Login Sample Receipt Checklist

Client: Haley & Aldrich, Inc.

Job Number: 180-138465-1

Login Number: 138465

List Source: Eurofins St. Louis

List Number: 2

List Creation: 05/24/22 11:02 AM

Creator: Booker, Autumn R

Question	Answer	Comment
Radioactivity wasn't checked or is </= background as measured by a survey meter.	True	
The cooler's custody seal, if present, is intact.	True	
Sample custody seals, if present, are intact.	True	
The cooler or samples do not appear to have been compromised or tampered with.	True	
Samples were received on ice.	N/A	
Cooler Temperature is acceptable.	True	
Cooler Temperature is recorded.	True	
COC is present.	True	
COC is filled out in ink and legible.	True	
COC is filled out with all pertinent information.	True	
Is the Field Sampler's name present on COC?	True	
There are no discrepancies between the containers received and the COC.	True	
Samples are received within Holding Time (excluding tests with immediate HTs)	True	
Sample containers have legible labels.	True	
Containers are not broken or leaking.	True	
Sample collection date/times are provided.	True	
Appropriate sample containers are used.	True	
Sample bottles are completely filled.	True	
Sample Preservation Verified.	True	
There is sufficient vol. for all requested analyses, incl. any requested MS/MSDs	True	
Containers requiring zero headspace have no headspace or bubble is <6mm (1/4").	True	
Multiphasic samples are not present.	True	
Samples do not require splitting or compositing.	True	
Residual Chlorine Checked.	N/A	

ANALYTICAL REPORT

PREPARED FOR

Attn: Mark Miesfeldt
Haley & Aldrich, Inc.
400 Augusta Street
Suite 100

Greenville, South Carolina 29601

Generated 12/13/2022 1:43:17 PM

JOB DESCRIPTION

CCR Groundwater Monitoring
SDG NUMBER AB Brown

JOB NUMBER

180-147725-1

Eurofins Pittsburgh
301 Alpha Drive
RIDC Park
Pittsburgh PA 15238

See page two for job notes and contact information.

Eurofins Pittsburgh

Job Notes

The test results in this report meet all NELAP requirements for parameters for which accreditation is required or available. Any exceptions to the NELAP requirements are noted in this report. Pursuant to NELAP, this report may not be reproduced, except in full, without the written approval of the laboratory. This report is confidential and is intended for the sole use of Eurofins Environment Testing Northeast, LLC Pittsburgh and its client. All questions regarding this report should be directed to the Eurofins Environment Testing Northeast, LLC Pittsburgh Project Manager or designee who has signed this report.

PA Lab ID: 02-00416

The test results in this report relate only to the samples as received by the laboratory and will meet all requirements of the methodology, with any exceptions noted. This report shall not be reproduced except in full, without the express written approval of the laboratory. All questions should be directed to the Eurofins Pittsburgh Project Manager.

Authorization



Generated
12/13/2022 1:43:17 PM

Authorized for release by
Ken Hayes, Project Manager II
Ken.Hayes@et.eurofinsus.com
(615)301-5035

Table of Contents

Cover Page	1
Table of Contents	3
Case Narrative	4
Definitions/Glossary	5
Certification Summary	6
Sample Summary	7
Method Summary	9
Lab Chronicle	10
Client Sample Results	11
QC Sample Results	19
QC Association Summary	33
Chain of Custody	40
Receipt Checklists	44
	48
	12
	13

Case Narrative

Client: Haley & Aldrich, Inc.
Project/Site: CCR Groundwater Monitoring

Job ID: 180-147725-1
SDG: AB Brown

Job ID: 180-147725-1

Laboratory: Eurofins Pittsburgh

Narrative

Job Narrative 180-147725-1

Comments

No additional comments.

Receipt

The samples were received on 11/10/2022 9:30 AM. Unless otherwise noted below, the samples arrived in good condition, and where required, properly preserved and on ice. The temperatures of the 3 coolers at receipt time were 4.5° C, 5.9° C and 6.0° C

RAD

Methods 903.0, 9315: Radium-226 batch 590394

Any minimum detectable concentration (MDC), critical value (DLC), or Safe Drinking Water Act detection limit (SDWA DL) is sample-specific unless otherwise stated elsewhere in this narrative. Radiochemistry sample results are reported with the count date/time applied as the Activity Reference Date. CCR-SP-1 (180-147725-1), CCR-SP-1 (180-147725-1[DU]), CCR-SP-2 (180-147725-2), CCR-SP-3 (180-147725-3), BLIND DUP (180-147725-4), FIELD BLANK (180-147725-5), CCR-BK-1 (180-147725-6), CCR-BK-2 (180-147725-7), CCR-AP-2R (180-147725-8), CCR-AP-2I (180-147725-9), CCR-AP-3R (180-147725-10), CCR-AP-3I (180-147725-11), (LCS 160-590394/2-A) and (MB 160-590394/1-A)

Methods 904.0, 9320: Radium-228 prep batch 160-590396:

Any minimum detectable concentration (MDC), critical value (DLC), or Safe Drinking Water Act detection limit (SDWA DL) is sample-specific unless otherwise stated elsewhere in this narrative. Radiochemistry sample results are reported with the count date/time applied as the Activity Reference Date. CCR-SP-1 (180-147725-1), CCR-SP-1 (180-147725-1[DU]), CCR-SP-2 (180-147725-2), CCR-SP-3 (180-147725-3), BLIND DUP (180-147725-4), FIELD BLANK (180-147725-5), CCR-BK-1 (180-147725-6), CCR-BK-2 (180-147725-7), CCR-AP-2R (180-147725-8), CCR-AP-2I (180-147725-9), CCR-AP-3R (180-147725-10), CCR-AP-3I (180-147725-11), (LCS 160-590396/2-A) and (MB 160-590396/1-A)

No additional analytical or quality issues were noted, other than those described above or in the Definitions/Glossary page.

Narrative

Job Narrative 180-147725-2

Comments

No additional comments.

Receipt

The samples were received on 11/10/2022 9:30 AM. Unless otherwise noted below, the samples arrived in good condition, and where required, properly preserved and on ice. The temperatures of the 3 coolers at receipt time were 4.5° C, 5.9° C and 6.0° C.

GC Semi VOA

Method 9056A: The following sample was diluted due to the nature of the sample matrix: CCR-SP-1 (180-147725-1), CCR-SP-1 (180-147725-1[MS]) and CCR-SP-1 (180-147725-1[MSD]). Elevated reporting limits (RLs) are provided. Dilution based on conductivity results of sample.

Method 9056A: The following sample was diluted to bring the concentration of target analytes within the calibration range: CCR-AP-2R (180-147725-8) and CCR-AP-3R (180-147725-10). Elevated reporting limits (RLs) are provided.

No additional analytical or quality issues were noted, other than those described above or in the Definitions/Glossary page.

Metals

Method 6020A: The post digestion spike % recovery for calcium associated with batch 180-419634 was outside of control limits. The associated sample is: CCR-SP-1 (180-147725-1).

Case Narrative

Client: Haley & Aldrich, Inc.
Project/Site: CCR Groundwater Monitoring

Job ID: 180-147725-1
SDG: AB Brown

Job ID: 180-147725-1 (Continued)

Laboratory: Eurofins Pittsburgh (Continued)

Method 6020A: The following samples were diluted to bring the concentration of target analytes within the calibration range: CCR-AP-2R (180-147725-8) and CCR-AP-3R (180-147725-10). Elevated reporting limits (RLs) are provided.

No additional analytical or quality issues were noted, other than those described above or in the Definitions/Glossary page.

General Chemistry

No analytical or quality issues were noted, other than those described in the Definitions/Glossary page.

Definitions/Glossary

Client: Haley & Aldrich, Inc.
Project/Site: CCR Groundwater Monitoring

Job ID: 180-147725-1
SDG: AB Brown

Qualifiers

HPLC/IC

Qualifier	Qualifier Description
4	MS, MSD: The analyte present in the original sample is greater than 4 times the matrix spike concentration; therefore, control limits are not applicable.
J	Result is less than the RL but greater than or equal to the MDL and the concentration is an approximate value.

Metals

Qualifier	Qualifier Description
4	MS, MSD: The analyte present in the original sample is greater than 4 times the matrix spike concentration; therefore, control limits are not applicable.
B	Compound was found in the blank and sample.
J	Result is less than the RL but greater than or equal to the MDL and the concentration is an approximate value.

General Chemistry

Qualifier	Qualifier Description
HF	Field parameter with a holding time of 15 minutes. Test performed by laboratory at client's request.

Rad

Qualifier	Qualifier Description
U	Result is less than the sample detection limit.

Glossary

Abbreviation

These commonly used abbreviations may or may not be present in this report.

☒	Listed under the "D" column to designate that the result is reported on a dry weight basis
%R	Percent Recovery
CFL	Contains Free Liquid
CFU	Colony Forming Unit
CNF	Contains No Free Liquid
DER	Duplicate Error Ratio (normalized absolute difference)
Dil Fac	Dilution Factor
DL	Detection Limit (DoD/DOE)
DL, RA, RE, IN	Indicates a Dilution, Re-analysis, Re-extraction, or additional Initial metals/anion analysis of the sample
DLC	Decision Level Concentration (Radiochemistry)
EDL	Estimated Detection Limit (Dioxin)
LOD	Limit of Detection (DoD/DOE)
LOQ	Limit of Quantitation (DoD/DOE)
MCL	EPA recommended "Maximum Contaminant Level"
MDA	Minimum Detectable Activity (Radiochemistry)
MDC	Minimum Detectable Concentration (Radiochemistry)
MDL	Method Detection Limit
ML	Minimum Level (Dioxin)
MPN	Most Probable Number
MQL	Method Quantitation Limit
NC	Not Calculated
ND	Not Detected at the reporting limit (or MDL or EDL if shown)
NEG	Negative / Absent
POS	Positive / Present
PQL	Practical Quantitation Limit
PRES	Presumptive
QC	Quality Control
RER	Relative Error Ratio (Radiochemistry)
RL	Reporting Limit or Requested Limit (Radiochemistry)
RPD	Relative Percent Difference, a measure of the relative difference between two points
TEF	Toxicity Equivalent Factor (Dioxin)
TEQ	Toxicity Equivalent Quotient (Dioxin)
TNTC	Too Numerous To Count

Accreditation/Certification Summary

Client: Haley & Aldrich, Inc.

Project/Site: CCR Groundwater Monitoring

Job ID: 180-147725-1

SDG: AB Brown

Laboratory: Eurofins Pittsburgh

All accreditations/certifications held by this laboratory are listed. Not all accreditations/certifications are applicable to this report.

Authority	Program	Identification Number	Expiration Date
Arkansas DEQ	State	19-033-0	06-27-22 *
California	State	2891	04-30-23
Connecticut	State	PH-0688	09-30-22 *
Florida	NELAP	E871008	06-30-23
Georgia	State	PA 02-00416	04-30-23
Illinois	NELAP	004375	06-30-23
Kansas	NELAP	E-10350	03-31-23
Kentucky (UST)	State	162013	04-30-23
Kentucky (WW)	State	KY98043	12-31-22
Louisiana	NELAP	04041	06-30-22 *
Louisiana (All)	NELAP	04041	06-30-23
Maine	State	PA00164	03-06-24
Minnesota	NELAP	042-999-482	12-31-22
New Hampshire	NELAP	2030	04-04-23
New Jersey	NELAP	PA005	06-30-23
New York	NELAP	11182	04-01-23
North Carolina (WW/SW)	State	434	12-31-22
North Dakota	State	R-227	04-30-23
Oregon	NELAP	PA-2151	02-07-23
Pennsylvania	NELAP	02-00416	04-30-23
Rhode Island	State	LAO00362	12-31-22
South Carolina	State	89014	04-20-23
Texas	NELAP	T104704528	03-31-23
US Fish & Wildlife	US Federal Programs	058448	03-31-23
USDA	US Federal Programs	P330-16-00211	06-21-24
Utah	NELAP	PA001462019-8	05-31-23
Virginia	NELAP	10043	09-14-23
West Virginia DEP	State	142	01-31-23
Wisconsin	State	998027800	08-31-23

Laboratory: Eurofins St. Louis

All accreditations/certifications held by this laboratory are listed. Not all accreditations/certifications are applicable to this report.

Authority	Program	Identification Number	Expiration Date
Alaska (UST)	State	20-001	05-06-25
ANAB	Dept. of Defense ELAP	L2305	04-06-25
ANAB	Dept. of Energy	L2305.01	04-06-25
ANAB	ISO/IEC 17025	L2305	04-06-25
Arizona	State	AZ0813	12-08-23
California	Los Angeles County Sanitation Districts	10259	06-30-22 *
California	State	2886	06-30-23
Connecticut	State	PH-0241	03-31-23
Florida	NELAP	E87689	06-30-23
HI - RadChem Recognition	State	n/a	06-30-23
Illinois	NELAP	200023	11-30-23
Iowa	State	373	12-01-24
Kansas	NELAP	E-10236	10-31-23
Kentucky (DW)	State	KY90125	12-31-22
Kentucky (WW)	State	KY90125 (Permit KY0004049)	12-31-22

* Accreditation/Certification renewal pending - accreditation/certification considered valid.

Eurofins Pittsburgh

Accreditation/Certification Summary

Client: Haley & Aldrich, Inc.

Project/Site: CCR Groundwater Monitoring

Job ID: 180-147725-1

SDG: AB Brown

Laboratory: Eurofins St. Louis (Continued)

All accreditations/certifications held by this laboratory are listed. Not all accreditations/certifications are applicable to this report.

Authority	Program	Identification Number	Expiration Date
Louisiana (All)	NELAP	04080	06-30-23
Louisiana (DW)	State	LA011	12-31-22
Maryland	State	310	09-30-23
MI - RadChem Recognition	State	9005	06-30-23
Missouri	State	780	06-30-25
Nevada	State	MO000542020-1	07-31-23
New Jersey	NELAP	MO002	06-30-23
New York	NELAP	11616	04-01-23
North Dakota	State	R-207	06-30-23
NRC	NRC	24-24817-01	12-31-22
Oklahoma	NELAP	9997	08-31-23
Oregon	NELAP	4157	09-01-23
Pennsylvania	NELAP	68-00540	02-28-23
South Carolina	State	85002001	06-30-23
Texas	NELAP	T104704193	07-31-23
US Fish & Wildlife	US Federal Programs	058448	07-31-23
USDA	US Federal Programs	P330-17-00028	03-11-23
Utah	NELAP	MO000542021-14	07-31-23
Virginia	NELAP	10310	06-14-24
Washington	State	C592	08-30-23
West Virginia DEP	State	381	12-31-22

Sample Summary

Client: Haley & Aldrich, Inc.

Project/Site: CCR Groundwater Monitoring

Job ID: 180-147725-1

SDG: AB Brown

Lab Sample ID	Client Sample ID	Matrix	Collected	Received
180-147725-1	CCR-SP-1	Water	11/04/22 11:10	11/10/22 09:30
180-147725-2	CCR-SP-2	Water	11/07/22 09:55	11/10/22 09:30
180-147725-3	CCR-SP-3	Water	11/07/22 11:15	11/10/22 09:30
180-147725-4	BLIND DUP	Water	11/07/22 00:01	11/10/22 09:30
180-147725-5	FIELD BLANK	Water	11/07/22 11:15	11/10/22 09:30
180-147725-6	CCR-BK-1	Water	11/08/22 10:15	11/10/22 09:30
180-147725-7	CCR-BK-2	Water	11/08/22 12:15	11/10/22 09:30
180-147725-8	CCR-AP-2R	Water	11/08/22 15:15	11/10/22 09:30
180-147725-9	CCR-AP-2I	Water	11/08/22 16:15	11/10/22 09:30
180-147725-10	CCR-AP-3R	Water	11/09/22 10:00	11/10/22 09:30
180-147725-11	CCR-AP-3I	Water	11/09/22 11:30	11/10/22 09:30

Method Summary

Client: Haley & Aldrich, Inc.
Project/Site: CCR Groundwater Monitoring

Job ID: 180-147725-1
SDG: AB Brown

Method	Method Description	Protocol	Laboratory
9315	Radium-226 (GFPC)	SW846	EET SL
9320	Radium-228 (GFPC)	SW846	EET SL
Ra226_Ra228	Combined Radium-226 and Radium-228	TAL-STL	EET SL
PrecSep_0	Preparation, Precipitate Separation	None	EET SL
PrecSep-21	Preparation, Precipitate Separation (21-Day In-Growth)	None	EET SL

Protocol References:

None = None

SW846 = "Test Methods For Evaluating Solid Waste, Physical/Chemical Methods", Third Edition, November 1986 And Its Updates.

TAL-STL = TestAmerica Laboratories, St. Louis, Facility Standard Operating Procedure.

Laboratory References:

EET SL = Eurofins St. Louis, 13715 Rider Trail North, Earth City, MO 63045, TEL (314)298-8566

Lab Chronicle

Client: Haley & Aldrich, Inc.
Project/Site: CCR Groundwater Monitoring

Job ID: 180-147725-1
SDG: AB Brown

Client Sample ID: CCR-SP-1

Date Collected: 11/04/22 11:10

Date Received: 11/10/22 09:30

Lab Sample ID: 180-147725-1

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	EPA 9056A		2.5			418020	11/12/22 22:50	M1D	EET PIT
		Instrument ID: INTEGRION								
Total Recoverable	Prep	3005A			25 mL	25 mL	418688	11/18/22 17:39	NAF	EET PIT
Total Recoverable	Analysis	EPA 6020A		1			419634	12/01/22 13:58	RSK	EET PIT
		Instrument ID: A								
Total Recoverable	Prep	3005A			25 mL	25 mL	418688	11/18/22 17:39	NAF	EET PIT
Total Recoverable	Analysis	EPA 6020A		1			419721	12/02/22 14:12	RSK	EET PIT
		Instrument ID: A								
Total/NA	Prep	7470A			25 mL	25 mL	418196	11/15/22 08:26	RJR	EET PIT
Total/NA	Analysis	EPA 7470A		1			418493	11/17/22 06:58	RJR	EET PIT
		Instrument ID: HGY								
Total/NA	Analysis	EPA 9040C		1			418214	11/14/22 21:05	MAM	EET PIT
		Instrument ID: PHTITRATOR								
Total/NA	Analysis	SM 2540C		1	50 mL	100 mL	417994	11/11/22 16:10	LWM	EET PIT
		Instrument ID: NOEQUIP								
Total/NA	Prep	PrecSep-21			996.55 mL	1.0 g	590394	11/17/22 09:40	DJP	EET SL
Total/NA	Analysis	9315		1			592998	12/09/22 16:52	SCB	EET SL
		Instrument ID: GFPCBLUE								
Total/NA	Prep	PrecSep_0			996.55 mL	1.0 g	590396	11/17/22 10:15	DJP	EET SL
Total/NA	Analysis	9320		1			592998	12/09/22 12:19	SCB	EET SL
		Instrument ID: GFPCBLUE								
Total/NA	Analysis	Ra226_Ra228		1			593323	12/12/22 17:53	CLP	EET SL
		Instrument ID: NOEQUIP								

Client Sample ID: CCR-SP-2

Date Collected: 11/07/22 09:55

Date Received: 11/10/22 09:30

Lab Sample ID: 180-147725-2

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	EPA 9056A		1			418020	11/12/22 21:54	M1D	EET PIT
		Instrument ID: INTEGRION								
Total Recoverable	Prep	3005A			25 mL	25 mL	418688	11/18/22 17:39	NAF	EET PIT
Total Recoverable	Analysis	EPA 6020A		1			419634	12/01/22 14:16	RSK	EET PIT
		Instrument ID: A								
Total Recoverable	Prep	3005A			25 mL	25 mL	418688	11/18/22 17:39	NAF	EET PIT
Total Recoverable	Analysis	EPA 6020A		1			419721	12/02/22 14:22	RSK	EET PIT
		Instrument ID: A								
Total/NA	Prep	7470A			25 mL	25 mL	418196	11/15/22 08:26	RJR	EET PIT
Total/NA	Analysis	EPA 7470A		1			418493	11/17/22 07:01	RJR	EET PIT
		Instrument ID: HGY								
Total/NA	Analysis	EPA 9040C		1			418214	11/14/22 21:16	MAM	EET PIT
		Instrument ID: PHTITRATOR								
Total/NA	Analysis	SM 2540C		1	100 mL	100 mL	417994	11/11/22 16:10	LWM	EET PIT
		Instrument ID: NOEQUIP								

Eurofins Pittsburgh

Lab Chronicle

Client: Haley & Aldrich, Inc.
Project/Site: CCR Groundwater Monitoring

Job ID: 180-147725-1
SDG: AB Brown

Client Sample ID: CCR-SP-2

Date Collected: 11/07/22 09:55

Date Received: 11/10/22 09:30

Lab Sample ID: 180-147725-2

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	PrecSep-21			752.17 mL	1.0 g	590394	11/17/22 09:40	DJP	EET SL
Total/NA	Analysis	9315 Instrument ID: GFPCBLUE		1			592998	12/09/22 16:53	SCB	EET SL
Total/NA	Prep	PrecSep_0			752.17 mL	1.0 g	590396	11/17/22 10:15	DJP	EET SL
Total/NA	Analysis	9320 Instrument ID: GFPCBLUE		1			592998	12/09/22 12:19	SCB	EET SL
Total/NA	Analysis	Ra226_Ra228 Instrument ID: NOEQUIP		1			593323	12/12/22 17:53	CLP	EET SL

Client Sample ID: CCR-SP-3

Date Collected: 11/07/22 11:15

Date Received: 11/10/22 09:30

Lab Sample ID: 180-147725-3

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	EPA 9056A Instrument ID: INTEGRION		1			418020	11/12/22 22:13	M1D	EET PIT
Total Recoverable	Prep	3005A			25 mL	25 mL	418688	11/18/22 17:39	NAF	EET PIT
Total Recoverable	Analysis	EPA 6020A Instrument ID: A		1			419634	12/01/22 14:20	RSK	EET PIT
Total Recoverable	Prep	3005A			25 mL	25 mL	418688	11/18/22 17:39	NAF	EET PIT
Total Recoverable	Analysis	EPA 6020A Instrument ID: A		1			419721	12/02/22 14:26	RSK	EET PIT
Total/NA	Prep	7470A			25 mL	25 mL	418196	11/15/22 08:26	RJR	EET PIT
Total/NA	Analysis	EPA 7470A Instrument ID: HGY		1			418493	11/17/22 07:02	RJR	EET PIT
Total/NA	Analysis	EPA 9040C Instrument ID: PHTITRATOR		1			418214	11/14/22 21:22	MAM	EET PIT
Total/NA	Analysis	SM 2540C Instrument ID: NOEQUIP		1	100 mL	100 mL	417994	11/11/22 16:10	LWM	EET PIT
Total/NA	Prep	PrecSep-21			997.94 mL	1.0 g	590394	11/17/22 09:40	DJP	EET SL
Total/NA	Analysis	9315 Instrument ID: GFPCBLUE		1			592998	12/09/22 16:53	SCB	EET SL
Total/NA	Prep	PrecSep_0			997.94 mL	1.0 g	590396	11/17/22 10:15	DJP	EET SL
Total/NA	Analysis	9320 Instrument ID: GFPCBLUE		1			592998	12/09/22 12:20	SCB	EET SL
Total/NA	Analysis	Ra226_Ra228 Instrument ID: NOEQUIP		1			593323	12/12/22 17:53	CLP	EET SL

Client Sample ID: BLIND DUP

Date Collected: 11/07/22 00:01

Date Received: 11/10/22 09:30

Lab Sample ID: 180-147725-4

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	EPA 9056A Instrument ID: INTEGRION		1			418020	11/12/22 22:31	M1D	EET PIT

Eurofins Pittsburgh

Lab Chronicle

Client: Haley & Aldrich, Inc.
Project/Site: CCR Groundwater Monitoring

Job ID: 180-147725-1
SDG: AB Brown

Client Sample ID: BLIND DUP

Date Collected: 11/07/22 00:01

Date Received: 11/10/22 09:30

Lab Sample ID: 180-147725-4

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total Recoverable	Prep	3005A			25 mL	25 mL	418688	11/18/22 17:39	NAF	EET PIT
Total Recoverable	Analysis	EPA 6020A		1			419634	12/01/22 14:23	RSK	EET PIT
		Instrument ID: A								
Total Recoverable	Prep	3005A			25 mL	25 mL	418688	11/18/22 17:39	NAF	EET PIT
Total Recoverable	Analysis	EPA 6020A		1			419721	12/02/22 14:37	RSK	EET PIT
		Instrument ID: A								
Total/NA	Prep	7470A			25 mL	25 mL	418196	11/15/22 08:26	RJR	EET PIT
Total/NA	Analysis	EPA 7470A		1			418493	11/17/22 07:03	RJR	EET PIT
		Instrument ID: HGY								
Total/NA	Analysis	EPA 9040C		1			418214	11/14/22 21:28	MAM	EET PIT
		Instrument ID: PHTITRATOR								
Total/NA	Analysis	SM 2540C		1	100 mL	100 mL	417994	11/11/22 16:10	LWM	EET PIT
		Instrument ID: NOEQUIP								
Total/NA	Prep	PrecSep-21			995.11 mL	1.0 g	590394	11/17/22 09:40	DJP	EET SL
Total/NA	Analysis	9315		1			592998	12/09/22 16:53	SCB	EET SL
		Instrument ID: GFPCBLUE								
Total/NA	Prep	PrecSep_0			995.11 mL	1.0 g	590396	11/17/22 10:15	DJP	EET SL
Total/NA	Analysis	9320		1			592998	12/09/22 12:20	SCB	EET SL
		Instrument ID: GFPCBLUE								
Total/NA	Analysis	Ra226_Ra228		1			593323	12/12/22 17:53	CLP	EET SL
		Instrument ID: NOEQUIP								

Client Sample ID: FIELD BLANK

Date Collected: 11/07/22 11:15

Date Received: 11/10/22 09:30

Lab Sample ID: 180-147725-5

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	EPA 9056A		1	1 mL	1 mL	418374	11/16/22 17:39	M1D	EET PIT
		Instrument ID: CHICS2000								
Total/NA	Analysis	EPA 9056A		1			418020	11/12/22 23:45	M1D	EET PIT
		Instrument ID: INTEGRION								
Total Recoverable	Prep	3005A			25 mL	25 mL	418688	11/18/22 17:39	NAF	EET PIT
Total Recoverable	Analysis	EPA 6020A		1			419634	12/01/22 14:34	RSK	EET PIT
		Instrument ID: A								
Total Recoverable	Prep	3005A			25 mL	25 mL	418688	11/18/22 17:39	NAF	EET PIT
Total Recoverable	Analysis	EPA 6020A		1			419721	12/02/22 14:41	RSK	EET PIT
		Instrument ID: A								
Total/NA	Prep	7470A			25 mL	25 mL	418196	11/15/22 08:26	RJR	EET PIT
Total/NA	Analysis	EPA 7470A		1			418493	11/17/22 07:04	RJR	EET PIT
		Instrument ID: HGY								
Total/NA	Analysis	EPA 9040C		1			418214	11/14/22 21:33	MAM	EET PIT
		Instrument ID: PHTITRATOR								
Total/NA	Analysis	SM 2540C		1	100 mL	100 mL	417994	11/11/22 16:10	LWM	EET PIT
		Instrument ID: NOEQUIP								

Eurofins Pittsburgh

Lab Chronicle

Client: Haley & Aldrich, Inc.
Project/Site: CCR Groundwater Monitoring

Job ID: 180-147725-1
SDG: AB Brown

Client Sample ID: FIELD BLANK

Date Collected: 11/07/22 11:15

Date Received: 11/10/22 09:30

Lab Sample ID: 180-147725-5

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	PrecSep-21			994.95 mL	1.0 g	590394	11/17/22 09:40	DJP	EET SL
Total/NA	Analysis	9315 Instrument ID: GFPCBLUE		1			592998	12/09/22 16:53	SCB	EET SL
Total/NA	Prep	PrecSep_0			994.95 mL	1.0 g	590396	11/17/22 10:15	DJP	EET SL
Total/NA	Analysis	9320 Instrument ID: GFPCBLUE		1			592998	12/09/22 12:20	SCB	EET SL
Total/NA	Analysis	Ra226_Ra228 Instrument ID: NOEQUIP		1			593323	12/12/22 17:53	CLP	EET SL

Client Sample ID: CCR-BK-1

Date Collected: 11/08/22 10:15

Date Received: 11/10/22 09:30

Lab Sample ID: 180-147725-6

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	EPA 9056A Instrument ID: INTEGRION		1			418020	11/13/22 00:03	M1D	EET PIT
Total Recoverable	Prep	3005A			25 mL	25 mL	418688	11/18/22 17:39	NAF	EET PIT
Total Recoverable	Analysis	EPA 6020A Instrument ID: A		1			419634	12/01/22 14:38	RSK	EET PIT
Total Recoverable	Prep	3005A			25 mL	25 mL	418688	11/18/22 17:39	NAF	EET PIT
Total Recoverable	Analysis	EPA 6020A Instrument ID: A		1			419721	12/02/22 14:44	RSK	EET PIT
Total/NA	Prep	7470A			25 mL	25 mL	418196	11/15/22 08:26	RJR	EET PIT
Total/NA	Analysis	EPA 7470A Instrument ID: HGY		1			418493	11/17/22 07:05	RJR	EET PIT
Total/NA	Analysis	EPA 9040C Instrument ID: PHTITRATOR		1			418214	11/14/22 21:39	MAM	EET PIT
Total/NA	Analysis	SM 2540C Instrument ID: NOEQUIP		1	100 mL	100 mL	417994	11/11/22 16:10	LWM	EET PIT
Total/NA	Prep	PrecSep-21			983.87 mL	1.0 g	590394	11/17/22 09:40	DJP	EET SL
Total/NA	Analysis	9315 Instrument ID: GFPCRED		1			592995	12/09/22 22:40	SCB	EET SL
Total/NA	Prep	PrecSep_0			983.87 mL	1.0 g	590396	11/17/22 10:15	DJP	EET SL
Total/NA	Analysis	9320 Instrument ID: GFPCBLUE		1			592998	12/09/22 12:20	SCB	EET SL
Total/NA	Analysis	Ra226_Ra228 Instrument ID: NOEQUIP		1			593323	12/12/22 17:53	CLP	EET SL

Client Sample ID: CCR-BK-2

Date Collected: 11/08/22 12:15

Date Received: 11/10/22 09:30

Lab Sample ID: 180-147725-7

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	EPA 9056A Instrument ID: INTEGRION		1			418020	11/13/22 00:22	M1D	EET PIT

Eurofins Pittsburgh

Lab Chronicle

Client: Haley & Aldrich, Inc.
Project/Site: CCR Groundwater Monitoring

Job ID: 180-147725-1
SDG: AB Brown

Client Sample ID: CCR-BK-2

Date Collected: 11/08/22 12:15

Date Received: 11/10/22 09:30

Lab Sample ID: 180-147725-7

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total Recoverable	Prep	3005A			25 mL	25 mL	418688	11/18/22 17:39	NAF	EET PIT
Total Recoverable	Analysis	EPA 6020A		1			419634	12/01/22 14:41	RSK	EET PIT
		Instrument ID: A								
Total Recoverable	Prep	3005A			25 mL	25 mL	418688	11/18/22 17:39	NAF	EET PIT
Total Recoverable	Analysis	EPA 6020A		1			419721	12/02/22 14:48	RSK	EET PIT
		Instrument ID: A								
Total/NA	Prep	7470A			25 mL	25 mL	418196	11/15/22 08:26	RJR	EET PIT
Total/NA	Analysis	EPA 7470A		1			418493	11/17/22 07:06	RJR	EET PIT
		Instrument ID: HGY								
Total/NA	Analysis	EPA 9040C		1			418214	11/14/22 21:44	MAM	EET PIT
		Instrument ID: PHTITRATOR								
Total/NA	Analysis	SM 2540C		1	100 mL	100 mL	417994	11/11/22 16:10	LWM	EET PIT
		Instrument ID: NOEQUIP								
Total/NA	Prep	PrecSep-21			754.00 mL	1.0 g	590394	11/17/22 09:40	DJP	EET SL
Total/NA	Analysis	9315		1			592995	12/09/22 22:40	SCB	EET SL
		Instrument ID: GFPCRED								
Total/NA	Prep	PrecSep_0			754.00 mL	1.0 g	590396	11/17/22 10:15	DJP	EET SL
Total/NA	Analysis	9320		1			593004	12/09/22 12:26	SCB	EET SL
		Instrument ID: GFPCPURPLE								
Total/NA	Analysis	Ra226_Ra228		1			593323	12/12/22 17:53	CLP	EET SL
		Instrument ID: NOEQUIP								

Client Sample ID: CCR-AP-2R

Date Collected: 11/08/22 15:15

Date Received: 11/10/22 09:30

Lab Sample ID: 180-147725-8

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	EPA 9056A		1			418020	11/13/22 01:17	M1D	EET PIT
		Instrument ID: INTEGRION								
Total/NA	Analysis	EPA 9056A		10			418279	11/16/22 01:43	M1D	EET PIT
		Instrument ID: INTEGRION								
Total Recoverable	Prep	3005A			25 mL	25 mL	418688	11/18/22 17:39	NAF	EET PIT
Total Recoverable	Analysis	EPA 6020A		1			419634	12/01/22 14:45	RSK	EET PIT
		Instrument ID: A								
Total Recoverable	Prep	3005A			25 mL	25 mL	418688	11/18/22 17:39	NAF	EET PIT
Total Recoverable	Analysis	EPA 6020A		10			419882	12/04/22 14:03	RSK	EET PIT
		Instrument ID: A								
Total/NA	Prep	7470A			25 mL	25 mL	418196	11/15/22 08:26	RJR	EET PIT
Total/NA	Analysis	EPA 7470A		1			418493	11/17/22 07:11	RJR	EET PIT
		Instrument ID: HGY								
Total/NA	Analysis	EPA 9040C		1			418214	11/14/22 21:50	MAM	EET PIT
		Instrument ID: PHTITRATOR								
Total/NA	Analysis	SM 2540C		1	25 mL	100 mL	417994	11/11/22 16:10	LWM	EET PIT
		Instrument ID: NOEQUIP								

Eurofins Pittsburgh

Lab Chronicle

Client: Haley & Aldrich, Inc.
Project/Site: CCR Groundwater Monitoring

Job ID: 180-147725-1
SDG: AB Brown

Client Sample ID: CCR-AP-2R

Date Collected: 11/08/22 15:15

Date Received: 11/10/22 09:30

Lab Sample ID: 180-147725-8

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	PrecSep-21			998.47 mL	1.0 g	590394	11/17/22 09:40	DJP	EET SL
Total/NA	Analysis	9315 Instrument ID: GFPCRED		1			592995	12/09/22 22:40	SCB	EET SL
Total/NA	Prep	PrecSep_0			998.47 mL	1.0 g	590396	11/17/22 10:15	DJP	EET SL
Total/NA	Analysis	9320 Instrument ID: GFPCPURPLE		1			593004	12/09/22 12:26	SCB	EET SL
Total/NA	Analysis	Ra226_Ra228 Instrument ID: NOEQUIP		1			593323	12/12/22 17:53	CLP	EET SL

Client Sample ID: CCR-AP-2I

Date Collected: 11/08/22 16:15

Date Received: 11/10/22 09:30

Lab Sample ID: 180-147725-9

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	EPA 9056A Instrument ID: INTEGRION		1			418020	11/13/22 01:36	M1D	EET PIT
Total Recoverable	Prep	3005A			25 mL	25 mL	418688	11/18/22 17:39	NAF	EET PIT
Total Recoverable	Analysis	EPA 6020A Instrument ID: A		1			419634	12/01/22 15:00	RSK	EET PIT
Total Recoverable	Prep	3005A			25 mL	25 mL	418688	11/18/22 17:39	NAF	EET PIT
Total Recoverable	Analysis	EPA 6020A Instrument ID: A		1			419721	12/02/22 15:06	RSK	EET PIT
Total/NA	Prep	7470A			25 mL	25 mL	418196	11/15/22 08:26	RJR	EET PIT
Total/NA	Analysis	EPA 7470A Instrument ID: HGY		1			418493	11/17/22 07:12	RJR	EET PIT
Total/NA	Analysis	EPA 9040C Instrument ID: PHTITRATOR		1			418214	11/14/22 21:56	MAM	EET PIT
Total/NA	Analysis	SM 2540C Instrument ID: NOEQUIP		1	100 mL	100 mL	417994	11/11/22 16:10	LWM	EET PIT
Total/NA	Prep	PrecSep-21			998.62 mL	1.0 g	590394	11/17/22 09:40	DJP	EET SL
Total/NA	Analysis	9315 Instrument ID: GFPCRED		1			592995	12/09/22 22:40	SCB	EET SL
Total/NA	Prep	PrecSep_0			998.62 mL	1.0 g	590396	11/17/22 10:15	DJP	EET SL
Total/NA	Analysis	9320 Instrument ID: GFPCPURPLE		1			593004	12/09/22 12:26	SCB	EET SL
Total/NA	Analysis	Ra226_Ra228 Instrument ID: NOEQUIP		1			593323	12/12/22 17:53	CLP	EET SL

Client Sample ID: CCR-AP-3R

Date Collected: 11/09/22 10:00

Date Received: 11/10/22 09:30

Lab Sample ID: 180-147725-10

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	EPA 9056A Instrument ID: INTEGRION		1			418020	11/13/22 02:13	M1D	EET PIT

Eurofins Pittsburgh

Lab Chronicle

Client: Haley & Aldrich, Inc.
Project/Site: CCR Groundwater Monitoring

Job ID: 180-147725-1
SDG: AB Brown

Client Sample ID: CCR-AP-3R

Date Collected: 11/09/22 10:00

Date Received: 11/10/22 09:30

Lab Sample ID: 180-147725-10

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	EPA 9056A		10			418020	11/13/22 02:31	M1D	EET PIT
Total Recoverable	Prep	3005A			25 mL	25 mL	418688	11/18/22 17:39	NAF	EET PIT
Total Recoverable	Analysis	EPA 6020A		1			419634	12/01/22 15:03	RSK	EET PIT
		Instrument ID: A								
Total Recoverable	Prep	3005A			25 mL	25 mL	418688	11/18/22 17:39	NAF	EET PIT
Total Recoverable	Analysis	EPA 6020A		10			419882	12/04/22 14:06	RSK	EET PIT
		Instrument ID: A								
Total/NA	Prep	7470A			25 mL	25 mL	418196	11/15/22 08:26	RJR	EET PIT
Total/NA	Analysis	EPA 7470A		1			418493	11/17/22 07:13	RJR	EET PIT
		Instrument ID: HGY								
Total/NA	Analysis	EPA 9040C		1			418214	11/14/22 22:06	MAM	EET PIT
		Instrument ID: PHTITRATOR								
Total/NA	Analysis	SM 2540C		1	20 mL	100 mL	417994	11/11/22 16:10	LWM	EET PIT
		Instrument ID: NOEQUIP								
Total/NA	Prep	PrecSep-21			994.15 mL	1.0 g	590394	11/17/22 09:40	DJP	EET SL
Total/NA	Analysis	9315		1			592995	12/09/22 22:40	SCB	EET SL
		Instrument ID: GFPCRED								
Total/NA	Prep	PrecSep_0			994.15 mL	1.0 g	590396	11/17/22 10:15	DJP	EET SL
Total/NA	Analysis	9320		1			593004	12/09/22 12:26	SCB	EET SL
		Instrument ID: GFPCPURPLE								
Total/NA	Analysis	Ra226_Ra228		1			593323	12/12/22 17:53	CLP	EET SL
		Instrument ID: NOEQUIP								

Client Sample ID: CCR-AP-3I

Date Collected: 11/09/22 11:30

Date Received: 11/10/22 09:30

Lab Sample ID: 180-147725-11

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Analysis	EPA 9056A		1			418020	11/13/22 01:54	M1D	EET PIT
		Instrument ID: INTEGRION								
Total Recoverable	Prep	3005A			25 mL	25 mL	418688	11/18/22 17:39	NAF	EET PIT
Total Recoverable	Analysis	EPA 6020A		1			419634	12/01/22 15:18	RSK	EET PIT
		Instrument ID: A								
Total Recoverable	Prep	3005A			25 mL	25 mL	418688	11/18/22 17:39	NAF	EET PIT
Total Recoverable	Analysis	EPA 6020A		1			419721	12/02/22 15:24	RSK	EET PIT
		Instrument ID: A								
Total/NA	Prep	7470A			25 mL	25 mL	418196	11/15/22 08:26	RJR	EET PIT
Total/NA	Analysis	EPA 7470A		1			418493	11/17/22 09:14	RJR	EET PIT
		Instrument ID: HGY								
Total/NA	Analysis	EPA 9040C		1			418214	11/14/22 22:17	MAM	EET PIT
		Instrument ID: PHTITRATOR								
Total/NA	Analysis	SM 2540C		1	100 mL	100 mL	417994	11/11/22 16:10	LWM	EET PIT
		Instrument ID: NOEQUIP								

Eurofins Pittsburgh

Lab Chronicle

Client: Haley & Aldrich, Inc.
 Project/Site: CCR Groundwater Monitoring

Job ID: 180-147725-1
 SDG: AB Brown

Client Sample ID: CCR-AP-3I

Date Collected: 11/09/22 11:30

Date Received: 11/10/22 09:30

Lab Sample ID: 180-147725-11

Matrix: Water

Prep Type	Batch Type	Batch Method	Run	Dil Factor	Initial Amount	Final Amount	Batch Number	Prepared or Analyzed	Analyst	Lab
Total/NA	Prep	PrecSep-21			1000.46 mL	1.0 g	590394	11/17/22 09:40	DJP	EET SL
Total/NA	Analysis	9315		1			593004	12/09/22 16:55	SCB	EET SL
		Instrument ID: GFPCPURPLE								
Total/NA	Prep	PrecSep_0			1000.46 mL	1.0 g	590396	11/17/22 10:15	DJP	EET SL
Total/NA	Analysis	9320		1			593004	12/09/22 12:26	SCB	EET SL
		Instrument ID: GFPCPURPLE								
Total/NA	Analysis	Ra226_Ra228		1			593323	12/12/22 17:53	CLP	EET SL
		Instrument ID: NOEQUIP								

Laboratory References:

EET SL = Eurofins St. Louis, 13715 Rider Trail North, Earth City, MO 63045, TEL (314)298-8566

Analyst References:

Lab: EET PIT

Batch Type: Prep

NAF = Nicholas Frankos

RJR = Ron Rosenbaum

Batch Type: Analysis

LWM = Leslie McIntire

M1D = Maureen Donlin

MAM = Matthew Martin

RJR = Ron Rosenbaum

RSK = Robert Kurtz

Lab: EET SL

Batch Type: Prep

DJP = Dalton Pieper

Batch Type: Analysis

CLP = Cassandra Park

SCB = Sarah Bernsen

Client Sample Results

Client: Haley & Aldrich, Inc.

Project/Site: CCR Groundwater Monitoring

Job ID: 180-147725-1

SDG: AB Brown

Client Sample ID: CCR-SP-1

Lab Sample ID: 180-147725-1

Matrix: Water

Date Collected: 11/04/22 11:10

Date Received: 11/10/22 09:30

Method: SW846 EPA 9056A - Anions, Ion Chromatography

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Chloride	97		2.5	1.8	mg/L			11/12/22 22:50	2.5
Fluoride	0.22	J	0.25	0.065	mg/L			11/12/22 22:50	2.5
Sulfate	810		2.5	1.9	mg/L			11/12/22 22:50	2.5

Method: SW846 EPA 6020A - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Antimony	0.00052	J B	0.0020	0.00051	mg/L			12/01/22 13:58	1
Arsenic	0.0074		0.0010	0.00028	mg/L			12/01/22 13:58	1
Barium	0.064		0.010	0.0031	mg/L			12/01/22 13:58	1
Beryllium	ND		0.0010	0.00027	mg/L			12/01/22 13:58	1
Boron	0.46		0.080	0.060	mg/L			12/02/22 14:12	1
Cadmium	ND		0.0010	0.00022	mg/L			12/01/22 13:58	1
Calcium	240		0.50	0.13	mg/L			12/01/22 13:58	1
Chromium	ND		0.0020	0.0015	mg/L			12/01/22 13:58	1
Cobalt	0.0042		0.00050	0.00026	mg/L			12/01/22 13:58	1
Lead	0.00057	J B	0.0010	0.00017	mg/L			12/01/22 13:58	1
Lithium	0.0061		0.0050	0.00083	mg/L			12/01/22 13:58	1
Molybdenum	0.00061	J	0.0050	0.00061	mg/L			12/01/22 13:58	1
Selenium	ND		0.0050	0.00074	mg/L			12/01/22 13:58	1
Thallium	ND		0.0010	0.00047	mg/L			12/01/22 13:58	1

Method: SW846 EPA 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	ND		0.00020	0.00013	mg/L		11/15/22 08:26	11/17/22 06:58	1

General Chemistry

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Total Dissolved Solids (SM 2540C)	1700		20	20	mg/L			11/11/22 16:10	1
Analyte	Result	Qualifier	RL	RL	Unit	D	Prepared	Analyzed	Dil Fac
pH (SW846 EPA 9040C)	7.4	HF	0.1	0.1	SU			11/14/22 21:05	1

Method: SW846 9315 - Radium-226 (GFPC)

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			(2σ+/-)	(2σ+/-)						
Radium-226	0.0827	U	0.253	0.253	1.00	0.464	pCi/L	11/17/22 09:40	12/09/22 16:52	1
Carrier	%Yield	Qualifier	Limits					Prepared	Analyzed	Dil Fac
Ba Carrier	86.7		40 - 110					11/17/22 09:40	12/09/22 16:52	1

Method: SW846 9320 - Radium-228 (GFPC)

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			(2σ+/-)	(2σ+/-)						
Radium-228	-0.0441	U	0.334	0.334	1.00	0.633	pCi/L	11/17/22 10:15	12/09/22 12:19	1
Carrier	%Yield	Qualifier	Limits					Prepared	Analyzed	Dil Fac
Ba Carrier	86.7		40 - 110					11/17/22 10:15	12/09/22 12:19	1
Y Carrier	79.6		40 - 110					11/17/22 10:15	12/09/22 12:19	1

Eurofins Pittsburgh

Client Sample Results

Client: Haley & Aldrich, Inc.

Project/Site: CCR Groundwater Monitoring

Job ID: 180-147725-1

SDG: AB Brown

Client Sample ID: CCR-SP-1

Date Collected: 11/04/22 11:10

Date Received: 11/10/22 09:30

Lab Sample ID: 180-147725-1

Matrix: Water

Method: TAL-STL Ra226_Ra228 - Combined Radium-226 and Radium-228

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			(2σ+/-)	(2σ+/-)						
Combined Radium 226 + 228	0.0386	U	0.419	0.419	5.00	0.633	pCi/L		12/12/22 17:53	1

Client Sample ID: CCR-SP-2

Date Collected: 11/07/22 09:55

Date Received: 11/10/22 09:30

Lab Sample ID: 180-147725-2

Matrix: Water

Method: SW846 EPA 9056A - Anions, Ion Chromatography

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Chloride	72		1.0	0.71	mg/L			11/12/22 21:54	1
Fluoride	0.16		0.10	0.026	mg/L			11/12/22 21:54	1
Sulfate	390		1.0	0.76	mg/L			11/12/22 21:54	1

Method: SW846 EPA 6020A - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Antimony	0.00055	J B	0.0020	0.00051	mg/L		11/18/22 17:39	12/01/22 14:16	1
Arsenic	0.011		0.0010	0.00028	mg/L		11/18/22 17:39	12/01/22 14:16	1
Barium	0.096		0.010	0.0031	mg/L		11/18/22 17:39	12/01/22 14:16	1
Beryllium	ND		0.0010	0.00027	mg/L		11/18/22 17:39	12/01/22 14:16	1
Boron	0.17		0.080	0.060	mg/L		11/18/22 17:39	12/02/22 14:22	1
Cadmium	ND		0.0010	0.00022	mg/L		11/18/22 17:39	12/01/22 14:16	1
Calcium	180		0.50	0.13	mg/L		11/18/22 17:39	12/01/22 14:16	1
Chromium	ND		0.0020	0.0015	mg/L		11/18/22 17:39	12/01/22 14:16	1
Cobalt	0.00065		0.00050	0.00026	mg/L		11/18/22 17:39	12/01/22 14:16	1
Lead	0.0010	B	0.0010	0.00017	mg/L		11/18/22 17:39	12/01/22 14:16	1
Lithium	0.0053		0.0050	0.00083	mg/L		11/18/22 17:39	12/01/22 14:16	1
Molybdenum	0.0012	J	0.0050	0.00061	mg/L		11/18/22 17:39	12/01/22 14:16	1
Selenium	ND		0.0050	0.00074	mg/L		11/18/22 17:39	12/01/22 14:16	1
Thallium	ND		0.0010	0.00047	mg/L		11/18/22 17:39	12/01/22 14:16	1

Method: SW846 EPA 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	ND		0.00020	0.00013	mg/L		11/15/22 08:26	11/17/22 07:01	1

General Chemistry

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Total Dissolved Solids (SM 2540C)	1100		10	10	mg/L			11/11/22 16:10	1
Analyste	Result	Qualifier	RL	RL	Unit	D	Prepared	Analyzed	Dil Fac
pH (SW846 EPA 9040C)	7.6	HF	0.1	0.1	SU			11/14/22 21:16	1

Method: SW846 9315 - Radium-226 (GFPC)

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			(2σ+/-)	(2σ+/-)						
Radium-226	0.302	U	0.429	0.429	1.00	0.726	pCi/L	11/17/22 09:40	12/09/22 16:53	1
Carrier	%Yield	Qualifier	Limits					Prepared	Analyzed	Dil Fac
Ba Carrier	65.0		40 - 110					11/17/22 09:40	12/09/22 16:53	1

Eurofins Pittsburgh

Client Sample Results

Client: Haley & Aldrich, Inc.
Project/Site: CCR Groundwater Monitoring

Job ID: 180-147725-1
SDG: AB Brown

Client Sample ID: CCR-SP-2

Date Collected: 11/07/22 09:55
Date Received: 11/10/22 09:30

Lab Sample ID: 180-147725-2

Matrix: Water

Method: SW846 9320 - Radium-228 (GFPC)

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			(2σ+/-)	(2σ+/-)						
Radium-228	0.297	U	0.568	0.569	1.00	0.988	pCi/L	11/17/22 10:15	12/09/22 12:19	1
Carrier										
Ba Carrier	65.0		40 - 110					11/17/22 10:15	12/09/22 12:19	1
Y Carrier	78.9		40 - 110					11/17/22 10:15	12/09/22 12:19	1

Method: TAL-STL Ra226_Ra228 - Combined Radium-226 and Radium-228

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			(2σ+/-)	(2σ+/-)						
Combined Radium 226 + 228	0.599	U	0.712	0.713	5.00	0.988	pCi/L		12/12/22 17:53	1

Client Sample ID: CCR-SP-3

Date Collected: 11/07/22 11:15
Date Received: 11/10/22 09:30

Lab Sample ID: 180-147725-3

Matrix: Water

Method: SW846 EPA 9056A - Anions, Ion Chromatography

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Chloride	5.9		1.0	0.71	mg/L			11/12/22 22:13	1
Fluoride	0.26		0.10	0.026	mg/L			11/12/22 22:13	1
Sulfate	2.0		1.0	0.76	mg/L			11/12/22 22:13	1

Method: SW846 EPA 6020A - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Antimony	0.00052	J B	0.0020	0.00051	mg/L		11/18/22 17:39	12/01/22 14:20	1
Arsenic	0.0088		0.0010	0.00028	mg/L		11/18/22 17:39	12/01/22 14:20	1
Barium	0.076		0.010	0.0031	mg/L		11/18/22 17:39	12/01/22 14:20	1
Beryllium	ND		0.0010	0.00027	mg/L		11/18/22 17:39	12/01/22 14:20	1
Boron	ND		0.080	0.060	mg/L		11/18/22 17:39	12/02/22 14:26	1
Cadmium	ND		0.0010	0.00022	mg/L		11/18/22 17:39	12/01/22 14:20	1
Calcium	85		0.50	0.13	mg/L		11/18/22 17:39	12/01/22 14:20	1
Chromium	ND		0.0020	0.0015	mg/L		11/18/22 17:39	12/01/22 14:20	1
Cobalt	0.00054		0.00050	0.00026	mg/L		11/18/22 17:39	12/01/22 14:20	1
Lead	0.00042	J B	0.0010	0.00017	mg/L		11/18/22 17:39	12/01/22 14:20	1
Lithium	ND		0.0050	0.00083	mg/L		11/18/22 17:39	12/01/22 14:20	1
Molybdenum	0.011		0.0050	0.00061	mg/L		11/18/22 17:39	12/01/22 14:20	1
Selenium	ND		0.0050	0.00074	mg/L		11/18/22 17:39	12/01/22 14:20	1
Thallium	ND		0.0010	0.00047	mg/L		11/18/22 17:39	12/01/22 14:20	1

Method: SW846 EPA 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	ND		0.00020	0.00013	mg/L		11/15/22 08:26	11/17/22 07:02	1

General Chemistry

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Total Dissolved Solids (SM 2540C)	380		10	10	mg/L			11/11/22 16:10	1
pH (SW846 EPA 9040C)	7.7	HF	0.1	0.1	SU			11/14/22 21:22	1

Eurofins Pittsburgh

Client Sample Results

Client: Haley & Aldrich, Inc.
Project/Site: CCR Groundwater Monitoring

Job ID: 180-147725-1
SDG: AB Brown

Client Sample ID: CCR-SP-3

Date Collected: 11/07/22 11:15
Date Received: 11/10/22 09:30

Lab Sample ID: 180-147725-3

Matrix: Water

Method: SW846 9315 - Radium-226 (GFPC)

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			Uncert.	(2σ+/-)						
Radium-226	0.0319	U	0.177	0.177	1.00	0.350	pCi/L	11/17/22 09:40	12/09/22 16:53	1
Carrier	%Yield	Qualifier	Limits					Prepared	Analyzed	Dil Fac
Ba Carrier	83.3		40 - 110					11/17/22 09:40	12/09/22 16:53	1

Method: SW846 9320 - Radium-228 (GFPC)

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			Uncert.	(2σ+/-)						
Radium-228	0.552	U	0.394	0.397	1.00	0.591	pCi/L	11/17/22 10:15	12/09/22 12:20	1
Carrier	%Yield	Qualifier	Limits					Prepared	Analyzed	Dil Fac
Ba Carrier	83.3		40 - 110					11/17/22 10:15	12/09/22 12:20	1
Y Carrier	80.4		40 - 110					11/17/22 10:15	12/09/22 12:20	1

Method: TAL-STL Ra226_Ra228 - Combined Radium-226 and Radium-228

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			Uncert.	(2σ+/-)						
Combined Radium 226 + 228	0.584	U	0.432	0.435	5.00	0.591	pCi/L		12/12/22 17:53	1

Client Sample ID: BLIND DUP

Date Collected: 11/07/22 00:01
Date Received: 11/10/22 09:30

Lab Sample ID: 180-147725-4

Matrix: Water

Method: SW846 EPA 9056A - Anions, Ion Chromatography

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Chloride	72		1.0	0.71	mg/L			11/12/22 22:31	1
Fluoride	0.16		0.10	0.026	mg/L			11/12/22 22:31	1
Sulfate	390		1.0	0.76	mg/L			11/12/22 22:31	1

Method: SW846 EPA 6020A - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Antimony	ND		0.0020	0.00051	mg/L			12/01/22 14:23	1
Arsenic	0.0092		0.0010	0.00028	mg/L			12/01/22 14:23	1
Barium	0.10		0.010	0.0031	mg/L			12/01/22 14:23	1
Beryllium	ND		0.0010	0.00027	mg/L			12/01/22 14:23	1
Boron	0.12		0.080	0.060	mg/L			12/02/22 14:37	1
Cadmium	ND		0.0010	0.00022	mg/L			12/01/22 14:23	1
Calcium	190		0.50	0.13	mg/L			12/01/22 14:23	1
Chromium	ND		0.0020	0.0015	mg/L			12/01/22 14:23	1
Cobalt	0.00063		0.00050	0.00026	mg/L			12/01/22 14:23	1
Lead	0.00077	J B	0.0010	0.00017	mg/L			12/01/22 14:23	1
Lithium	0.0057		0.0050	0.00083	mg/L			12/01/22 14:23	1
Molybdenum	0.00096	J	0.0050	0.00061	mg/L			12/01/22 14:23	1
Selenium	ND		0.0050	0.00074	mg/L			12/01/22 14:23	1
Thallium	ND		0.0010	0.00047	mg/L			12/01/22 14:23	1

Eurofins Pittsburgh

Client Sample Results

Client: Haley & Aldrich, Inc.
Project/Site: CCR Groundwater Monitoring

Job ID: 180-147725-1
SDG: AB Brown

Client Sample ID: BLIND DUP

Date Collected: 11/07/22 00:01
Date Received: 11/10/22 09:30

Lab Sample ID: 180-147725-4

Matrix: Water

Method: SW846 EPA 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	ND		0.00020	0.00013	mg/L		11/15/22 08:26	11/17/22 07:03	1

General Chemistry

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Total Dissolved Solids (SM 2540C)	1100		10	10	mg/L			11/11/22 16:10	1
pH (SW846 EPA 9040C)	7.5	HF	0.1	0.1	SU			11/14/22 21:28	1

Method: SW846 9315 - Radium-226 (GFPC)

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			(2σ+/-)	(2σ+/-)						
Radium-226	0.294	U	0.260	0.262	1.00	0.399	pCi/L	11/17/22 09:40	12/09/22 16:53	1
Carrier	%Yield	Qualifier	Limits					Prepared	Analyzed	Dil Fac
Ba Carrier	86.2		40 - 110					11/17/22 09:40	12/09/22 16:53	1

Method: SW846 9320 - Radium-228 (GFPC)

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			(2σ+/-)	(2σ+/-)						
Radium-228	0.786		0.443	0.449	1.00	0.640	pCi/L	11/17/22 10:15	12/09/22 12:20	1
Carrier	%Yield	Qualifier	Limits					Prepared	Analyzed	Dil Fac
Ba Carrier	86.2		40 - 110					11/17/22 10:15	12/09/22 12:20	1
Y Carrier	80.7		40 - 110					11/17/22 10:15	12/09/22 12:20	1

Method: TAL-STL Ra226_Ra228 - Combined Radium-226 and Radium-228

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			(2σ+/-)	(2σ+/-)						
Combined Radium 226 + 228	1.08		0.514	0.520	5.00	0.640	pCi/L		12/12/22 17:53	1

Client Sample ID: FIELD BLANK

Date Collected: 11/07/22 11:15
Date Received: 11/10/22 09:30

Lab Sample ID: 180-147725-5

Matrix: Water

Method: SW846 EPA 9056A - Anions, Ion Chromatography

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Chloride	ND		1.0	0.71	mg/L			11/12/22 23:45	1
Fluoride	0.18		0.10	0.026	mg/L			11/16/22 17:39	1
Sulfate	0.78	J	1.0	0.76	mg/L			11/12/22 23:45	1

Method: SW846 EPA 6020A - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Antimony	0.0011	J B	0.0020	0.00051	mg/L		11/18/22 17:39	12/01/22 14:34	1
Arsenic	ND		0.0010	0.00028	mg/L		11/18/22 17:39	12/01/22 14:34	1
Barium	ND		0.010	0.0031	mg/L		11/18/22 17:39	12/01/22 14:34	1
Beryllium	ND		0.0010	0.00027	mg/L		11/18/22 17:39	12/01/22 14:34	1
Boron	ND		0.080	0.060	mg/L		11/18/22 17:39	12/02/22 14:41	1
Cadmium	ND		0.0010	0.00022	mg/L		11/18/22 17:39	12/01/22 14:34	1

Eurofins Pittsburgh

Client Sample Results

Client: Haley & Aldrich, Inc.
Project/Site: CCR Groundwater Monitoring

Job ID: 180-147725-1
SDG: AB Brown

Client Sample ID: FIELD BLANK

Date Collected: 11/07/22 11:15
Date Received: 11/10/22 09:30

Lab Sample ID: 180-147725-5

Matrix: Water

Method: SW846 EPA 6020A - Metals (ICP/MS) - Total Recoverable (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Calcium	ND		0.50	0.13	mg/L		11/18/22 17:39	12/01/22 14:34	1
Chromium	0.0019	J	0.0020	0.0015	mg/L		11/18/22 17:39	12/01/22 14:34	1
Cobalt	ND		0.00050	0.00026	mg/L		11/18/22 17:39	12/01/22 14:34	1
Lead	0.00035	J B	0.0010	0.00017	mg/L		11/18/22 17:39	12/01/22 14:34	1
Lithium	ND		0.0050	0.00083	mg/L		11/18/22 17:39	12/01/22 14:34	1
Molybdenum	ND		0.0050	0.00061	mg/L		11/18/22 17:39	12/01/22 14:34	1
Selenium	ND		0.0050	0.00074	mg/L		11/18/22 17:39	12/01/22 14:34	1
Thallium	ND		0.0010	0.00047	mg/L		11/18/22 17:39	12/01/22 14:34	1

Method: SW846 EPA 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	ND		0.00020	0.00013	mg/L		11/15/22 08:26	11/17/22 07:04	1

General Chemistry

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Total Dissolved Solids (SM 2540C)	ND		10	10	mg/L			11/11/22 16:10	1
Analyte	Result	Qualifier	RL	RL	Unit	D	Prepared	Analyzed	Dil Fac
pH (SW846 EPA 9040C)	5.9	HF	0.1	0.1	SU			11/14/22 21:33	1

Method: SW846 9315 - Radium-226 (GFPC)

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			(2σ+/-)	(2σ+/-)						
Radium-226	0.135	U	0.252	0.252	1.00	0.441	pCi/L	11/17/22 09:40	12/09/22 16:53	1
Carrier	%Yield	Qualifier	Limits					Prepared	Analyzed	Dil Fac
Ba Carrier	97.1		40 - 110					11/17/22 09:40	12/09/22 16:53	1

Method: SW846 9320 - Radium-228 (GFPC)

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			(2σ+/-)	(2σ+/-)						
Radium-228	0.406	U	0.325	0.327	1.00	0.503	pCi/L	11/17/22 10:15	12/09/22 12:20	1
Carrier	%Yield	Qualifier	Limits					Prepared	Analyzed	Dil Fac
Ba Carrier	97.1		40 - 110					11/17/22 10:15	12/09/22 12:20	1
Y Carrier	87.1		40 - 110					11/17/22 10:15	12/09/22 12:20	1

Method: TAL-STL Ra226_Ra228 - Combined Radium-226 and Radium-228

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			(2σ+/-)	(2σ+/-)						
Combined Radium 226 + 228	0.541		0.411	0.413	5.00	0.503	pCi/L		12/12/22 17:53	1

Client Sample ID: CCR-BK-1

Date Collected: 11/08/22 10:15
Date Received: 11/10/22 09:30

Lab Sample ID: 180-147725-6

Matrix: Water

Method: SW846 EPA 9056A - Anions, Ion Chromatography

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Chloride	8.9		1.0	0.71	mg/L			11/13/22 00:03	1

Eurofins Pittsburgh

Client Sample Results

Client: Haley & Aldrich, Inc.

Project/Site: CCR Groundwater Monitoring

Job ID: 180-147725-1

SDG: AB Brown

Client Sample ID: CCR-BK-1

Lab Sample ID: 180-147725-6

Matrix: Water

Date Collected: 11/08/22 10:15

Date Received: 11/10/22 09:30

Method: SW846 EPA 9056A - Anions, Ion Chromatography (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Fluoride	0.23		0.10	0.026	mg/L			11/13/22 00:03	1
Sulfate	41		1.0	0.76	mg/L			11/13/22 00:03	1

Method: SW846 EPA 6020A - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Antimony	0.00065	J B	0.0020	0.00051	mg/L		11/18/22 17:39	12/01/22 14:38	1
Arsenic	ND		0.0010	0.00028	mg/L		11/18/22 17:39	12/01/22 14:38	1
Barium	0.063		0.010	0.0031	mg/L		11/18/22 17:39	12/01/22 14:38	1
Beryllium	ND		0.0010	0.00027	mg/L		11/18/22 17:39	12/01/22 14:38	1
Boron	ND		0.080	0.060	mg/L		11/18/22 17:39	12/02/22 14:44	1
Cadmium	ND		0.0010	0.00022	mg/L		11/18/22 17:39	12/01/22 14:38	1
Calcium	47		0.50	0.13	mg/L		11/18/22 17:39	12/01/22 14:38	1
Chromium	0.0020		0.0020	0.0015	mg/L		11/18/22 17:39	12/01/22 14:38	1
Cobalt	ND		0.00050	0.00026	mg/L		11/18/22 17:39	12/01/22 14:38	1
Lead	0.00071	J B	0.0010	0.00017	mg/L		11/18/22 17:39	12/01/22 14:38	1
Lithium	0.0065		0.0050	0.00083	mg/L		11/18/22 17:39	12/01/22 14:38	1
Molybdenum	0.0011	J	0.0050	0.00061	mg/L		11/18/22 17:39	12/01/22 14:38	1
Selenium	ND		0.0050	0.00074	mg/L		11/18/22 17:39	12/01/22 14:38	1
Thallium	ND		0.0010	0.00047	mg/L		11/18/22 17:39	12/01/22 14:38	1

Method: SW846 EPA 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	ND		0.00020	0.00013	mg/L		11/15/22 08:26	11/17/22 07:05	1

General Chemistry

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Total Dissolved Solids (SM 2540C)	290		10	10	mg/L			11/11/22 16:10	1
Analyte	Result	Qualifier	RL	RL	Unit	D	Prepared	Analyzed	Dil Fac
pH (SW846 EPA 9040C)	7.5	HF	0.1	0.1	SU			11/14/22 21:39	1

Method: SW846 9315 - Radium-226 (GFPC)

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			Uncert. (2σ+/-)	Uncert. (2σ+/-)						
Radium-226	0.390		0.203	0.207	1.00	0.225	pCi/L	11/17/22 09:40	12/09/22 22:40	1
Carrier	%Yield	Qualifier	Limits					Prepared	Analyzed	Dil Fac
Ba Carrier	94.0		40 - 110					11/17/22 09:40	12/09/22 22:40	1

Method: SW846 9320 - Radium-228 (GFPC)

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			Uncert. (2σ+/-)	Uncert. (2σ+/-)						
Radium-228	0.118	U	0.297	0.297	1.00	0.524	pCi/L	11/17/22 10:15	12/09/22 12:20	1
Carrier	%Yield	Qualifier	Limits					Prepared	Analyzed	Dil Fac
Ba Carrier	94.0		40 - 110					11/17/22 10:15	12/09/22 12:20	1
Y Carrier	84.9		40 - 110					11/17/22 10:15	12/09/22 12:20	1

Eurofins Pittsburgh

Client Sample Results

Client: Haley & Aldrich, Inc.
Project/Site: CCR Groundwater Monitoring

Job ID: 180-147725-1
SDG: AB Brown

Client Sample ID: CCR-BK-1

Date Collected: 11/08/22 10:15
Date Received: 11/10/22 09:30

Lab Sample ID: 180-147725-6

Matrix: Water

Method: TAL-STL Ra226_Ra228 - Combined Radium-226 and Radium-228

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			(2σ+/-)	(2σ+/-)						
Combined Radium 226 + 228	0.509	U	0.360	0.362	5.00	0.524	pCi/L		12/12/22 17:53	1

Client Sample ID: CCR-BK-2

Date Collected: 11/08/22 12:15
Date Received: 11/10/22 09:30

Lab Sample ID: 180-147725-7

Matrix: Water

Method: SW846 EPA 9056A - Anions, Ion Chromatography

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Chloride	19		1.0	0.71	mg/L			11/13/22 00:22	1
Fluoride	0.11		0.10	0.026	mg/L			11/13/22 00:22	1
Sulfate	22		1.0	0.76	mg/L			11/13/22 00:22	1

Method: SW846 EPA 6020A - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Antimony	ND		0.0020	0.00051	mg/L			12/01/22 14:41	1
Arsenic	ND		0.0010	0.00028	mg/L			12/01/22 14:41	1
Barium	0.036		0.010	0.0031	mg/L			12/01/22 14:41	1
Beryllium	ND		0.0010	0.00027	mg/L			12/01/22 14:41	1
Boron	ND		0.080	0.060	mg/L			12/02/22 14:48	1
Cadmium	ND		0.0010	0.00022	mg/L			12/01/22 14:41	1
Calcium	39		0.50	0.13	mg/L			12/01/22 14:41	1
Chromium	0.0018	J	0.0020	0.0015	mg/L			12/01/22 14:41	1
Cobalt	ND		0.00050	0.00026	mg/L			12/01/22 14:41	1
Lead	0.00074	J B	0.0010	0.00017	mg/L			12/01/22 14:41	1
Lithium	0.0021	J	0.0050	0.00083	mg/L			12/01/22 14:41	1
Molybdenum	ND		0.0050	0.00061	mg/L			12/01/22 14:41	1
Selenium	ND		0.0050	0.00074	mg/L			12/01/22 14:41	1
Thallium	ND		0.0010	0.00047	mg/L			12/01/22 14:41	1

Method: SW846 EPA 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	ND		0.00020	0.00013	mg/L			11/17/22 07:06	1

General Chemistry

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Total Dissolved Solids (SM 2540C)	240		10	10	mg/L			11/11/22 16:10	1
Analyte	Result	Qualifier	RL	RL	Unit	D	Prepared	Analyzed	Dil Fac
pH (SW846 EPA 9040C)	7.4	HF	0.1	0.1	SU			11/14/22 21:44	1

Method: SW846 9315 - Radium-226 (GFPC)

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			(2σ+/-)	(2σ+/-)						
Radium-226	0.189	U	0.209	0.210	1.00	0.332	pCi/L	11/17/22 09:40	12/09/22 22:40	1
Carrier	%Yield	Qualifier	Limits					Prepared	Analyzed	Dil Fac
Ba Carrier	93.2		40 - 110					11/17/22 09:40	12/09/22 22:40	1

Eurofins Pittsburgh

Client Sample Results

Client: Haley & Aldrich, Inc.
Project/Site: CCR Groundwater Monitoring

Job ID: 180-147725-1
SDG: AB Brown

Client Sample ID: CCR-BK-2

Date Collected: 11/08/22 12:15
Date Received: 11/10/22 09:30

Lab Sample ID: 180-147725-7

Matrix: Water

Method: SW846 9320 - Radium-228 (GFPC)

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			(2σ+/-)	(2σ+/-)						
Radium-228	0.705	U	0.489	0.494	1.00	0.741	pCi/L	11/17/22 10:15	12/09/22 12:26	1
Carrier										
Ba Carrier	93.2		40 - 110					11/17/22 10:15	12/09/22 12:26	1
Y Carrier	84.5		40 - 110					11/17/22 10:15	12/09/22 12:26	1

Method: TAL-STL Ra226_Ra228 - Combined Radium-226 and Radium-228

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			(2σ+/-)	(2σ+/-)						
Combined Radium 226 + 228	0.894		0.532	0.537	5.00	0.741	pCi/L		12/12/22 17:53	1

Client Sample ID: CCR-AP-2R

Date Collected: 11/08/22 15:15
Date Received: 11/10/22 09:30

Lab Sample ID: 180-147725-8

Matrix: Water

Method: SW846 EPA 9056A - Anions, Ion Chromatography

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Chloride	490		1.0	0.71	mg/L			11/13/22 01:17	1
Fluoride	0.35		0.10	0.026	mg/L			11/13/22 01:17	1
Sulfate	3200		10	7.6	mg/L			11/16/22 01:43	10

Method: SW846 EPA 6020A - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Antimony	ND		0.0020	0.00051	mg/L		11/18/22 17:39	12/01/22 14:45	1
Arsenic	0.00034	J	0.0010	0.00028	mg/L		11/18/22 17:39	12/01/22 14:45	1
Barium	0.049		0.010	0.0031	mg/L		11/18/22 17:39	12/01/22 14:45	1
Beryllium	ND		0.0010	0.00027	mg/L		11/18/22 17:39	12/01/22 14:45	1
Boron	11		0.80	0.60	mg/L		11/18/22 17:39	12/04/22 14:03	10
Cadmium	ND		0.0010	0.00022	mg/L		11/18/22 17:39	12/01/22 14:45	1
Calcium	400		0.50	0.13	mg/L		11/18/22 17:39	12/01/22 14:45	1
Chromium	ND		0.0020	0.0015	mg/L		11/18/22 17:39	12/01/22 14:45	1
Cobalt	0.0026		0.00050	0.00026	mg/L		11/18/22 17:39	12/01/22 14:45	1
Lead	0.00033	J B	0.0010	0.00017	mg/L		11/18/22 17:39	12/01/22 14:45	1
Lithium	0.027		0.0050	0.00083	mg/L		11/18/22 17:39	12/01/22 14:45	1
Molybdenum	1.4		0.0050	0.00061	mg/L		11/18/22 17:39	12/01/22 14:45	1
Selenium	ND		0.0050	0.00074	mg/L		11/18/22 17:39	12/01/22 14:45	1
Thallium	ND		0.0010	0.00047	mg/L		11/18/22 17:39	12/01/22 14:45	1

Method: SW846 EPA 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	ND		0.00020	0.00013	mg/L		11/15/22 08:26	11/17/22 07:11	1

General Chemistry

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Total Dissolved Solids (SM 2540C)	4800		40	40	mg/L			11/11/22 16:10	1
pH (SW846 EPA 9040C)	7.4	HF	0.1	0.1	SU			11/14/22 21:50	1

Eurofins Pittsburgh

Client Sample Results

Client: Haley & Aldrich, Inc.
Project/Site: CCR Groundwater Monitoring

Job ID: 180-147725-1
SDG: AB Brown

Client Sample ID: CCR-AP-2R

Date Collected: 11/08/22 15:15
Date Received: 11/10/22 09:30

Lab Sample ID: 180-147725-8
Matrix: Water

Method: SW846 9315 - Radium-226 (GFPC)

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			(2σ+/-)	(2σ+/-)						
Radium-226	0.411		0.212	0.215	1.00	0.239	pCi/L	11/17/22 09:40	12/09/22 22:40	1
Carrier	%Yield	Qualifier	Limits					Prepared	Analyzed	Dil Fac
Ba Carrier	95.7		40 - 110					11/17/22 09:40	12/09/22 22:40	1

Method: SW846 9320 - Radium-228 (GFPC)

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			(2σ+/-)	(2σ+/-)						
Radium-228	0.405	U	0.362	0.364	1.00	0.575	pCi/L	11/17/22 10:15	12/09/22 12:26	1
Carrier	%Yield	Qualifier	Limits					Prepared	Analyzed	Dil Fac
Ba Carrier	95.7		40 - 110					11/17/22 10:15	12/09/22 12:26	1
Y Carrier	84.1		40 - 110					11/17/22 10:15	12/09/22 12:26	1

Method: TAL-STL Ra226_Ra228 - Combined Radium-226 and Radium-228

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			(2σ+/-)	(2σ+/-)						
Combined Radium 226 + 228	0.816		0.420	0.423	5.00	0.575	pCi/L		12/12/22 17:53	1

Client Sample ID: CCR-AP-2I

Date Collected: 11/08/22 16:15
Date Received: 11/10/22 09:30

Lab Sample ID: 180-147725-9
Matrix: Water

Method: SW846 EPA 9056A - Anions, Ion Chromatography

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Chloride	100		1.0	0.71	mg/L			11/13/22 01:36	1
Fluoride	1.0		0.10	0.026	mg/L			11/13/22 01:36	1
Sulfate	1.7		1.0	0.76	mg/L			11/13/22 01:36	1

Method: SW846 EPA 6020A - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Antimony	ND		0.0020	0.00051	mg/L			12/01/22 15:00	1
Arsenic	0.00043	J	0.0010	0.00028	mg/L			12/01/22 15:00	1
Barium	0.098		0.010	0.0031	mg/L			12/01/22 15:00	1
Beryllium	ND		0.0010	0.00027	mg/L			12/01/22 15:00	1
Boron	2.2		0.080	0.060	mg/L			12/02/22 15:06	1
Cadmium	ND		0.0010	0.00022	mg/L			12/01/22 15:00	1
Calcium	10		0.50	0.13	mg/L			12/01/22 15:00	1
Chromium	ND		0.0020	0.0015	mg/L			12/01/22 15:00	1
Cobalt	ND		0.00050	0.00026	mg/L			12/01/22 15:00	1
Lead	0.00031	J B	0.0010	0.00017	mg/L			12/01/22 15:00	1
Lithium	0.021		0.0050	0.00083	mg/L			12/01/22 15:00	1
Molybdenum	ND		0.0050	0.00061	mg/L			12/01/22 15:00	1
Selenium	ND		0.0050	0.00074	mg/L			12/01/22 15:00	1
Thallium	ND		0.0010	0.00047	mg/L			12/01/22 15:00	1

Eurofins Pittsburgh

Client Sample Results

Client: Haley & Aldrich, Inc.
Project/Site: CCR Groundwater Monitoring

Job ID: 180-147725-1
SDG: AB Brown

Client Sample ID: CCR-AP-2I

Date Collected: 11/08/22 16:15
Date Received: 11/10/22 09:30

Lab Sample ID: 180-147725-9

Matrix: Water

Method: SW846 EPA 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	ND		0.00020	0.00013	mg/L		11/15/22 08:26	11/17/22 07:12	1

General Chemistry

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Total Dissolved Solids (SM 2540C)	710		10	10	mg/L			11/11/22 16:10	1
pH (SW846 EPA 9040C)	8.2	HF	0.1	0.1	SU			11/14/22 21:56	1

Method: SW846 9315 - Radium-226 (GFPC)

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			(2σ+/-)	(2σ+/-)						
Radium-226	0.358		0.200	0.203	1.00	0.241	pCi/L	11/17/22 09:40	12/09/22 22:40	1
Carrier	%Yield	Qualifier	Limits					Prepared	Analyzed	Dil Fac
Ba Carrier	96.6		40 - 110					11/17/22 09:40	12/09/22 22:40	1

Method: SW846 9320 - Radium-228 (GFPC)

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			(2σ+/-)	(2σ+/-)						
Radium-228	0.171	U	0.312	0.313	1.00	0.538	pCi/L	11/17/22 10:15	12/09/22 12:26	1
Carrier	%Yield	Qualifier	Limits					Prepared	Analyzed	Dil Fac
Ba Carrier	96.6		40 - 110					11/17/22 10:15	12/09/22 12:26	1
Y Carrier	81.5		40 - 110					11/17/22 10:15	12/09/22 12:26	1

Method: TAL-STL Ra226_Ra228 - Combined Radium-226 and Radium-228

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			(2σ+/-)	(2σ+/-)						
Combined Radium 226 + 228	0.529	U	0.371	0.373	5.00	0.538	pCi/L		12/12/22 17:53	1

Client Sample ID: CCR-AP-3R

Date Collected: 11/09/22 10:00
Date Received: 11/10/22 09:30

Lab Sample ID: 180-147725-10

Matrix: Water

Method: SW846 EPA 9056A - Anions, Ion Chromatography

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Chloride	730		1.0	0.71	mg/L			11/13/22 02:13	1
Fluoride	0.79		0.10	0.026	mg/L			11/13/22 02:13	1
Sulfate	4200		10	7.6	mg/L			11/13/22 02:31	10

Method: SW846 EPA 6020A - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Antimony	ND		0.0020	0.00051	mg/L		11/18/22 17:39	12/01/22 15:03	1
Arsenic	ND		0.0010	0.00028	mg/L		11/18/22 17:39	12/01/22 15:03	1
Barium	0.021		0.010	0.0031	mg/L		11/18/22 17:39	12/01/22 15:03	1
Beryllium	ND		0.0010	0.00027	mg/L		11/18/22 17:39	12/01/22 15:03	1
Boron	12		0.80	0.60	mg/L		11/18/22 17:39	12/04/22 14:06	10
Cadmium	ND		0.0010	0.00022	mg/L		11/18/22 17:39	12/01/22 15:03	1

Eurofins Pittsburgh

Client Sample Results

Client: Haley & Aldrich, Inc.
Project/Site: CCR Groundwater Monitoring

Job ID: 180-147725-1
SDG: AB Brown

Client Sample ID: CCR-AP-3R

Lab Sample ID: 180-147725-10

Matrix: Water

Date Collected: 11/09/22 10:00
Date Received: 11/10/22 09:30

Method: SW846 EPA 6020A - Metals (ICP/MS) - Total Recoverable (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Calcium	390		0.50	0.13	mg/L		11/18/22 17:39	12/01/22 15:03	1
Chromium	0.0022		0.0020	0.0015	mg/L		11/18/22 17:39	12/01/22 15:03	1
Cobalt	0.00048	J	0.00050	0.00026	mg/L		11/18/22 17:39	12/01/22 15:03	1
Lead	0.00036	J B	0.0010	0.00017	mg/L		11/18/22 17:39	12/01/22 15:03	1
Lithium	0.059		0.0050	0.00083	mg/L		11/18/22 17:39	12/01/22 15:03	1
Molybdenum	0.73		0.0050	0.00061	mg/L		11/18/22 17:39	12/01/22 15:03	1
Selenium	0.0033	J	0.0050	0.00074	mg/L		11/18/22 17:39	12/01/22 15:03	1
Thallium	ND		0.0010	0.00047	mg/L		11/18/22 17:39	12/01/22 15:03	1

Method: SW846 EPA 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	ND		0.00020	0.00013	mg/L		11/15/22 08:26	11/17/22 07:13	1

General Chemistry

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Total Dissolved Solids (SM 2540C)	6700		50	50	mg/L			11/11/22 16:10	1
Analyte	Result	Qualifier	RL	RL	Unit	D	Prepared	Analyzed	Dil Fac
pH (SW846 EPA 9040C)	7.6	HF	0.1	0.1	SU			11/14/22 22:06	1

Method: SW846 9315 - Radium-226 (GFPC)

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			(2σ+/-)	(2σ+/-)						
Radium-226	0.148	U	0.165	0.165	1.00	0.264	pCi/L	11/17/22 09:40	12/09/22 22:40	1
Carrier	%Yield	Qualifier	Limits					Prepared	Analyzed	Dil Fac
Ba Carrier	100		40 - 110					11/17/22 09:40	12/09/22 22:40	1

Method: SW846 9320 - Radium-228 (GFPC)

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			(2σ+/-)	(2σ+/-)						
Radium-228	0.324	U	0.312	0.314	1.00	0.499	pCi/L	11/17/22 10:15	12/09/22 12:26	1
Carrier	%Yield	Qualifier	Limits					Prepared	Analyzed	Dil Fac
Ba Carrier	100		40 - 110					11/17/22 10:15	12/09/22 12:26	1
Y Carrier	81.5		40 - 110					11/17/22 10:15	12/09/22 12:26	1

Method: TAL-STL Ra226_Ra228 - Combined Radium-226 and Radium-228

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			(2σ+/-)	(2σ+/-)						
Combined Radium 226 + 228	0.471	U	0.353	0.355	5.00	0.499	pCi/L		12/12/22 17:53	1

Client Sample ID: CCR-AP-3I

Lab Sample ID: 180-147725-11

Date Collected: 11/09/22 11:30
Date Received: 11/10/22 09:30

Method: SW846 EPA 9056A - Anions, Ion Chromatography

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Chloride	140		1.0	0.71	mg/L			11/13/22 01:54	1

Eurofins Pittsburgh

Client Sample Results

Client: Haley & Aldrich, Inc.

Project/Site: CCR Groundwater Monitoring

Job ID: 180-147725-1

SDG: AB Brown

Client Sample ID: CCR-AP-3I

Date Collected: 11/09/22 11:30

Date Received: 11/10/22 09:30

Lab Sample ID: 180-147725-11

Matrix: Water

Method: SW846 EPA 9056A - Anions, Ion Chromatography (Continued)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Fluoride	1.3		0.10	0.026	mg/L			11/13/22 01:54	1
Sulfate	26		1.0	0.76	mg/L			11/13/22 01:54	1

Method: SW846 EPA 6020A - Metals (ICP/MS) - Total Recoverable

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Antimony	0.00063	J B	0.0020	0.00051	mg/L		11/18/22 17:39	12/01/22 15:18	1
Arsenic	0.00044	J	0.0010	0.00028	mg/L		11/18/22 17:39	12/01/22 15:18	1
Barium	0.12		0.010	0.0031	mg/L		11/18/22 17:39	12/01/22 15:18	1
Beryllium	ND		0.0010	0.00027	mg/L		11/18/22 17:39	12/01/22 15:18	1
Boron	1.8		0.080	0.060	mg/L		11/18/22 17:39	12/02/22 15:24	1
Cadmium	ND		0.0010	0.00022	mg/L		11/18/22 17:39	12/01/22 15:18	1
Calcium	25		0.50	0.13	mg/L		11/18/22 17:39	12/01/22 15:18	1
Chromium	ND		0.0020	0.0015	mg/L		11/18/22 17:39	12/01/22 15:18	1
Cobalt	ND		0.00050	0.00026	mg/L		11/18/22 17:39	12/01/22 15:18	1
Lead	0.00053	J B	0.0010	0.00017	mg/L		11/18/22 17:39	12/01/22 15:18	1
Lithium	0.019		0.0050	0.00083	mg/L		11/18/22 17:39	12/01/22 15:18	1
Molybdenum	0.0032	J	0.0050	0.00061	mg/L		11/18/22 17:39	12/01/22 15:18	1
Selenium	ND		0.0050	0.00074	mg/L		11/18/22 17:39	12/01/22 15:18	1
Thallium	ND		0.0010	0.00047	mg/L		11/18/22 17:39	12/01/22 15:18	1

Method: SW846 EPA 7470A - Mercury (CVAA)

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	ND		0.00020	0.00013	mg/L		11/15/22 08:26	11/17/22 09:14	1

General Chemistry

Analyte	Result	Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Total Dissolved Solids (SM 2540C)	770		10	10	mg/L			11/11/22 16:10	1
Analyte	Result	Qualifier	RL	RL	Unit	D	Prepared	Analyzed	Dil Fac
pH (SW846 EPA 9040C)	8.2	HF	0.1	0.1	SU			11/14/22 22:17	1

Method: SW846 9315 - Radium-226 (GFPC)

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			Uncert. (2σ+/-)	Uncert. (2σ+/-)						
Radium-226	0.587		0.291	0.296	1.00	0.367	pCi/L	11/17/22 09:40	12/09/22 16:55	1
Carrier	%Yield	Qualifier	Limits					Prepared	Analyzed	Dil Fac
Ba Carrier	94.0		40 - 110					11/17/22 09:40	12/09/22 16:55	1

Method: SW846 9320 - Radium-228 (GFPC)

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			Uncert. (2σ+/-)	Uncert. (2σ+/-)						
Radium-228	0.402	U	0.366	0.368	1.00	0.582	pCi/L	11/17/22 10:15	12/09/22 12:26	1
Carrier	%Yield	Qualifier	Limits					Prepared	Analyzed	Dil Fac
Ba Carrier	94.0		40 - 110					11/17/22 10:15	12/09/22 12:26	1
Y Carrier	82.6		40 - 110					11/17/22 10:15	12/09/22 12:26	1

Eurofins Pittsburgh

Client Sample Results

Client: Haley & Aldrich, Inc.
Project/Site: CCR Groundwater Monitoring

Job ID: 180-147725-1
SDG: AB Brown

Client Sample ID: CCR-AP-3I

Lab Sample ID: 180-147725-11

Date Collected: 11/09/22 11:30

Matrix: Water

Date Received: 11/10/22 09:30

Method: TAL-STL Ra226_Ra228 - Combined Radium-226 and Radium-228

Analyte	Result	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
			(2 σ +/-)	(2 σ +/-)						
Combined Radium 226 + 228	0.989		0.468	0.472	5.00	0.582	pCi/L		12/12/22 17:53	1

QC Sample Results

Client: Haley & Aldrich, Inc.
Project/Site: CCR Groundwater Monitoring

Job ID: 180-147725-1
SDG: AB Brown

Method: EPA 9056A - Anions, Ion Chromatography

Lab Sample ID: MB 180-418020/22

Matrix: Water

Analysis Batch: 418020

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Chloride	ND		1.0	0.71	mg/L			11/12/22 17:55	1
Fluoride	ND		0.10	0.026	mg/L			11/12/22 17:55	1
Sulfate	ND		1.0	0.76	mg/L			11/12/22 17:55	1

Lab Sample ID: LCS 180-418020/23

Matrix: Water

Analysis Batch: 418020

Analyte		Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
Chloride		50.0	51.8		mg/L		104	80 - 120
Fluoride		2.50	2.72		mg/L		109	80 - 120
Sulfate		50.0	50.8		mg/L		102	80 - 120

Lab Sample ID: 180-147725-1 MS

Matrix: Water

Analysis Batch: 418020

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec Limits
Chloride	97		125	229		mg/L		106	80 - 120
Fluoride	0.22	J	6.25	6.90		mg/L		107	80 - 120
Sulfate	810		125	925	4	mg/L		93	80 - 120

Lab Sample ID: 180-147725-1 MSD

Matrix: Water

Analysis Batch: 418020

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec Limits	RPD	RPD Limit
Chloride	97		125	229		mg/L		106	80 - 120	0	15
Fluoride	0.22	J	6.25	7.06		mg/L		109	80 - 120	2	15
Sulfate	810		125	924	4	mg/L		92	80 - 120	0	15

Lab Sample ID: MB 180-418279/22

Matrix: Water

Analysis Batch: 418279

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Sulfate	ND		1.0	0.76	mg/L			11/15/22 21:42	1

Lab Sample ID: LCS 180-418279/23

Matrix: Water

Analysis Batch: 418279

Analyte		Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
Sulfate		50.0	51.3		mg/L		103	80 - 120

Eurofins Pittsburgh

QC Sample Results

Client: Haley & Aldrich, Inc.
Project/Site: CCR Groundwater Monitoring

Job ID: 180-147725-1
SDG: AB Brown

Method: EPA 9056A - Anions, Ion Chromatography (Continued)

Lab Sample ID: 180-147910-D-1 MS

Matrix: Water

Analysis Batch: 418279

Client Sample ID: Matrix Spike
Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec Limits		
Sulfate	620		500	1110		mg/L	99	80 - 120			

Lab Sample ID: 180-147910-D-1 MSD

Matrix: Water

Analysis Batch: 418279

Client Sample ID: Matrix Spike Duplicate
Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec Limits	RPD	RPD Limit
Sulfate	620		500	1120		mg/L	100	80 - 120		0	15

Lab Sample ID: MB 180-418374/6

Matrix: Water

Analysis Batch: 418374

Client Sample ID: Method Blank
Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Fluoride	ND		0.10	0.026	mg/L			11/16/22 12:35	1

Lab Sample ID: LCS 180-418374/7

Matrix: Water

Analysis Batch: 418374

Client Sample ID: Lab Control Sample
Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec Limits
Fluoride	2.50	2.46		mg/L	99	80 - 120	

Lab Sample ID: 180-147730-A-7 MS

Matrix: Water

Analysis Batch: 418374

Client Sample ID: Matrix Spike
Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	%Rec Limits
Fluoride	0.034	J	2.50	2.68		mg/L	106	80 - 120	

Lab Sample ID: 180-147730-A-7 MSD

Matrix: Water

Analysis Batch: 418374

Client Sample ID: Matrix Spike Duplicate
Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	%Rec Limits	RPD	RPD Limit
Fluoride	0.034	J	2.50	2.81		mg/L	111	80 - 120		5	15

Method: EPA 6020A - Metals (ICP/MS)

Lab Sample ID: MB 180-418688/1-A

Matrix: Water

Analysis Batch: 419634

Client Sample ID: Method Blank
Prep Type: Total Recoverable
Prep Batch: 418688

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Antimony	0.000887	J	0.0020	0.00051	mg/L		11/18/22 17:39	12/01/22 13:00	1
Arsenic	ND		0.0010	0.00028	mg/L		11/18/22 17:39	12/01/22 13:00	1
Barium	ND		0.010	0.0031	mg/L		11/18/22 17:39	12/01/22 13:00	1
Beryllium	ND		0.0010	0.00027	mg/L		11/18/22 17:39	12/01/22 13:00	1
Cadmium	ND		0.0010	0.00022	mg/L		11/18/22 17:39	12/01/22 13:00	1
Calcium	ND		0.50	0.13	mg/L		11/18/22 17:39	12/01/22 13:00	1

Eurofins Pittsburgh

QC Sample Results

Client: Haley & Aldrich, Inc.
Project/Site: CCR Groundwater Monitoring

Job ID: 180-147725-1
SDG: AB Brown

Method: EPA 6020A - Metals (ICP/MS) (Continued)

Lab Sample ID: MB 180-418688/1-A

Matrix: Water

Analysis Batch: 419634

Client Sample ID: Method Blank

Prep Type: Total Recoverable

Prep Batch: 418688

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Chromium	ND		0.0020	0.0015	mg/L		11/18/22 17:39	12/01/22 13:00	1
Cobalt	ND		0.00050	0.00026	mg/L		11/18/22 17:39	12/01/22 13:00	1
Lead	0.000619	J	0.0010	0.00017	mg/L		11/18/22 17:39	12/01/22 13:00	1
Lithium	ND		0.0050	0.00083	mg/L		11/18/22 17:39	12/01/22 13:00	1
Molybdenum	ND		0.0050	0.00061	mg/L		11/18/22 17:39	12/01/22 13:00	1
Selenium	ND		0.0050	0.00074	mg/L		11/18/22 17:39	12/01/22 13:00	1
Thallium	ND		0.0010	0.00047	mg/L		11/18/22 17:39	12/01/22 13:00	1

Lab Sample ID: MB 180-418688/1-A

Matrix: Water

Analysis Batch: 419721

Client Sample ID: Method Blank

Prep Type: Total Recoverable

Prep Batch: 418688

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Boron	ND		0.080	0.060	mg/L		11/18/22 17:39	12/02/22 13:31	1

Lab Sample ID: LCS 180-418688/2-A

Matrix: Water

Analysis Batch: 419634

Client Sample ID: Lab Control Sample

Prep Type: Total Recoverable

Prep Batch: 418688

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	Limits
Antimony	0.250	0.285		mg/L		114	80 - 120
Arsenic	1.00	1.01		mg/L		101	80 - 120
Barium	1.00	0.945		mg/L		94	80 - 120
Beryllium	0.500	0.519		mg/L		104	80 - 120
Cadmium	0.500	0.530		mg/L		106	80 - 120
Calcium	25.0	26.7		mg/L		107	80 - 120
Chromium	0.500	0.543		mg/L		109	80 - 120
Cobalt	0.500	0.523		mg/L		105	80 - 120
Lead	0.500	0.540		mg/L		108	80 - 120
Lithium	0.500	0.507		mg/L		101	80 - 120
Molybdenum	0.500	0.544		mg/L		109	80 - 120
Selenium	1.00	1.01		mg/L		101	80 - 120
Thallium	1.00	1.13		mg/L		113	80 - 120

Lab Sample ID: LCS 180-418688/2-A

Matrix: Water

Analysis Batch: 419721

Client Sample ID: Lab Control Sample

Prep Type: Total Recoverable

Prep Batch: 418688

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	Limits
Boron	1.25	1.22		mg/L		98	80 - 120

Lab Sample ID: 180-147725-1 MS

Matrix: Water

Analysis Batch: 419634

Client Sample ID: CCR-SP-1

Prep Type: Total Recoverable

Prep Batch: 418688

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	Limits
Antimony	0.00052	J B	0.250	0.275		mg/L		110	75 - 125
Arsenic	0.0074		1.00	1.00		mg/L		100	75 - 125
Barium	0.064		1.00	0.972		mg/L		91	75 - 125
Beryllium	ND		0.500	0.497		mg/L		99	75 - 125

Eurofins Pittsburgh

QC Sample Results

Client: Haley & Aldrich, Inc.
Project/Site: CCR Groundwater Monitoring

Job ID: 180-147725-1
SDG: AB Brown

Method: EPA 6020A - Metals (ICP/MS) (Continued)

Lab Sample ID: 180-147725-1 MS

Matrix: Water

Analysis Batch: 419634

Client Sample ID: CCR-SP-1

Prep Type: Total Recoverable

Prep Batch: 418688

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	Limits		
Cadmium	ND		0.500	0.505		mg/L	101	75 - 125			
Calcium	240		25.0	247	4	mg/L	44	75 - 125			
Chromium	ND		0.500	0.514		mg/L	103	75 - 125			
Cobalt	0.0042		0.500	0.506		mg/L	100	75 - 125			
Lead	0.00057	J B	0.500	0.521		mg/L	104	75 - 125			
Lithium	0.0061		0.500	0.493		mg/L	97	75 - 125			
Molybdenum	0.00061	J	0.500	0.534		mg/L	107	75 - 125			
Selenium	ND		1.00	0.938		mg/L	94	75 - 125			
Thallium	ND		1.00	1.10		mg/L	110	75 - 125			

Lab Sample ID: 180-147725-1 MS

Matrix: Water

Analysis Batch: 419721

Client Sample ID: CCR-SP-1

Prep Type: Total Recoverable

Prep Batch: 418688

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	Limits		
Boron	0.46		1.25	1.63		mg/L	94	75 - 125			

Lab Sample ID: 180-147725-1 MSD

Matrix: Water

Analysis Batch: 419634

Client Sample ID: CCR-SP-1

Prep Type: Total Recoverable

Prep Batch: 418688

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	Limits	RPD	Limit
Antimony	0.00052	J B	0.250	0.275		mg/L	110	75 - 125		0	20
Arsenic	0.0074		1.00	1.00		mg/L	99	75 - 125		0	20
Barium	0.064		1.00	0.969		mg/L	91	75 - 125		0	20
Beryllium	ND		0.500	0.494		mg/L	99	75 - 125		1	20
Cadmium	ND		0.500	0.501		mg/L	100	75 - 125		1	20
Calcium	240		25.0	244	4	mg/L	33	75 - 125		1	20
Chromium	ND		0.500	0.517		mg/L	103	75 - 125		1	20
Cobalt	0.0042		0.500	0.506		mg/L	100	75 - 125		0	20
Lead	0.00057	J B	0.500	0.523		mg/L	104	75 - 125		0	20
Lithium	0.0061		0.500	0.482		mg/L	95	75 - 125		2	20
Molybdenum	0.00061	J	0.500	0.536		mg/L	107	75 - 125		0	20
Selenium	ND		1.00	0.933		mg/L	93	75 - 125		1	20
Thallium	ND		1.00	1.10		mg/L	110	75 - 125		0	20

Lab Sample ID: 180-147725-1 MSD

Matrix: Water

Analysis Batch: 419721

Client Sample ID: CCR-SP-1

Prep Type: Total Recoverable

Prep Batch: 418688

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	Limits	RPD	Limit
Boron	0.46		1.25	1.67		mg/L	97	75 - 125		2	20

QC Sample Results

Client: Haley & Aldrich, Inc.
Project/Site: CCR Groundwater Monitoring

Job ID: 180-147725-1
SDG: AB Brown

Method: EPA 7470A - Mercury (CVAA)

Lab Sample ID: MB 180-418196/1-A

Matrix: Water

Analysis Batch: 418493

Client Sample ID: Method Blank

Prep Type: Total/NA

Prep Batch: 418196

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Mercury	ND		0.00020	0.00013	mg/L		11/15/22 08:26	11/17/22 06:53	1

Lab Sample ID: LCS 180-418196/2-A

Matrix: Water

Analysis Batch: 418493

Client Sample ID: Lab Control Sample

Prep Type: Total/NA

Prep Batch: 418196

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	Limits
Mercury	0.00250	0.00231		mg/L		92	80 - 120

Lab Sample ID: 180-147725-1 MS

Matrix: Water

Analysis Batch: 418493

Client Sample ID: CCR-SP-1

Prep Type: Total/NA

Prep Batch: 418196

Analyte	Sample Result	Sample Qualifier	Spike Added	MS Result	MS Qualifier	Unit	D	%Rec	Limits
Mercury	ND		0.00100	0.000838		mg/L		84	75 - 125

Lab Sample ID: 180-147725-1 MSD

Matrix: Water

Analysis Batch: 418493

Client Sample ID: CCR-SP-1

Prep Type: Total/NA

Prep Batch: 418196

Analyte	Sample Result	Sample Qualifier	Spike Added	MSD Result	MSD Qualifier	Unit	D	%Rec	Limits	RPD	Limit
Mercury	ND		0.00100	0.000828		mg/L		83	75 - 125	1	20

Method: EPA 9040C - pH

Lab Sample ID: LCS 180-418214/59

Matrix: Water

Analysis Batch: 418214

Client Sample ID: Lab Control Sample

Prep Type: Total/NA

Analyte	Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	Limits
pH	7.00	7.0		SU		100	99 - 101

Lab Sample ID: 180-147725-10 DU

Matrix: Water

Analysis Batch: 418214

Client Sample ID: CCR-AP-3R

Prep Type: Total/NA

Analyte	Sample Result	Sample Qualifier	DU Result	DU Qualifier	Unit	D	RPD	Limit
pH	7.6	HF	7.7		SU		0.7	2

Method: SM 2540C - Solids, Total Dissolved (TDS)

Lab Sample ID: MB 180-417994/1

Matrix: Water

Analysis Batch: 417994

Client Sample ID: Method Blank

Prep Type: Total/NA

Analyte	MB Result	MB Qualifier	RL	MDL	Unit	D	Prepared	Analyzed	Dil Fac
Total Dissolved Solids	ND		10	10	mg/L		11/11/22 16:10		1

Eurofins Pittsburgh

QC Sample Results

Client: Haley & Aldrich, Inc.
Project/Site: CCR Groundwater Monitoring

Job ID: 180-147725-1
SDG: AB Brown

Method: SM 2540C - Solids, Total Dissolved (TDS) (Continued)

Lab Sample ID: LCS 180-417994/2 Matrix: Water Analysis Batch: 417994				Client Sample ID: Lab Control Sample Prep Type: Total/NA							
Analyte		Spike Added	LCS Result	LCS Qualifier	Unit	D	%Rec	%Rec	Limits		
Total Dissolved Solids		388	384		mg/L	99			85 - 115		
Lab Sample ID: 180-147710-E-1 DU Matrix: Water Analysis Batch: 417994				Client Sample ID: Duplicate Prep Type: Total/NA							
Analyte	Sample Result	Sample Qualifier	DU Result	DU Qualifier	Unit	D		RPD	Limit		
Total Dissolved Solids	170		163		mg/L			5	10		

Method: 9315 - Radium-226 (GFPC)

Lab Sample ID: MB 160-590394/1-A Matrix: Water Analysis Batch: 592998								Client Sample ID: Method Blank Prep Type: Total/NA Prep Batch: 590394			
Analyte	MB Result	MB Qualifier	Count Uncert. (2σ+/-)	Total Uncert. (2σ+/-)	RL	MDC	Unit	Prepared	Analyzed	Dil Fac	
Radium-226	0.1212	U	0.185	0.185	1.00	0.318	pCi/L	11/17/22 09:40	12/09/22 16:51		1
Carrier	MB %Yield	MB Qualifier	Limits					Prepared	Analyzed	Dil Fac	
Ba Carrier	104		40 - 110					11/17/22 09:40	12/09/22 16:51		1

Lab Sample ID: LCS 160-590394/2-A Matrix: Water Analysis Batch: 592998

Client Sample ID: Lab Control Sample
Prep Type: Total/NA
Prep Batch: 590394

Lab Sample ID: LCS 160-590394/2-A Matrix: Water Analysis Batch: 592998								Client Sample ID: Lab Control Sample Prep Type: Total/NA Prep Batch: 590394			
Analyte	Spike Added	LCS Result	LCS Qual	Total Uncert. (2σ+/-)	RL	MDC	Unit	%Rec	%Rec	Limits	
Radium-226	11.3	10.47		1.35	1.00	0.335	pCi/L	92		75 - 125	
Carrier	LCS %Yield	LCS Qualifier	Limits								
Ba Carrier	97.3		40 - 110								

Lab Sample ID: 180-147725-1 DU Matrix: Water Analysis Batch: 592998

Client Sample ID: CCR-SP-1
Prep Type: Total/NA
Prep Batch: 590394

Lab Sample ID: 180-147725-1 DU Matrix: Water Analysis Batch: 592998								Client Sample ID: CCR-SP-1 Prep Type: Total/NA Prep Batch: 590394			
Analyte	Sample Result	Sample Qual	DU Result	DU Qual	Total Uncert. (2σ+/-)	RL	MDC	Unit	RER	RER	Limit
Radium-226	0.0827	U	0.4222		0.282	1.00	0.383	pCi/L	0.63		1
Carrier	DU %Yield	DU Qualifier	Limits								
Ba Carrier	75.6		40 - 110								

QC Sample Results

Client: Haley & Aldrich, Inc.
Project/Site: CCR Groundwater Monitoring

Job ID: 180-147725-1
SDG: AB Brown

Method: 9320 - Radium-228 (GFPC)

Lab Sample ID: MB 160-590396/1-A

Matrix: Water

Analysis Batch: 592998

Client Sample ID: Method Blank

Prep Type: Total/NA

Prep Batch: 590396

Analyte	MB	MB	Qualifier	Count	Total	RL	MDC	Unit	Prepared	Analyzed	Dil Fac
	Result	Uncert.		(2σ+/-)	Uncert.						
Radium-228	0.4769	U		0.321	0.324	1.00	0.479	pCi/L	11/17/22 10:15	12/09/22 12:14	1
Carrier											
Ba Carrier	MB	MB	Qualifier	Limits		Prepared	Analyzed	Dil Fac	11/17/22 10:15	12/09/22 12:14	1
	%Yield			40 - 110							
Y Carrier	104		80.7	40 - 110		11/17/22 10:15	12/09/22 12:14	1	11/17/22 10:15	12/09/22 12:14	1

Lab Sample ID: LCS 160-590396/2-A

Matrix: Water

Analysis Batch: 592998

Client Sample ID: Lab Control Sample

Prep Type: Total/NA

Prep Batch: 590396

Analyte	MB	MB	Qualifier	Spike	LCS	LCS	Total Uncert.	(2σ+/-)	RL	MDC	Unit	%Rec	Limits						
	Result	Added		Result	Qual	Qual													
Radium-228		8.38		9.363			1.29		1.00	0.620	pCi/L	112	75 - 125						
Carrier																			
Ba Carrier	MB	MB	Qualifier	Limits		Prepared	Analyzed	Dil Fac	11/17/22 10:15	12/09/22 12:14	1	11/17/22 10:15	12/09/22 12:14						
	%Yield			40 - 110															
Y Carrier	97.3		80.4	40 - 110															

Lab Sample ID: 180-147725-1 DU

Matrix: Water

Analysis Batch: 592998

Client Sample ID: CCR-SP-1

Prep Type: Total/NA

Prep Batch: 590396

Analyte	Sample	Sample	Qualifier	DU	DU	Total Uncert.	(2σ+/-)	RL	MDC	Unit	RER	Limit							
	Result	Qual		Result	Qual														
Radium-228		-0.0441	U		0.3775	U	0.429	1.00	0.701	pCi/L	0.55	1							
Carrier																			
Ba Carrier	DU	DU	Qualifier	Limits		Prepared	Analyzed	Dil Fac	11/17/22 10:15	12/09/22 12:14	1	11/17/22 10:15	12/09/22 12:14						
	%Yield			40 - 110															
Y Carrier	75.6		81.1	40 - 110															

Method: Ra226_Ra228 - Combined Radium-226 and Radium-228

Lab Sample ID: 180-147725-1 DU

Matrix: Water

Analysis Batch: 593323

Client Sample ID: CCR-SP-1

Prep Type: Total/NA

Analyte	Sample	Sample	Qualifier	DU	DU	Total Uncert.	(2σ+/-)	RL	MDC	Unit	RER	Limit
	Result	Qual		Result	Qual							
Combined Radium 226 + 228	0.0386	U		0.7998		0.513		5.00	0.701	pCi/L	0.82	1

Eurofins Pittsburgh

QC Association Summary

Client: Haley & Aldrich, Inc.

Project/Site: CCR Groundwater Monitoring

Job ID: 180-147725-1

SDG: AB Brown

HPLC/IC

Analysis Batch: 418020

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
180-147725-1	CCR-SP-1	Total/NA	Water	EPA 9056A	
180-147725-2	CCR-SP-2	Total/NA	Water	EPA 9056A	
180-147725-3	CCR-SP-3	Total/NA	Water	EPA 9056A	
180-147725-4	BLIND DUP	Total/NA	Water	EPA 9056A	
180-147725-5	FIELD BLANK	Total/NA	Water	EPA 9056A	
180-147725-6	CCR-BK-1	Total/NA	Water	EPA 9056A	
180-147725-7	CCR-BK-2	Total/NA	Water	EPA 9056A	
180-147725-8	CCR-AP-2R	Total/NA	Water	EPA 9056A	
180-147725-9	CCR-AP-2I	Total/NA	Water	EPA 9056A	
180-147725-10	CCR-AP-3R	Total/NA	Water	EPA 9056A	
180-147725-10	CCR-AP-3R	Total/NA	Water	EPA 9056A	
180-147725-11	CCR-AP-3I	Total/NA	Water	EPA 9056A	
MB 180-418020/22	Method Blank	Total/NA	Water	EPA 9056A	
LCS 180-418020/23	Lab Control Sample	Total/NA	Water	EPA 9056A	
180-147725-1 MS	CCR-SP-1	Total/NA	Water	EPA 9056A	
180-147725-1 MSD	CCR-SP-1	Total/NA	Water	EPA 9056A	

Analysis Batch: 418279

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
180-147725-8	CCR-AP-2R	Total/NA	Water	EPA 9056A	
MB 180-418279/22	Method Blank	Total/NA	Water	EPA 9056A	
LCS 180-418279/23	Lab Control Sample	Total/NA	Water	EPA 9056A	
180-147910-D-1 MS	Matrix Spike	Total/NA	Water	EPA 9056A	
180-147910-D-1 MSD	Matrix Spike Duplicate	Total/NA	Water	EPA 9056A	

Analysis Batch: 418374

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
180-147725-5	FIELD BLANK	Total/NA	Water	EPA 9056A	
MB 180-418374/6	Method Blank	Total/NA	Water	EPA 9056A	
LCS 180-418374/7	Lab Control Sample	Total/NA	Water	EPA 9056A	
180-147730-A-7 MS	Matrix Spike	Total/NA	Water	EPA 9056A	
180-147730-A-7 MSD	Matrix Spike Duplicate	Total/NA	Water	EPA 9056A	

Metals

Prep Batch: 418196

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
180-147725-1	CCR-SP-1	Total/NA	Water	7470A	
180-147725-2	CCR-SP-2	Total/NA	Water	7470A	
180-147725-3	CCR-SP-3	Total/NA	Water	7470A	
180-147725-4	BLIND DUP	Total/NA	Water	7470A	
180-147725-5	FIELD BLANK	Total/NA	Water	7470A	
180-147725-6	CCR-BK-1	Total/NA	Water	7470A	
180-147725-7	CCR-BK-2	Total/NA	Water	7470A	
180-147725-8	CCR-AP-2R	Total/NA	Water	7470A	
180-147725-9	CCR-AP-2I	Total/NA	Water	7470A	
180-147725-10	CCR-AP-3R	Total/NA	Water	7470A	
180-147725-11	CCR-AP-3I	Total/NA	Water	7470A	
MB 180-418196/1-A	Method Blank	Total/NA	Water	7470A	
LCS 180-418196/2-A	Lab Control Sample	Total/NA	Water	7470A	
180-147725-1 MS	CCR-SP-1	Total/NA	Water	7470A	

QC Association Summary

Client: Haley & Aldrich, Inc.

Project/Site: CCR Groundwater Monitoring

Job ID: 180-147725-1

SDG: AB Brown

Metals (Continued)

Prep Batch: 418196 (Continued)

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
180-147725-1 MSD	CCR-SP-1	Total/NA	Water	7470A	

Analysis Batch: 418493

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
180-147725-1	CCR-SP-1	Total/NA	Water	EPA 7470A	418196
180-147725-2	CCR-SP-2	Total/NA	Water	EPA 7470A	418196
180-147725-3	CCR-SP-3	Total/NA	Water	EPA 7470A	418196
180-147725-4	BLIND DUP	Total/NA	Water	EPA 7470A	418196
180-147725-5	FIELD BLANK	Total/NA	Water	EPA 7470A	418196
180-147725-6	CCR-BK-1	Total/NA	Water	EPA 7470A	418196
180-147725-7	CCR-BK-2	Total/NA	Water	EPA 7470A	418196
180-147725-8	CCR-AP-2R	Total/NA	Water	EPA 7470A	418196
180-147725-9	CCR-AP-2I	Total/NA	Water	EPA 7470A	418196
180-147725-10	CCR-AP-3R	Total/NA	Water	EPA 7470A	418196
180-147725-11	CCR-AP-3I	Total/NA	Water	EPA 7470A	418196
MB 180-418196/1-A	Method Blank	Total/NA	Water	EPA 7470A	418196
LCS 180-418196/2-A	Lab Control Sample	Total/NA	Water	EPA 7470A	418196
180-147725-1 MS	CCR-SP-1	Total/NA	Water	EPA 7470A	418196
180-147725-1 MSD	CCR-SP-1	Total/NA	Water	EPA 7470A	418196

Prep Batch: 418688

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
180-147725-1	CCR-SP-1	Total Recoverable	Water	3005A	
180-147725-2	CCR-SP-2	Total Recoverable	Water	3005A	
180-147725-3	CCR-SP-3	Total Recoverable	Water	3005A	
180-147725-4	BLIND DUP	Total Recoverable	Water	3005A	
180-147725-5	FIELD BLANK	Total Recoverable	Water	3005A	
180-147725-6	CCR-BK-1	Total Recoverable	Water	3005A	
180-147725-7	CCR-BK-2	Total Recoverable	Water	3005A	
180-147725-8	CCR-AP-2R	Total Recoverable	Water	3005A	
180-147725-9	CCR-AP-2I	Total Recoverable	Water	3005A	
180-147725-10	CCR-AP-3R	Total Recoverable	Water	3005A	
180-147725-11	CCR-AP-3I	Total Recoverable	Water	3005A	
MB 180-418688/1-A	Method Blank	Total Recoverable	Water	3005A	
LCS 180-418688/2-A	Lab Control Sample	Total Recoverable	Water	3005A	
180-147725-1 MS	CCR-SP-1	Total Recoverable	Water	3005A	
180-147725-1 MSD	CCR-SP-1	Total Recoverable	Water	3005A	

Analysis Batch: 419634

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
180-147725-1	CCR-SP-1	Total Recoverable	Water	EPA 6020A	418688
180-147725-2	CCR-SP-2	Total Recoverable	Water	EPA 6020A	418688
180-147725-3	CCR-SP-3	Total Recoverable	Water	EPA 6020A	418688
180-147725-4	BLIND DUP	Total Recoverable	Water	EPA 6020A	418688
180-147725-5	FIELD BLANK	Total Recoverable	Water	EPA 6020A	418688
180-147725-6	CCR-BK-1	Total Recoverable	Water	EPA 6020A	418688
180-147725-7	CCR-BK-2	Total Recoverable	Water	EPA 6020A	418688
180-147725-8	CCR-AP-2R	Total Recoverable	Water	EPA 6020A	418688
180-147725-9	CCR-AP-2I	Total Recoverable	Water	EPA 6020A	418688
180-147725-10	CCR-AP-3R	Total Recoverable	Water	EPA 6020A	418688
180-147725-11	CCR-AP-3I	Total Recoverable	Water	EPA 6020A	418688

Eurofins Pittsburgh

QC Association Summary

Client: Haley & Aldrich, Inc.

Project/Site: CCR Groundwater Monitoring

Job ID: 180-147725-1

SDG: AB Brown

Metals (Continued)

Analysis Batch: 419634 (Continued)

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
MB 180-418688/1-A	Method Blank	Total Recoverable	Water	EPA 6020A	418688
LCS 180-418688/2-A	Lab Control Sample	Total Recoverable	Water	EPA 6020A	418688
180-147725-1 MS	CCR-SP-1	Total Recoverable	Water	EPA 6020A	418688
180-147725-1 MSD	CCR-SP-1	Total Recoverable	Water	EPA 6020A	418688

Analysis Batch: 419721

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
180-147725-1	CCR-SP-1	Total Recoverable	Water	EPA 6020A	418688
180-147725-2	CCR-SP-2	Total Recoverable	Water	EPA 6020A	418688
180-147725-3	CCR-SP-3	Total Recoverable	Water	EPA 6020A	418688
180-147725-4	BLIND DUP	Total Recoverable	Water	EPA 6020A	418688
180-147725-5	FIELD BLANK	Total Recoverable	Water	EPA 6020A	418688
180-147725-6	CCR-BK-1	Total Recoverable	Water	EPA 6020A	418688
180-147725-7	CCR-BK-2	Total Recoverable	Water	EPA 6020A	418688
180-147725-9	CCR-AP-2I	Total Recoverable	Water	EPA 6020A	418688
180-147725-11	CCR-AP-3I	Total Recoverable	Water	EPA 6020A	418688
MB 180-418688/1-A	Method Blank	Total Recoverable	Water	EPA 6020A	418688
LCS 180-418688/2-A	Lab Control Sample	Total Recoverable	Water	EPA 6020A	418688
180-147725-1 MS	CCR-SP-1	Total Recoverable	Water	EPA 6020A	418688
180-147725-1 MSD	CCR-SP-1	Total Recoverable	Water	EPA 6020A	418688

Analysis Batch: 419882

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
180-147725-8	CCR-AP-2R	Total Recoverable	Water	EPA 6020A	418688
180-147725-10	CCR-AP-3R	Total Recoverable	Water	EPA 6020A	418688

General Chemistry

Analysis Batch: 417994

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
180-147725-1	CCR-SP-1	Total/NA	Water	SM 2540C	
180-147725-2	CCR-SP-2	Total/NA	Water	SM 2540C	
180-147725-3	CCR-SP-3	Total/NA	Water	SM 2540C	
180-147725-4	BLIND DUP	Total/NA	Water	SM 2540C	
180-147725-5	FIELD BLANK	Total/NA	Water	SM 2540C	
180-147725-6	CCR-BK-1	Total/NA	Water	SM 2540C	
180-147725-7	CCR-BK-2	Total/NA	Water	SM 2540C	
180-147725-8	CCR-AP-2R	Total/NA	Water	SM 2540C	
180-147725-9	CCR-AP-2I	Total/NA	Water	SM 2540C	
180-147725-10	CCR-AP-3R	Total/NA	Water	SM 2540C	
180-147725-11	CCR-AP-3I	Total/NA	Water	SM 2540C	
MB 180-417994/1	Method Blank	Total/NA	Water	SM 2540C	
LCS 180-417994/2	Lab Control Sample	Total/NA	Water	SM 2540C	
180-147710-E-1 DU	Duplicate	Total/NA	Water	SM 2540C	

Analysis Batch: 418214

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
180-147725-1	CCR-SP-1	Total/NA	Water	EPA 9040C	
180-147725-2	CCR-SP-2	Total/NA	Water	EPA 9040C	
180-147725-3	CCR-SP-3	Total/NA	Water	EPA 9040C	
180-147725-4	BLIND DUP	Total/NA	Water	EPA 9040C	

Eurofins Pittsburgh

QC Association Summary

Client: Haley & Aldrich, Inc.

Project/Site: CCR Groundwater Monitoring

Job ID: 180-147725-1

SDG: AB Brown

General Chemistry (Continued)

Analysis Batch: 418214 (Continued)

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
180-147725-5	FIELD BLANK	Total/NA	Water	EPA 9040C	
180-147725-6	CCR-BK-1	Total/NA	Water	EPA 9040C	
180-147725-7	CCR-BK-2	Total/NA	Water	EPA 9040C	
180-147725-8	CCR-AP-2R	Total/NA	Water	EPA 9040C	
180-147725-9	CCR-AP-2I	Total/NA	Water	EPA 9040C	
180-147725-10	CCR-AP-3R	Total/NA	Water	EPA 9040C	
180-147725-11	CCR-AP-3I	Total/NA	Water	EPA 9040C	
LCS 180-418214/59	Lab Control Sample	Total/NA	Water	EPA 9040C	
180-147725-10 DU	CCR-AP-3R	Total/NA	Water	EPA 9040C	

Rad

Prep Batch: 590394

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
180-147725-1	CCR-SP-1	Total/NA	Water	PrecSep-21	
180-147725-2	CCR-SP-2	Total/NA	Water	PrecSep-21	
180-147725-3	CCR-SP-3	Total/NA	Water	PrecSep-21	
180-147725-4	BLIND DUP	Total/NA	Water	PrecSep-21	
180-147725-5	FIELD BLANK	Total/NA	Water	PrecSep-21	
180-147725-6	CCR-BK-1	Total/NA	Water	PrecSep-21	
180-147725-7	CCR-BK-2	Total/NA	Water	PrecSep-21	
180-147725-8	CCR-AP-2R	Total/NA	Water	PrecSep-21	
180-147725-9	CCR-AP-2I	Total/NA	Water	PrecSep-21	
180-147725-10	CCR-AP-3R	Total/NA	Water	PrecSep-21	
180-147725-11	CCR-AP-3I	Total/NA	Water	PrecSep-21	
MB 160-590394/1-A	Method Blank	Total/NA	Water	PrecSep-21	
LCS 160-590394/2-A	Lab Control Sample	Total/NA	Water	PrecSep-21	
180-147725-1 DU	CCR-SP-1	Total/NA	Water	PrecSep-21	

Prep Batch: 590396

Lab Sample ID	Client Sample ID	Prep Type	Matrix	Method	Prep Batch
180-147725-1	CCR-SP-1	Total/NA	Water	PrecSep_0	
180-147725-2	CCR-SP-2	Total/NA	Water	PrecSep_0	
180-147725-3	CCR-SP-3	Total/NA	Water	PrecSep_0	
180-147725-4	BLIND DUP	Total/NA	Water	PrecSep_0	
180-147725-5	FIELD BLANK	Total/NA	Water	PrecSep_0	
180-147725-6	CCR-BK-1	Total/NA	Water	PrecSep_0	
180-147725-7	CCR-BK-2	Total/NA	Water	PrecSep_0	
180-147725-8	CCR-AP-2R	Total/NA	Water	PrecSep_0	
180-147725-9	CCR-AP-2I	Total/NA	Water	PrecSep_0	
180-147725-10	CCR-AP-3R	Total/NA	Water	PrecSep_0	
180-147725-11	CCR-AP-3I	Total/NA	Water	PrecSep_0	
MB 160-590396/1-A	Method Blank	Total/NA	Water	PrecSep_0	
LCS 160-590396/2-A	Lab Control Sample	Total/NA	Water	PrecSep_0	
180-147725-1 DU	CCR-SP-1	Total/NA	Water	PrecSep_0	

370472

3001 Alpha Drive RIDC Park
Pittsburgh, PA 15238
Phone (412) 963-7058 Fax (412) 963-2468



Eurofins Pittsburgh
301 Alpha Drive RIDC Park

301 Alpha Drive RIDC Park
Pittsburgh, PA 15238
Phone: 412-963-7058 Fax: 412-963-2468

Chain of Custody Record

Client Information (Sub Contract Lab)		Sampler: Hayes, Ken		Carrier Tracking No(s): 180-473963-1
Client Contact: Shipping/Receiving Company		Phone: E-Mail: Ken.Hayes@eurofinsus.com		State of Origin: Indiana
Address: TestAmerica Laboratories, Inc.		Accreditations Required (See note):		Job #: 180-147725-1
13715 Rider Trail North, Earth City MO, 63045		Date Requested: 12/15/2022		Preservation Codes:
Phone: 314-298-8566(Tel) 314-298-8757(Fax)		TAT Requested (days):		A - HCl B - NaOH C - Zn Acetate D - Nitric Acid E - NaHSO4 F - MeOH G - Ammonia H - Ascorbic Acid I - Ice J - DI Water K - EDTA L - EDA Other:
Email: WO#:				M - Hexane N - None O - AsNaO2 P - Na2O4S Q - Na2SO3 R - Na2SO3 S - H2SO4 T - TSP Dodecahydrate U - Acetone V - MCA W - pH 4-5 Y - Trizma Z - other (specify)
Project Name: CCR Groundwater Monitoring		Total Number of Contaminants: 21		Total Number of Contaminants: 21
Site: Project #: 18016014		Performance MSDS (Yes or No): Field Filtered Sample (Yes or No): 9320-Ra228Precess-0 Standard Target List		Special Instructions/Note:
SSN#:		Matrix (Water, Soil, Sediment, On-water, Air, Grav):		Ra226Ra228-GFPC
		Sample Date	Sample Time	Preservation Code:
		11/4/22	11:10	Water
		11/4/22	Eastern 11:10	Water
		11/4/22	DU	Water
		11/7/22	Eastern 09:55	Water
		11/7/22	11:15	Water
		11/7/22	00:01	Water
		11/7/22	11:15	Water
		11/8/22	10:15	Water
		11/8/22	12:15	Water
		11/8/22	15:15	Water
		Eastern		
Sample Identification - Client ID (Lab ID)				
CCR-SP-1 (180-147725-1)				
CCR-SP-1 (180-147725-1DU)				
CCR-SP-2 (180-147725-2)				
CCR-SP-3 (180-147725-3)				
BLIND DUP (180-147725-4)				
FIELD BLANK (180-147725-5)				
CCR-BK-1 (180-147725-6)				
CCR-BK-2 (180-147725-7)				
CCR-AP-2R (180-147725-8)				
Note: Since laboratory accreditations are subject to change, Eurofins Pittsburgh places the ownership of methods, analysis & accreditation compliance upon out subcontract laboratories. This sample shipment is forwarded under chain-of-custody. If the laboratory does not currently maintain accreditation in the State of Origin listed above for analysis/test/matrix being analyzed, the samples must be shipped back to the Eurofins Pittsburgh laboratory or other instructions will be provided. Any changes to accreditation status should be brought to Eurofins Pittsburgh attention immediately. If all requested accreditations are current to date, return the signed Chain of Custody attesting to said compliance to Eurofins Pittsburgh.		Primary Deliverable Rank: 2		Possible Hazard Identification
Unconfirmed Deliverable Requested: I, II, III, IV, Other (specify): FED EX		Time: Received by Company <i>2022-11-12 18:00</i>		Sample Disposal (A fee may be assessed if samples are retained longer than 1 month)
		Time: Received by Company <i>2022-11-12 18:00</i>		Disposal By Lab <input type="checkbox"/>
		Time: Received by Company <i>2022-11-12 18:00</i>		Archive For Months <input type="checkbox"/>
Empty Kit Relinquished by: Relinquished by: <i>FED EX</i>		Method of Shipment:		Company <i>2022-11-12 18:00</i>
Custody Seals Intact: Yes <input checked="" type="checkbox"/> No <input type="checkbox"/>		Cooler Temperature(s): °C and Other Remarks:		Company <i>2022-11-12 18:00</i>

۲۷۰ - میرزا ناصر

Chain of Custody Record

Environment Testing

Ver: 06/08/2021

1
2
3
4
5
6
7
8
9
10
11
12
13

Login Sample Receipt Checklist

Client: Haley & Aldrich, Inc.

Job Number: 180-147725-1

SDG Number: AB Brown

Login Number: 147725

List Source: Eurofins Pittsburgh

List Number: 1

Creator: Abernathy, Eric L

Question	Answer	Comment
Radioactivity wasn't checked or is </= background as measured by a survey meter.	N/A	
The cooler's custody seal, if present, is intact.	True	
Sample custody seals, if present, are intact.	True	
The cooler or samples do not appear to have been compromised or tampered with.	True	
Samples were received on ice.	True	
Cooler Temperature is acceptable.	True	
Cooler Temperature is recorded.	True	
COC is present.	True	
COC is filled out in ink and legible.	True	
COC is filled out with all pertinent information.	True	
Is the Field Sampler's name present on COC?	True	
There are no discrepancies between the containers received and the COC.	True	
Samples are received within Holding Time (excluding tests with immediate HTs)	True	
Sample containers have legible labels.	True	
Containers are not broken or leaking.	True	
Sample collection date/times are provided.	True	
Appropriate sample containers are used.	True	
Sample bottles are completely filled.	True	
Sample Preservation Verified.	True	
There is sufficient vol. for all requested analyses, incl. any requested MS/MSDs	True	
Containers requiring zero headspace have no headspace or bubble is <6mm (1/4").	True	
Multiphasic samples are not present.	True	
Samples do not require splitting or compositing.	True	
Residual Chlorine Checked.	N/A	

Login Sample Receipt Checklist

Client: Haley & Aldrich, Inc.

Job Number: 180-147725-1

SDG Number: AB Brown

Login Number: 147725

List Source: Eurofins St. Louis

List Number: 2

List Creation: 11/14/22 11:46 AM

Creator: Bohlmann, Jessica M

Question	Answer	Comment
Radioactivity wasn't checked or is </= background as measured by a survey meter.	True	
The cooler's custody seal, if present, is intact.	True	
Sample custody seals, if present, are intact.	True	
The cooler or samples do not appear to have been compromised or tampered with.	True	
Samples were received on ice.	N/A	
Cooler Temperature is acceptable.	True	
Cooler Temperature is recorded.	True	
COC is present.	True	
COC is filled out in ink and legible.	True	
COC is filled out with all pertinent information.	True	
Is the Field Sampler's name present on COC?	True	
There are no discrepancies between the containers received and the COC.	True	
Samples are received within Holding Time (excluding tests with immediate HTs)	True	
Sample containers have legible labels.	True	
Containers are not broken or leaking.	True	
Sample collection date/times are provided.	True	
Appropriate sample containers are used.	True	
Sample bottles are completely filled.	True	
Sample Preservation Verified.	True	
There is sufficient vol. for all requested analyses, incl. any requested MS/MSDs	True	
Containers requiring zero headspace have no headspace or bubble is <6mm (1/4").	True	
Multiphasic samples are not present.	True	
Samples do not require splitting or compositing.	True	
Residual Chlorine Checked.	N/A	